

Date:


Monday 20 Sep 2021

BSUoS Charge Estimate: £3.20/MWh

Total Outturn: £3.15m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

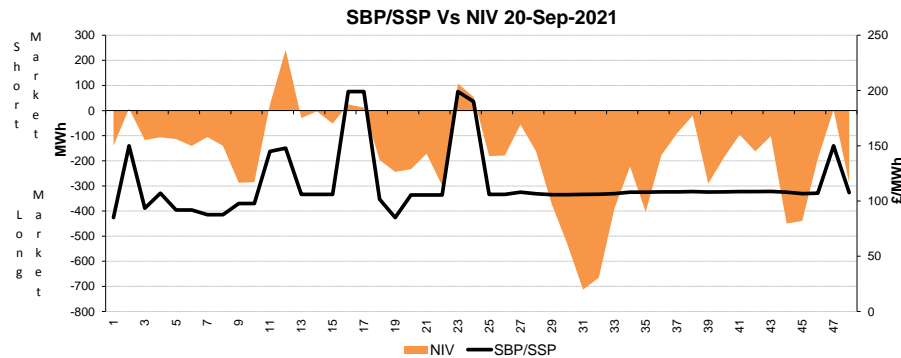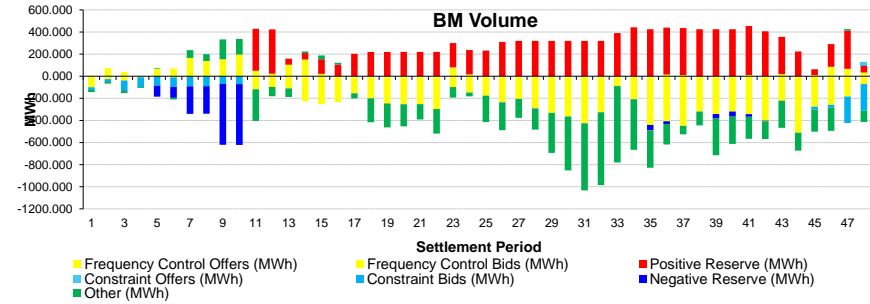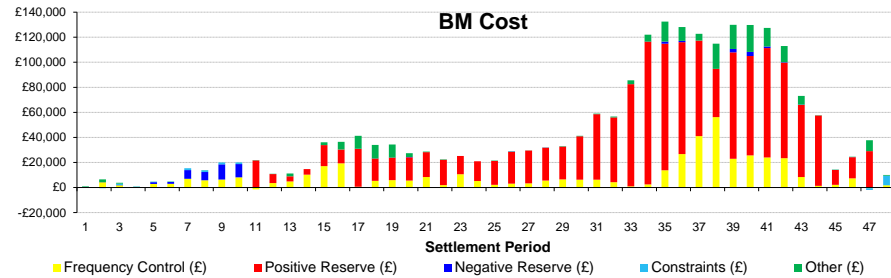

Commentary

A mostly long market. Interconnector Trades were required for Downward Regulation between 2am and 5am, and for Margin between 5am and 6am.

Trades for RoCoF overnight. Voltage Control supported by overnight BM Action in the Midlands area.