
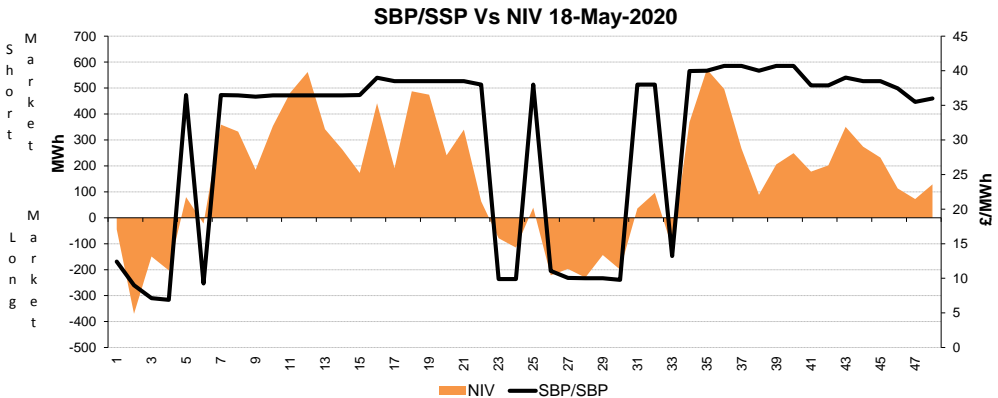
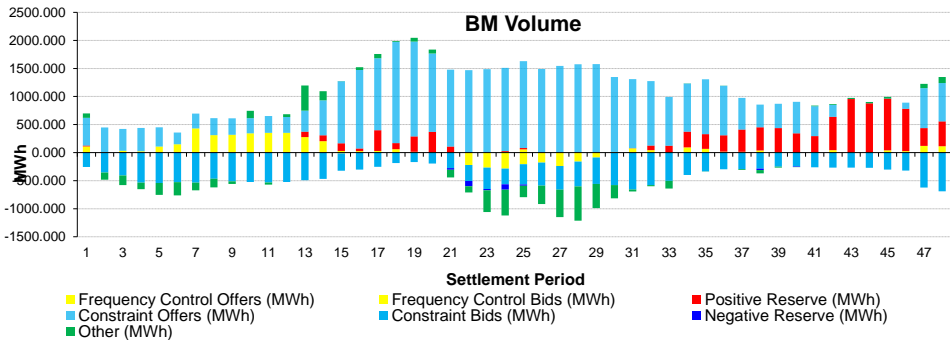
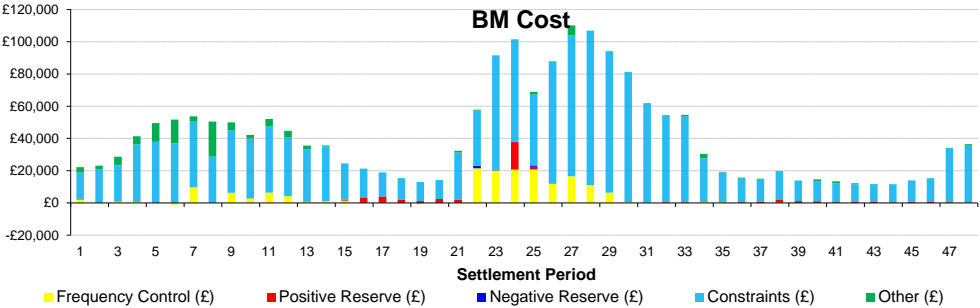
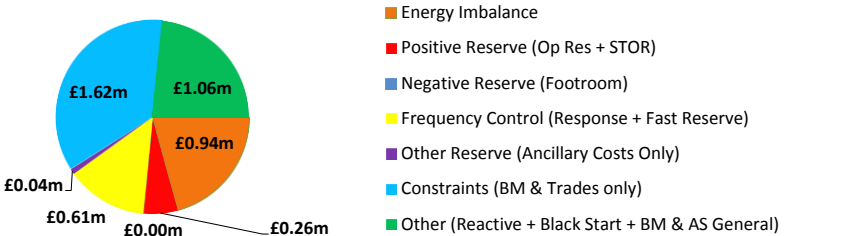


Date: **Monday 18 May 2020**
BSUoS Charge Estimate: £4.67/MWh
Total Outturn: £4.56m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Western Link status: Available

Commentary

The market was mostly short throughout the day with a few dips into a long position. In the morning inertia requirements required additional plant, which caused downwards regulation challenges throughout the morning. In the evening wind was 900MW below forecast.

A combination of trades and BM Actions were required for voltage management. Interconnector trades were done in the morning for RoCoF and BM Actions were used for RoCoF in the evening.