



Dispatch 'Case for Change'

12th March 2024

Introduction

- We are concerned that the current GB Dispatch Mechanism design, including the Balancing Mechanism, is not working as intended.
- ESO is now supporting DESNZ' REMA Programme by leading the 'Dispatch' workstream. This includes options for reform to the Balancing Mechanism.

Objectives for the workshop:

1. Get your feedback on whether you agree with the challenges identified, and whether we have missed anything
2. Capture the impact of these challenges on market stakeholders

Agenda

Item			Time
Foreword		Cian McLeavey-Reville (ESO)	13:05 – 13:10
ESO Intro		Izzie Sunnucks (ESO)	13:10 – 13:20
DESNZ Intro		Nick Allen	13:20 – 13:25
Exec Summary		Stephen Woodhouse (AFRY)	13:25 – 13:45
Challenge 1: Incentives	Presentation & Clarification questions	Francisco Celis-Andrade (ESO)	13:45 – 14:10
	Activity 1		14:10 – 14:30
Challenge 2: Visibility and Access	Presentation & Clarification questions	Marie Hayden (Grid Enhancing Technologies) Romain Bourdette (AFRY)	14:30 – 14:55
	Activity 2		14:55 – 15:15
Coffee Break			15:15 – 15:35
Challenge 3: Intertemporal Issues	Presentation & Clarification questions	Kostas Theodoropoulos (AFRY) Rob Westmancoat (ESO)	15:40 – 16:05
	Activity 3		16:05 – 16:25
Conclusions		Stephen Woodhouse (AFRY)	16:25 – 16:35
Q&A/Next Steps		Izzie Sunnucks (ESO)	16:35 – 17:00

Next Steps

Feedback

- We would hugely appreciate your feedback on this work.
- Following today we will send a form with questions relating to the presentation content

Case for Change

- The slides and a summary of the discussion today will be published on our Net Zero Market Reform [website](#)
- We will then integrate workshop feedback into the final 'Case for Change' report

Options for Reform

1. **Industry idea generation:** Following the workshop, we will welcome organisations sending us their proposals for how the issues raised can best be addressed
2. **ESO option sharing:** We plan to run a follow-up workshop outlining the spectrum of options we have identified to address the issues raised, **likely in May**

Other related work

- We have in parallel been assessing the interactions between energy and ancillary services looking at the pros and cons of more co-optimised procurement
- We will run be engaging with stakeholders on this project in the coming months




ESO Intro

Scope of this work

GB Dispatch Design includes multiple interlocking features governed by different parties, and sets ESO up to be a residual balancer

- 1 Design of spot markets
- 2 Timing of Gate Closure
- 3 Balancing Market or Mechanism
- 4 How is imbalance exposure allocated (i.e profiled or case based settlement)
- 5 Settlement Period Length
- 6 Speed of feedback loop

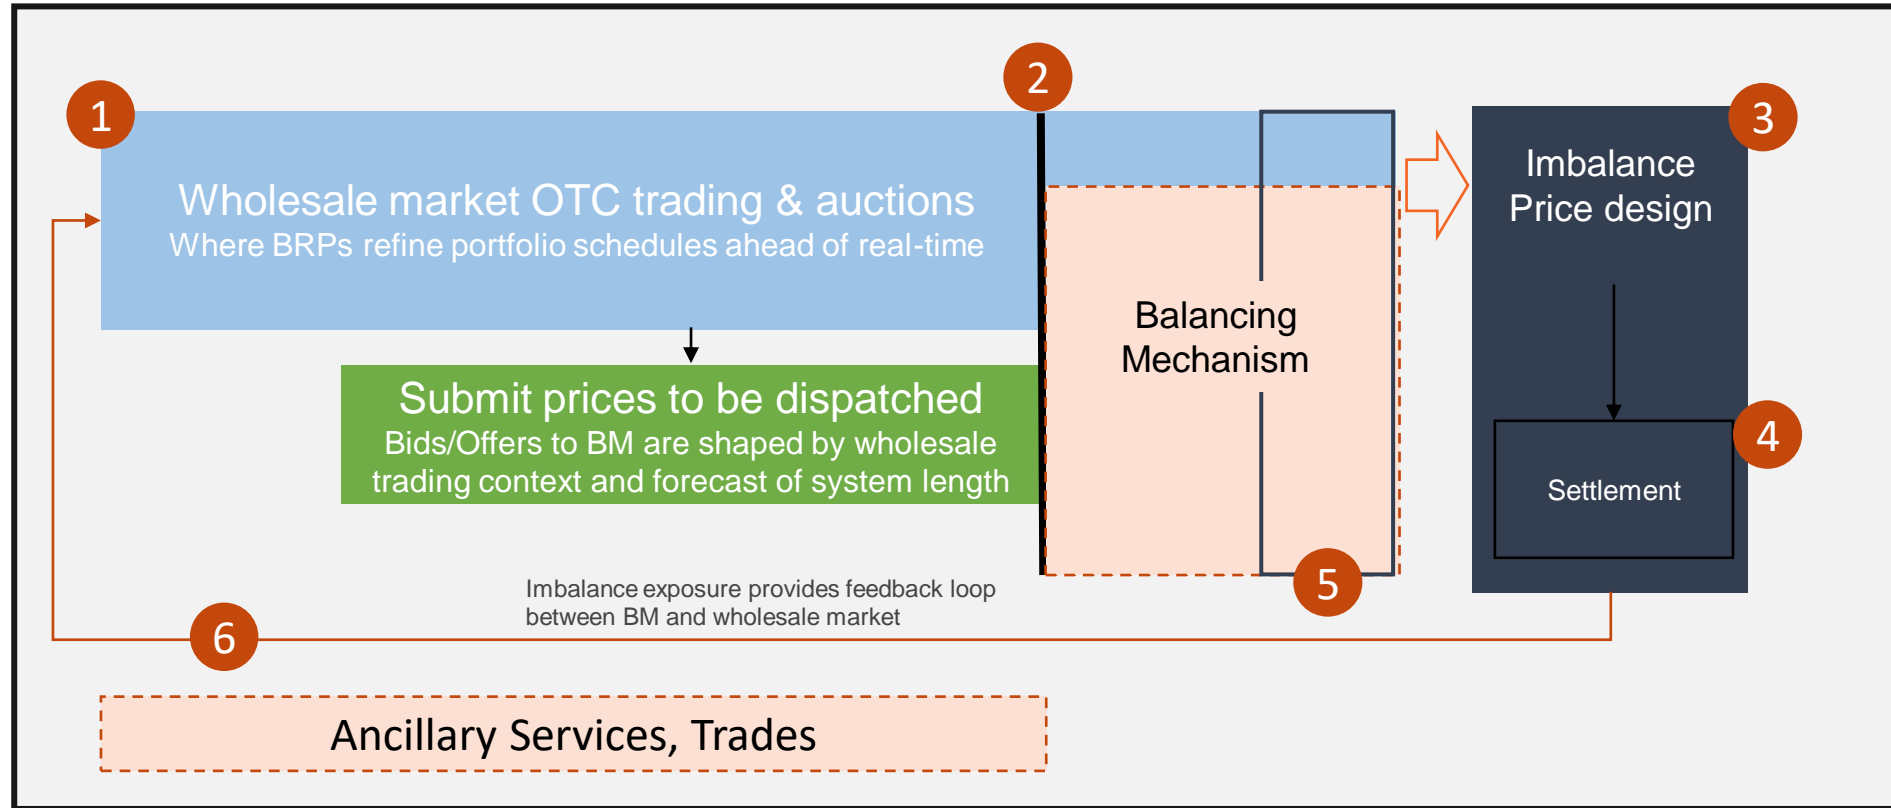


Why are we exploring the Case for Change?

As operating the system becomes more challenging, we are concerned that ESO is becoming a 'Central Scheduler', contrary to its intended role

Theoretical GB market design

The GB market was designed assuming the ESO only intervenes at the last minute

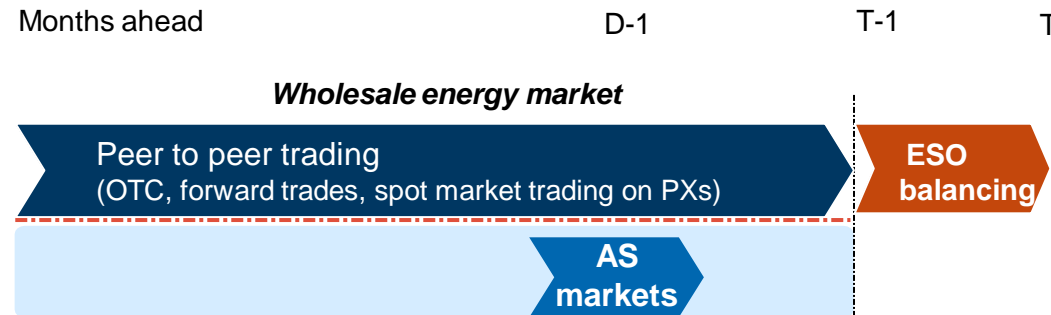

De facto GB market operation

As optimising the system becomes harder, ESO is overlapping with the wholesale market, creating confusing price signals




The growing overlap between ESO redispatch and wholesale market trading can create conflicting price signals and impact overall transparency

Assessment Framework

Overarching Objective for future Dispatch Mechanism Design:
To facilitate secure operation of a net zero electricity system and drive value for consumers



How does this work fit with other ESO programmes?

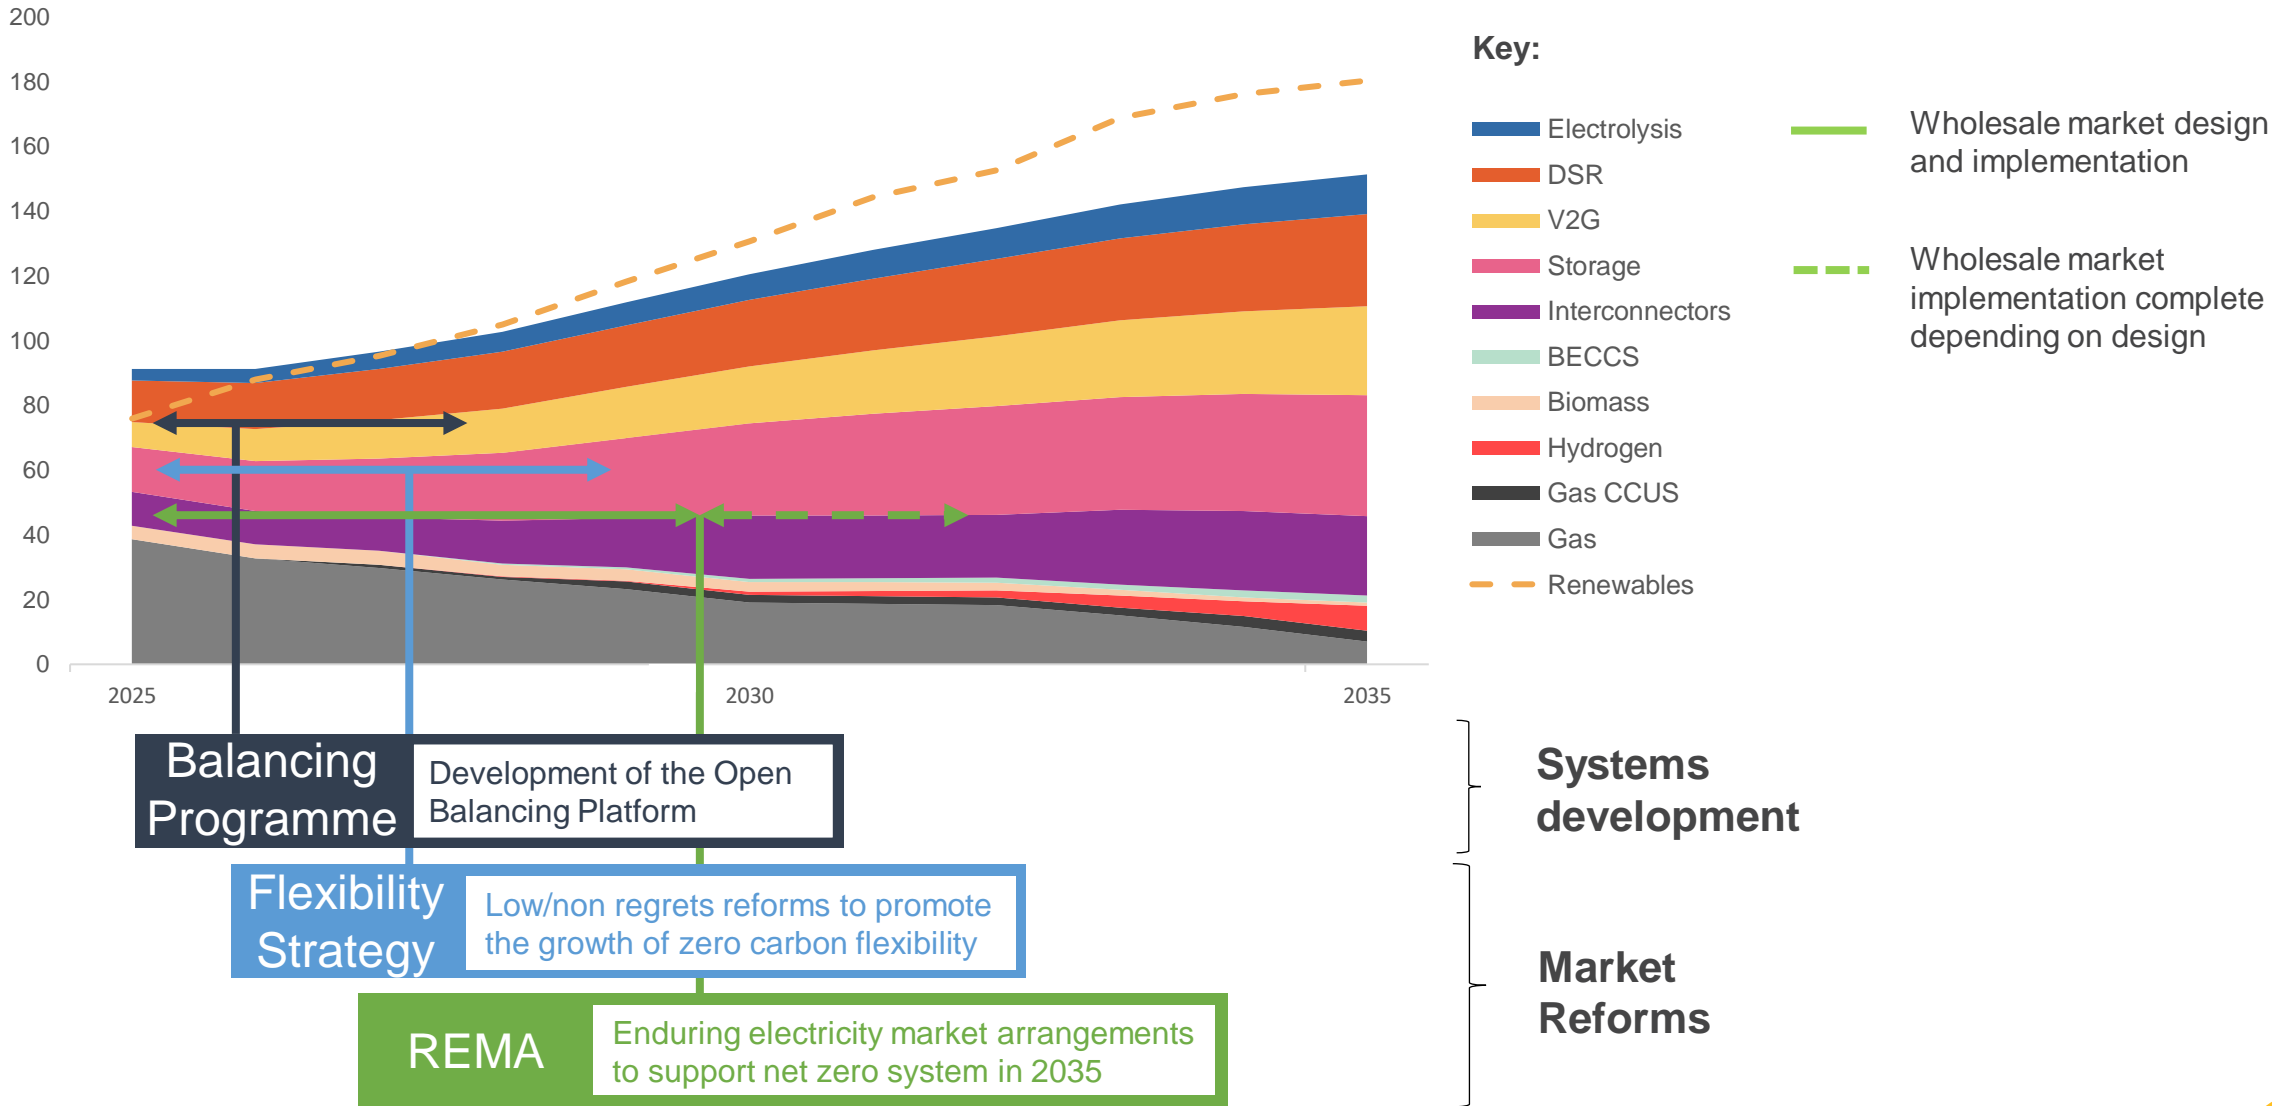

Note: Year ranges represent illustrative implementation dates

Breakout activities after each section will follow the same structure:

What have we missed?

What are the impacts of these issues on:

1. Balancing Mechanism Units
2. Wholesale Market Participants
3. Bill payers
4. Balancing Costs

A man with glasses and a beard is looking out a window at night. The scene is lit with vibrant neon colors, primarily purple and blue. The man is wearing a light-colored t-shirt with a small circular logo on the chest. The background shows a city street at night with blurred lights and buildings. A yellow line graphic runs across the image, starting from the top right and curving down to the bottom right.

DESNZ

Intro




ESO scheduling and dispatch

A case for change


AFRY MANAGEMENT CONSULTING

Content


1. Executive summary	12
2. Key limitations of the current scheduling and dispatch regime	19
2.1 Incentives	20
2.2 Visibility and access	33
2.3 Intertemporal issues	45
3. Conclusions	54

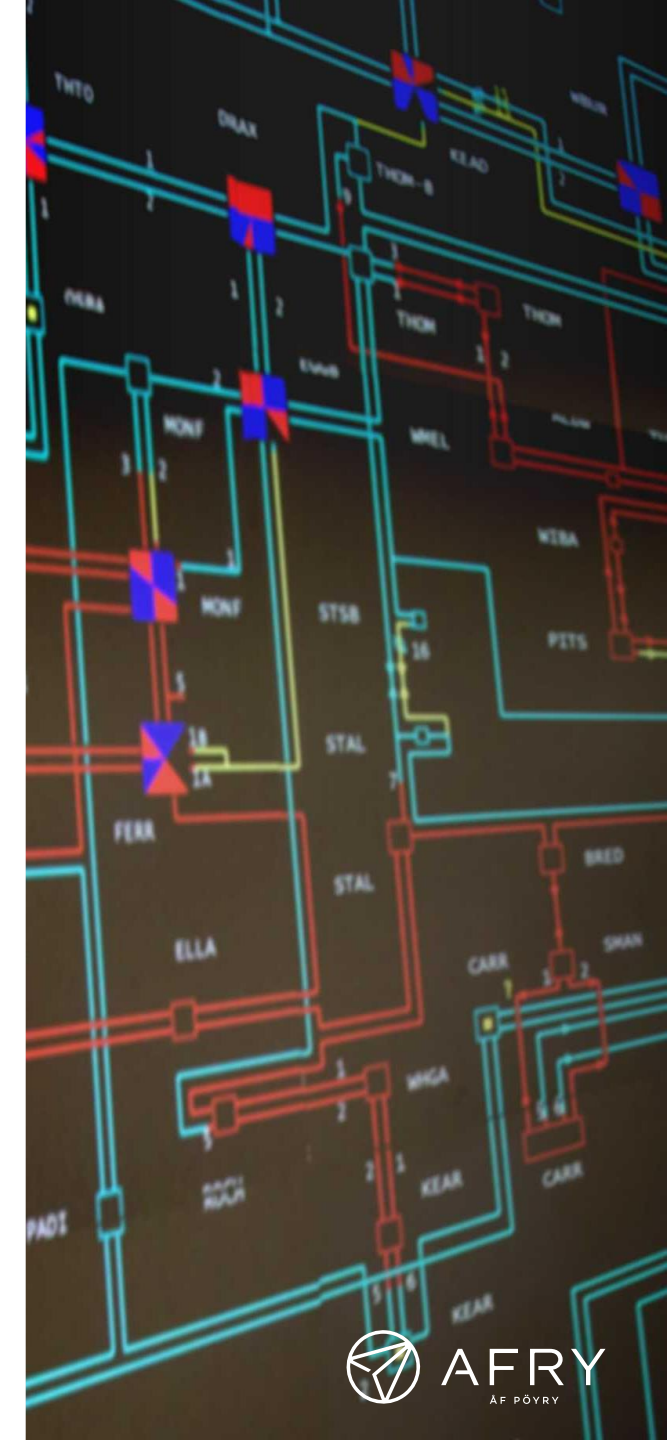


A lot has changed since the introduction of NETA

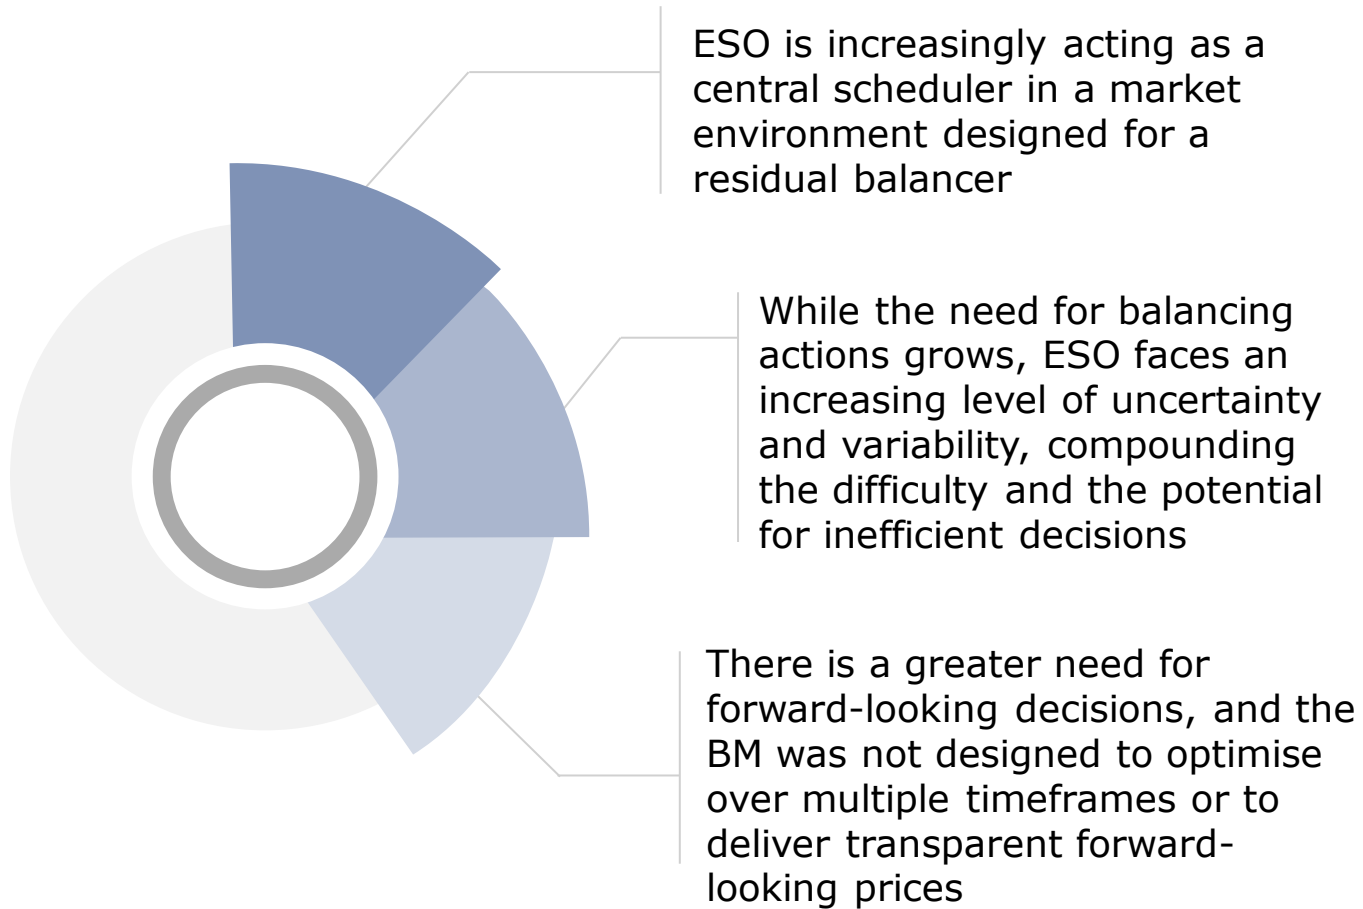

MONTHLY BALANCING VOLUMES (BOAS AND TRADES), 2006-2023

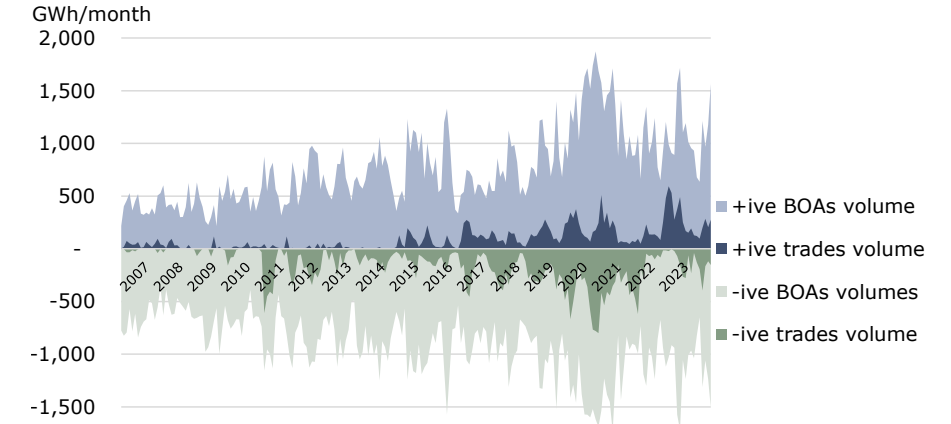


NUMBER OF UNIT COMMITMENT DECISIONS THROUGH THE BM, 2001-2022

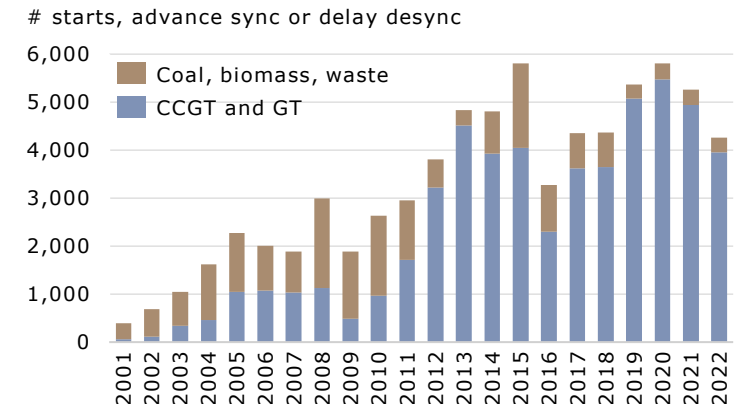

There is a clear case for change of the 'status quo' as the underlying conditions have changed since NETA was introduced

What are the key limitations of the 'status quo' scheduling and dispatch regime?

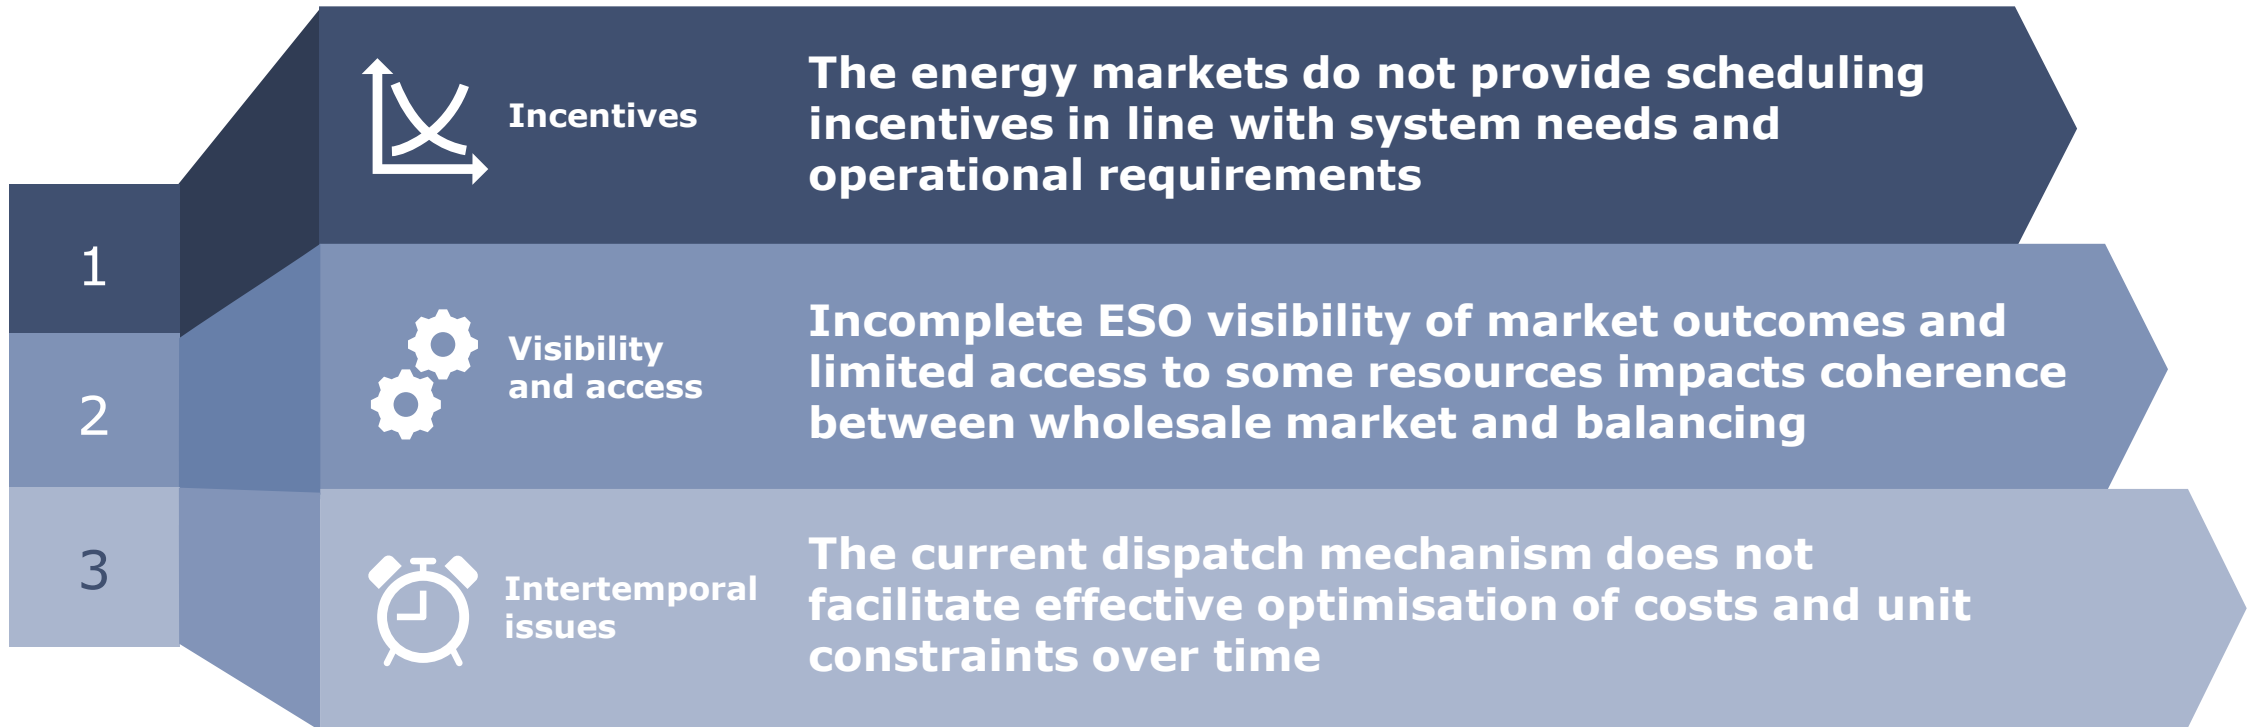

In addition to network capacity challenges, the limitations of the current market design challenge system operation and can result in inefficient dispatch

		Reason for ESO actions			
		Energy balance	Network congestion	Reserve	Other system needs
Limitations of the current market design and processes	Incentives: The energy markets do not provide scheduling incentives in line with system needs and operational requirements				
	Visibility and access: Incomplete ESO visibility of market outcomes and limited access to some resources impacts coherence between wholesale market and balancing				
	Intertemporal issues: The current dispatch mechanism does not facilitate effective optimisation of costs and unit constraints over time				

While each aspect is potentially manageable individually, the combination of the three creates the current limitations of the scheduling and dispatch processes

Solving the underlying reasons for ESO action is another way to limit potential difficulties

In addition to network capacity challenges, the limitations of the current market design challenge system operation and can result in inefficient dispatch


		Reason for ESO actions			
		Energy balance	Network congestion	Reserve	Other system needs
Limitations of the current market design and processes	Incentives: The energy markets do not provide scheduling incentives in line with system needs and operational requirements	Limited impact, although improvements are possible	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency
	Visibility and access: Incomplete ESO visibility of market outcomes and limited access to some resources impacts coherence between wholesale market and balancing	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency
	Intertemporal issues: The current dispatch mechanism does not facilitate effective optimisation of costs and unit constraints over time	Limited impact, although improvements are possible	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency

While each aspect is potentially manageable individually, the combination of the three creates the current limitations of the scheduling and dispatch processes

Solving the underlying reasons for ESO action is another way to limit potential difficulties

What is less clear is what to change to ...

There are two high-level approaches:

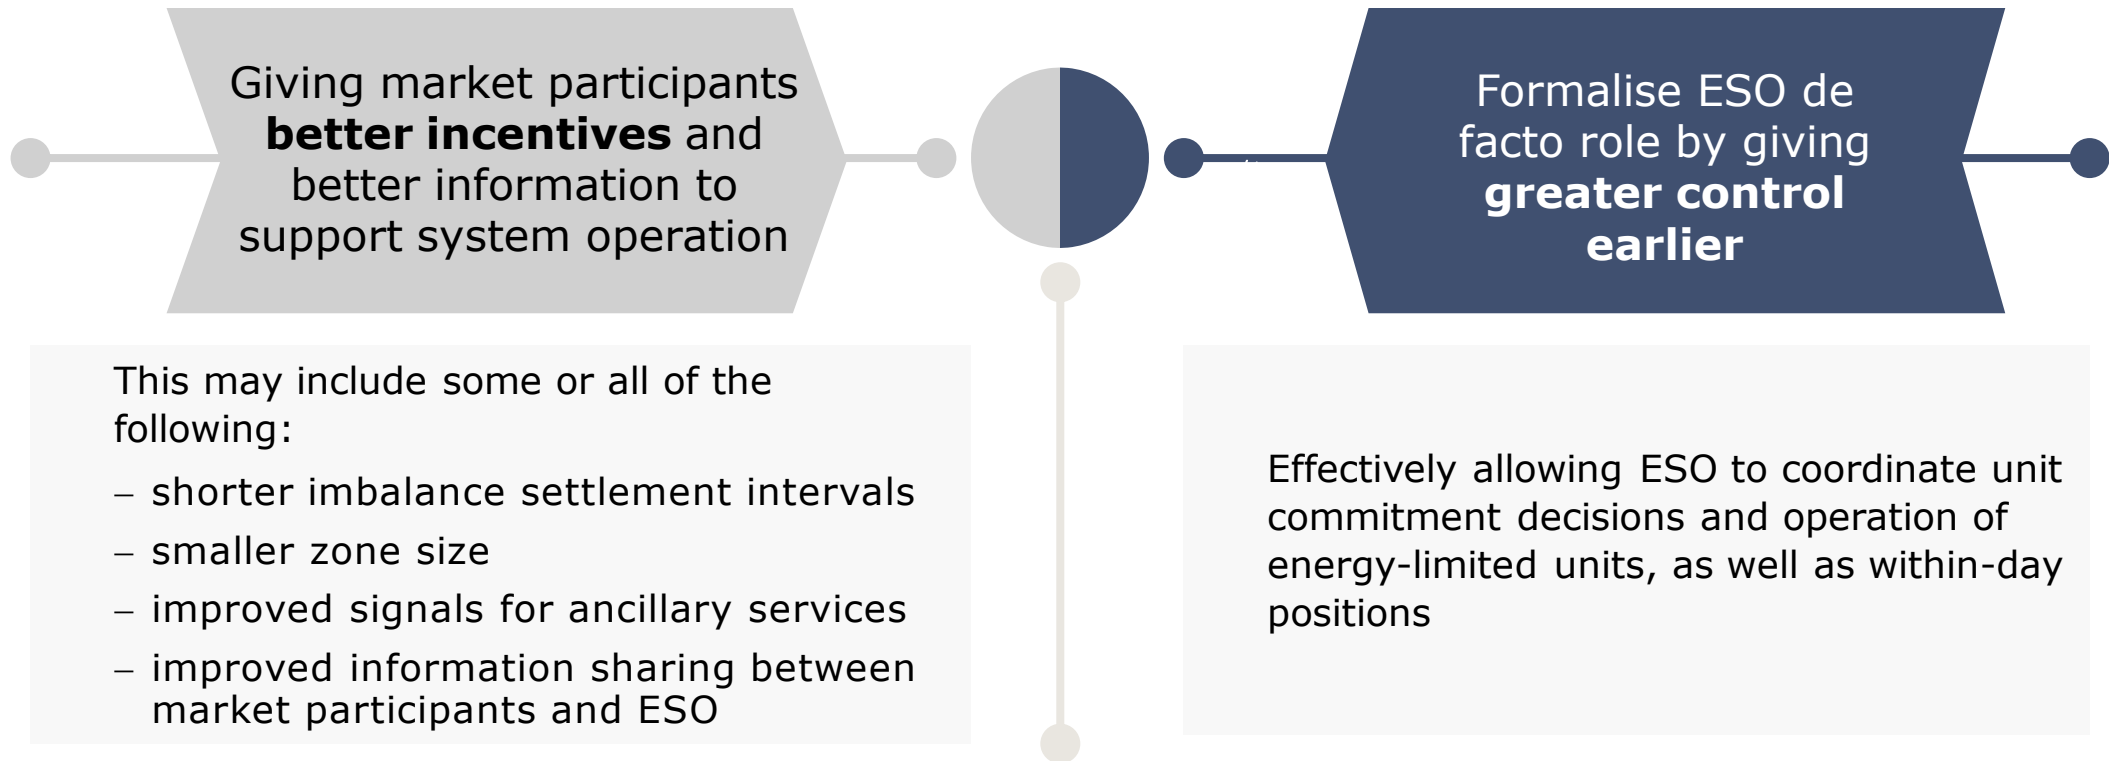

Ongoing changes are expected to mitigate some specific manifestations of the issues



Incentives



- Ongoing network capacity expansion
- Balancing Reserve will pre-contract some resources to provide reserve availability
- Half-hourly settlement
- Ofgem compliance engagement with storage regarding TCLC



Visibility and access



- GC117 proposal to reduce BMU threshold to 10MW
- Local constraint market (pilot for B6) will allow ESO access to more resources




Intertemporal issues




- Balancing reserve will reduce the need for pro-active scheduling actions in the BM
- Potential submission of data on energy limited units (within Gate Closure only)
- Ofgem inflexible offers licence condition

Content

1. Executive summary	12
2. Key limitations of the current scheduling and dispatch regime	19
2.1 Incentives	20
2.2 Visibility and access	33
2.3 Intertemporal issues	45
3. Conclusions	54

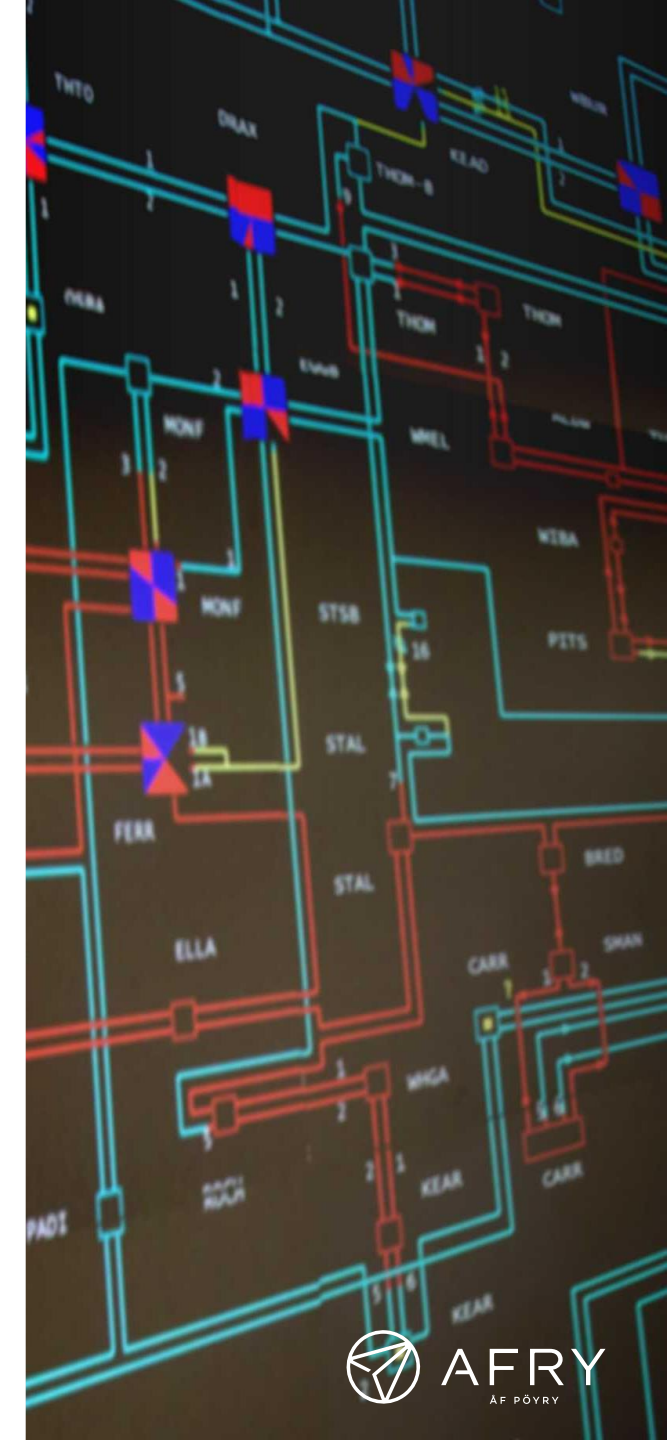

Through the Imbalance Price, market participants are incentivised to balance their portfolio against their traded positions

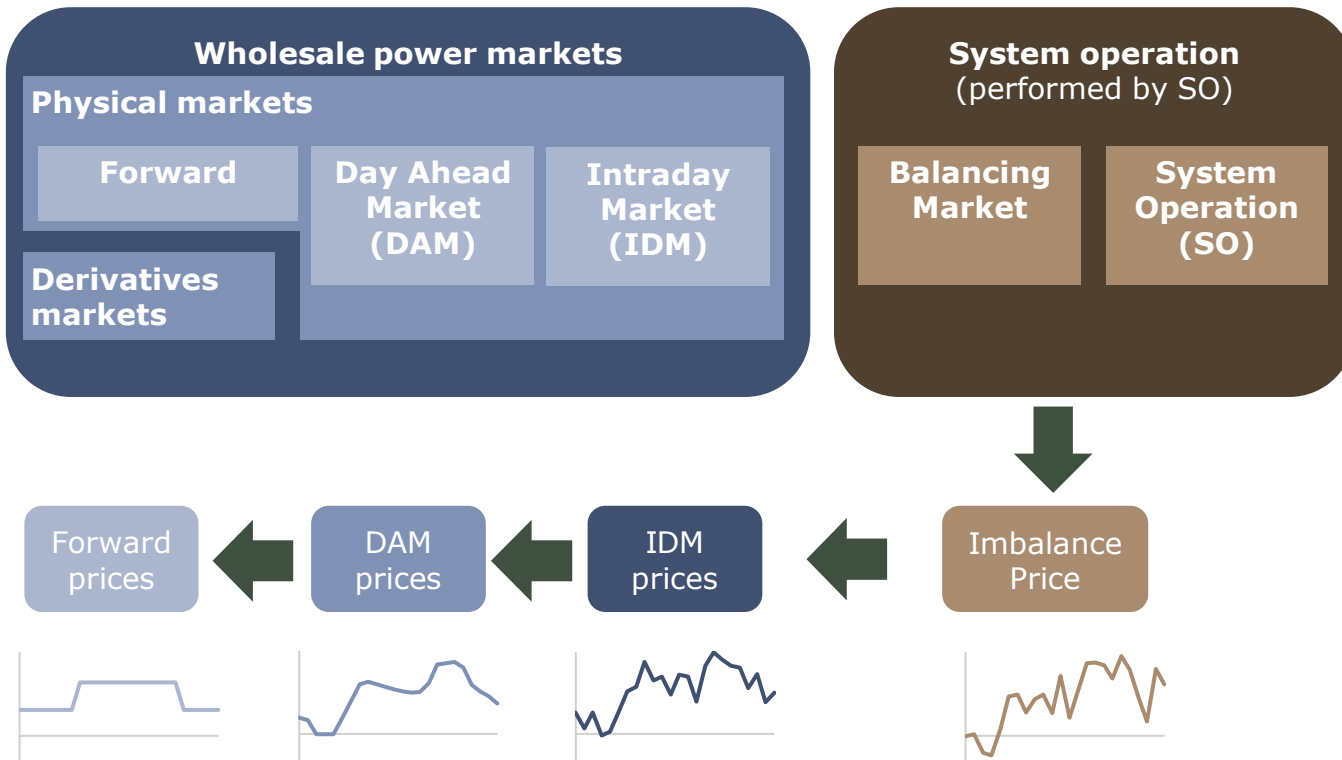


- **Market actors have balance responsibility** and manage this through market trading and portfolio balancing
- Collectively, the **market is incentivised** to support national supply and demand balance through **exposure to the Imbalance Price**
- There are no obligations for individual participants to balance their own positions
- Participants may continue to use non-BMU resources after GC for portfolio balancing or NIV chasing

INCENTIVES

Energy markets don't provide scheduling incentives in line with system needs and operational requirements


- 1** **'Unconstrained' market incentives:** Incentive provided by national Imbalance Price does not align with network constraints and other system needs
- 2** **'National' imbalance price:** Portfolio level balancing and national Imbalance Price lead to dispatch/NIV chasing in 'wrong' location
- 3** **Potential missing signals for real time reserve procurement:** Market is not incentivised to provide reserve capacity where and when needed

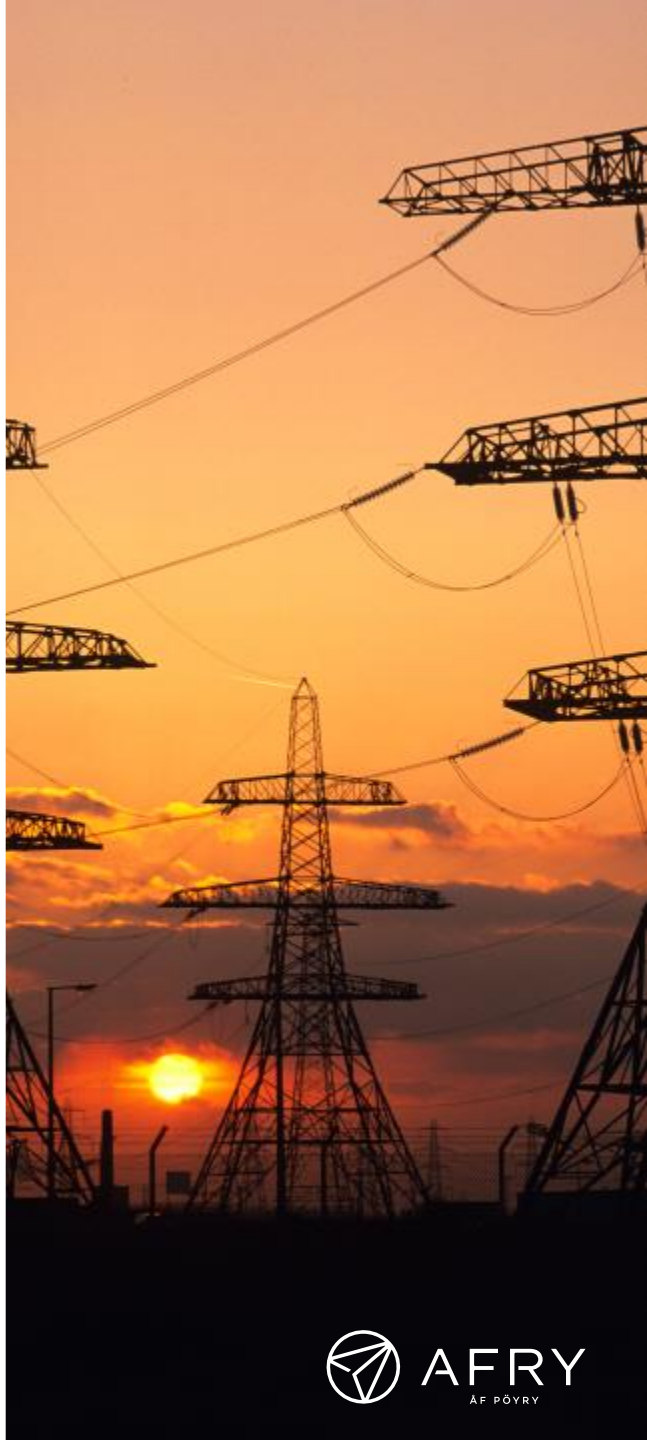

INCENTIVES

The volume of balancing actions for system constraints and reserve is now significantly greater than the volume of pure balancing energy actions

HISTORICAL MONTHLY BALANCING VOLUMES BY TYPE OF ACTION

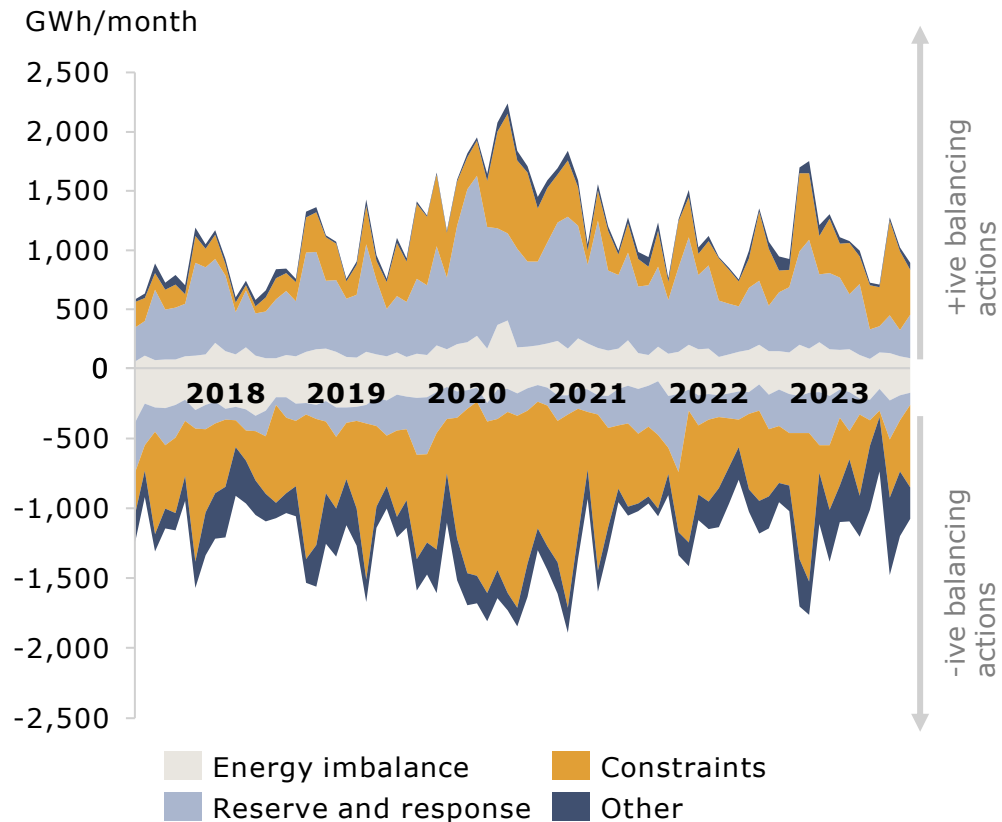

Note: 'Constraints' in this chart include transmission constraints and other system needs (e.g. inertia and voltage)


Source: Daily BSUoS volume Data, AFRY analysis

- Electricity is traded in the ex-ante markets assuming away network constraints and some other key system needs
- ESO starts from the 'unconstrained' PNs, and redispatches units to **manage system constraints and ensure sufficient operating reserves**
- There are now significantly greater volumes for managing system constraints and for reserve than for energy balancing

INCENTIVES

It is not only the volume of BM actions for reserve and constraints that is high, but also the associated costs

**TOTAL BALANCING AND ANCILLARY SERVICES COSTS
FY 2021/2022**

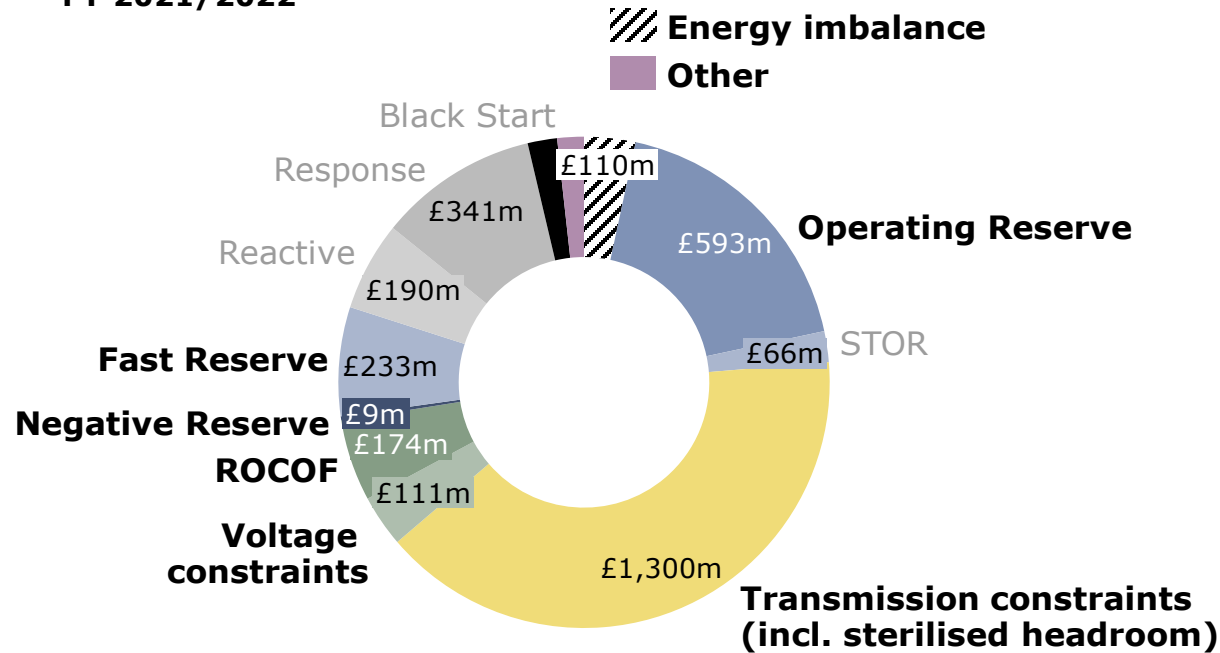

- Over time, the **procurement of system services has evolved** (Enduring Auction Capability platform, Pathfinders, Balancing Reserve...)
- However, the **Balancing Mechanism remains ESO's primary tool** to maintain energy balance, procure sufficient operating reserve, manage transmission constraints, and ensure system stability
- The costs associated with managing transmission constraints and procuring Regulating Reserve are high

Almost exclusively managed through the BM or trades

Managed/procured through separate arrangements (e.g. auctions, mandatory provision)

'UNCONSTRAINED' MARKET INCENTIVES

Incentive provided by national imbalance price does not align with network constraints and other system needs [1/2]

ILLUSTRATIVE FPN AND BOAS FOR THERMAL GENERATION LOCATED IN FRONT OF A CONSTRAINT




- A unit in an import-constrained location trades volumes in the ex-ante 'unconstrained' markets and submits a positive FPN over the evening peak periods
- Market prices are, however, below its short-run cost of operation in the morning and in the afternoon, and the unit is not scheduled to generate
- ESO issues BOAs to synchronise the unit earlier to relieve the import constraint
- The national System Imbalance Price does not provide a signal for the unit to synchronise in the morning

'UNCONSTRAINED' MARKET INCENTIVES

Incentive provided by national imbalance price does not align with network constraints and other system needs [2/2]

FPN AND BOAS FOR PUMPED STORAGE ON THE 12/04/2023

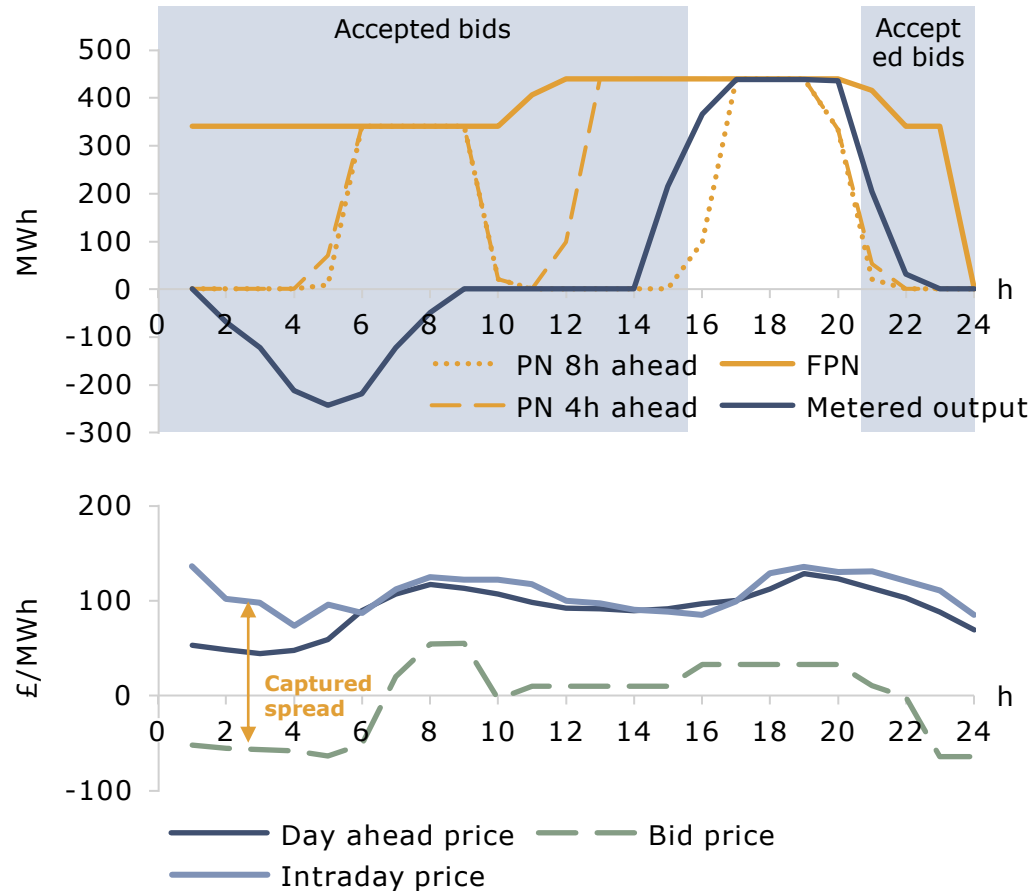

- A unit in an export constrained location trades volumes in the markets and submits a positive FPN
- ESO has to bid down this unit for most of the settlement periods to relieve the export constraint
- The resulting output broadly follows the underlying market fundamentals in this case. In other situations, even the resulting dispatch may be inefficient and flexible resources may be used in a suboptimal way

KEY IMPACT

- Greater volume of actions than could be necessary, increasing costs to consumers
- Misallocation of flexible resources

'NATIONAL' IMBALANCE PRICE


National System Imbalance Price can lead to NIV chasing in 'wrong' locations, exacerbating constraints instead of supporting system operation

A 'NIV chasing' unit's imbalance is opposite to the direction of the total system imbalance

In case of transmission constraints, ESO takes actions to both:

- resolve congestion; and
- ensure energy balance, effectively replacing the volumes from NIV chasing units located 'in front of' the constraint

- Market participants respond to a national System Imbalance Price ignoring locational factors
- NIV chasing can support total system balance
- However, in the presence of transmission constraints, NIV chasing can lead to an increase in balancing actions

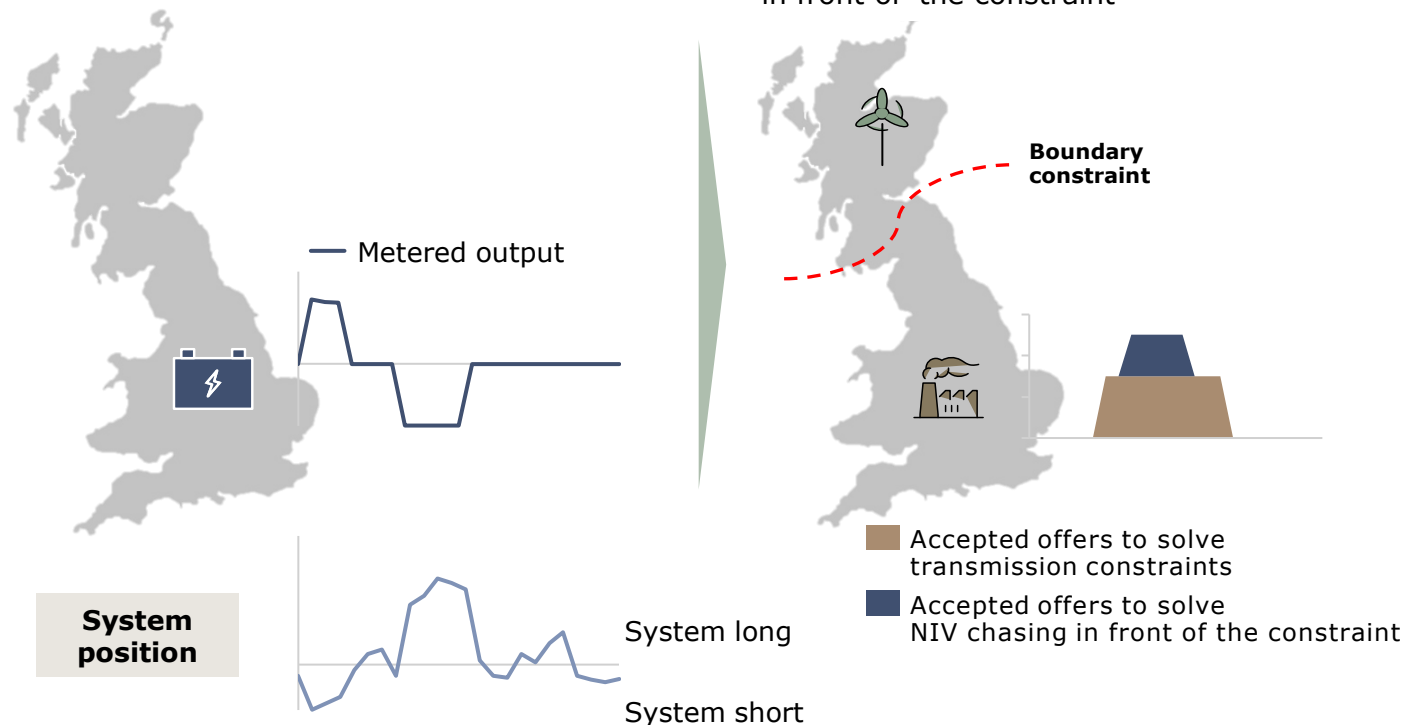

KEY IMPACT

- Greater volume of actions than could be necessary, increasing costs to consumers
- Misallocation of flexible resources



'NATIONAL' IMBALANCE PRICE

Portfolio level balancing can lead to dispatch decisions increasing network constraints instead of supporting system operation

A portfolio manager chooses to reduce output from a thermal unit as there is more potential from the wind asset

In case of network constraints, the lower FPN from the thermal unit increases the ESO balancing action needs

- There is no incentive to consider transmission constraints with portfolio level balancing in a single price zone
- The imbalance mechanism at portfolio level can lead to an increase in balancing actions in the presence of transmission constraints

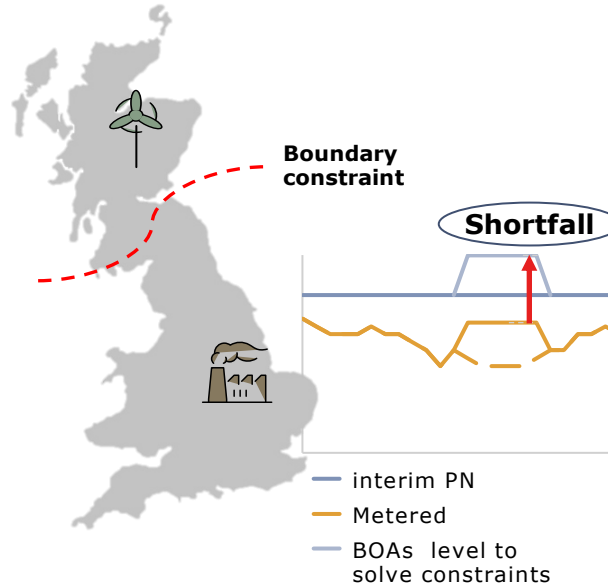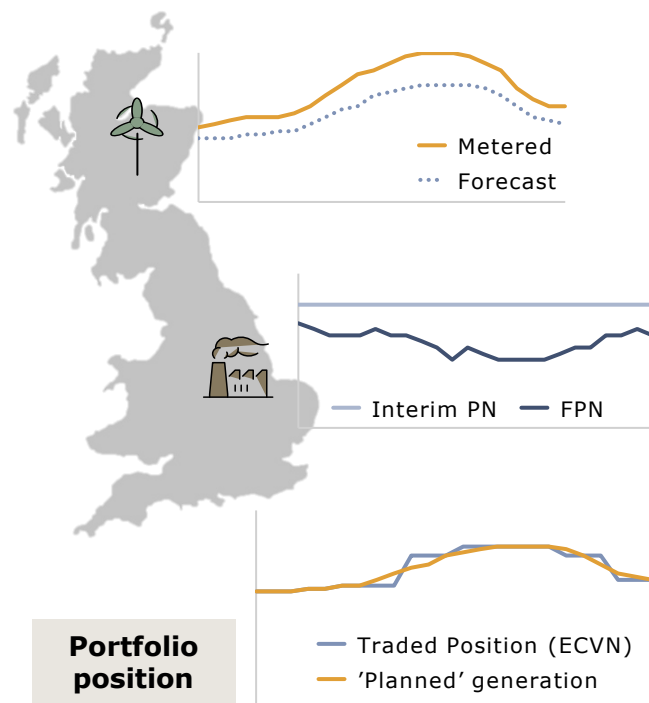

KEY IMPACT


- Greater volume of actions than could be necessary, increasing costs to consumers
- Misallocation of flexible resources

MISSING SIGNALS FOR REAL TIME RESERVE PROCUREMENT

Costs of procuring operating reserve have grown markedly in recent years – beyond the impact of the rise in commodity prices


MONTHLY OPERATING RESERVE COSTS - ABSOLUTE

m£/month

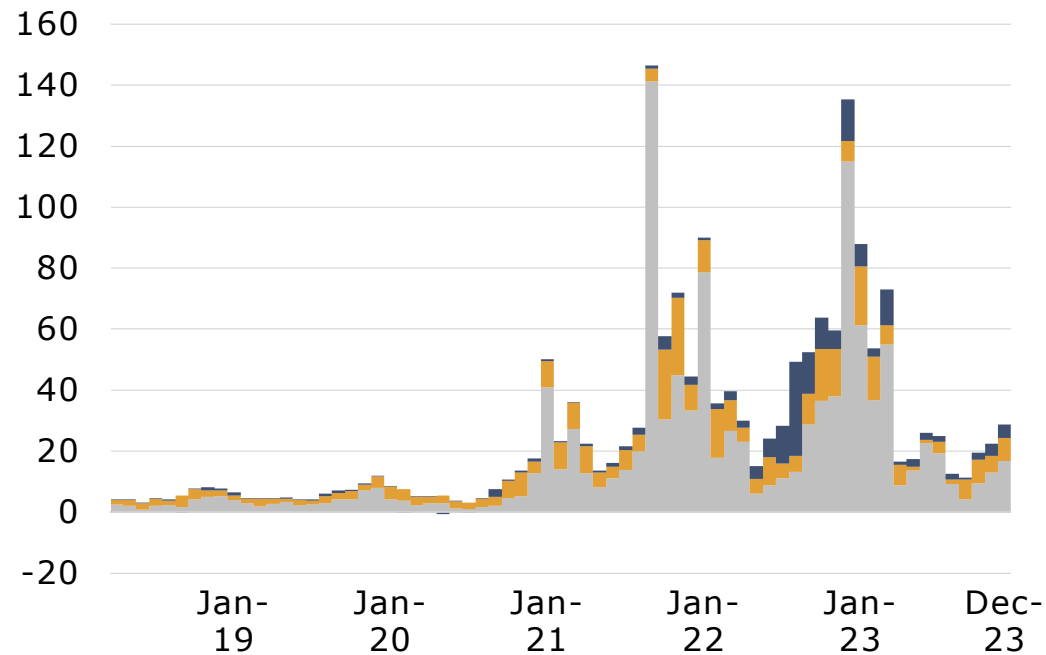

- Trade - Operating Reserve
- BM - Sterilised headroom for operating reserve
- BM - Operating Reserve

NORMALISED BY MONTHLY GAS PRICES

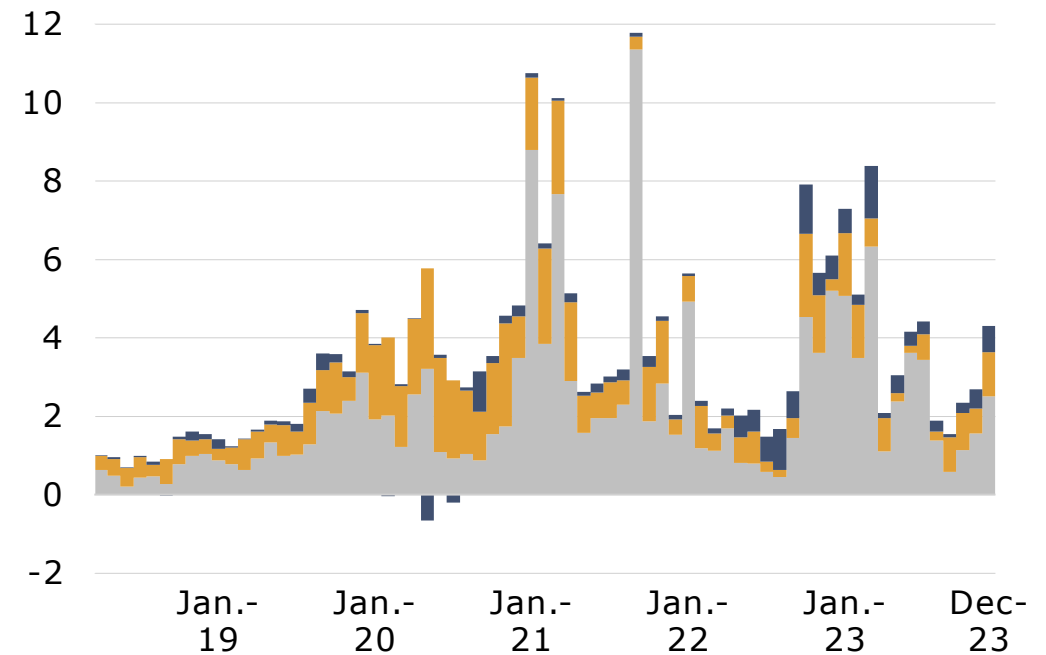

- Monthly costs for operating reserve procurement divided by monthly spot NBP gas prices
- Indexed to April 2018 = 1

Source: MBSS, AFRY analysis



NO EXPLICIT RESERVE MARKET

Potential missing signals for operating reserve in near real time

SITUATION

The BM secures reserve as well as energy

- The amount of headroom provided by the market is not always enough to meet ESO Regulating Reserve requirements

ESO is creating a new market for regulating reserve

- Regulating Reserve is currently procured predominantly via the BM
- ESO is introducing a new day-ahead auction for Regulating Reserve ('Balancing Reserve') which will allow it to compensate directly for the service

But procuring at day-ahead risks over/under procurement

- There will still be sterilised headroom, and it is likely that the BM will continue to be used to procure some of the reserve

KEY IMPACTS

ESO needs to synchronise units to ensure there is sufficient operating reserve continuously


The Balancing Reserve product is national, and there is potential for '**sterilised headroom**'

Transparency on what is an energy and what is a reserve action is limited

MISSING SIGNALS FOR REAL TIME RESERVE PROCUREMENT


Market is not incentivised to provide reserve capacity where and when needed

MODELLED RESULTS 12/04/2023
WHOLESALE ELECTRICITY PRICE

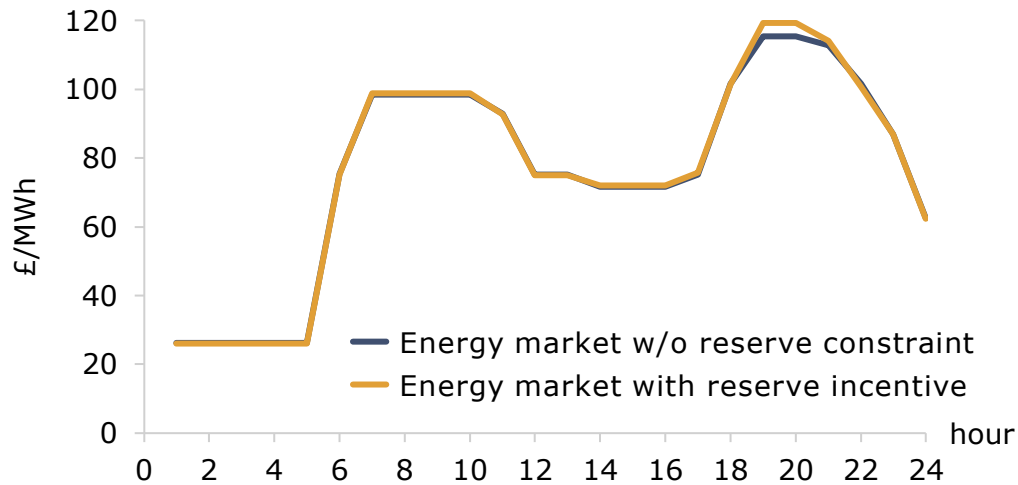

- As part of the analysis, AFRY has modelled :
 - a) an ex-ante market assuming no reserve requirement
 - b) an ex-ante market assuming a signal for real-time operating reserve provision
- On one of the modelled days, we see the following:
 - Ex-ante wholesale prices would have been higher in some periods if the market was incentivised to deliver the required reserve
 - There is a value in 'reserving' capacity during the morning ramp and the 'peak' - in all other periods reserve is practically 'free'

OPERATING RESERVE PRICE

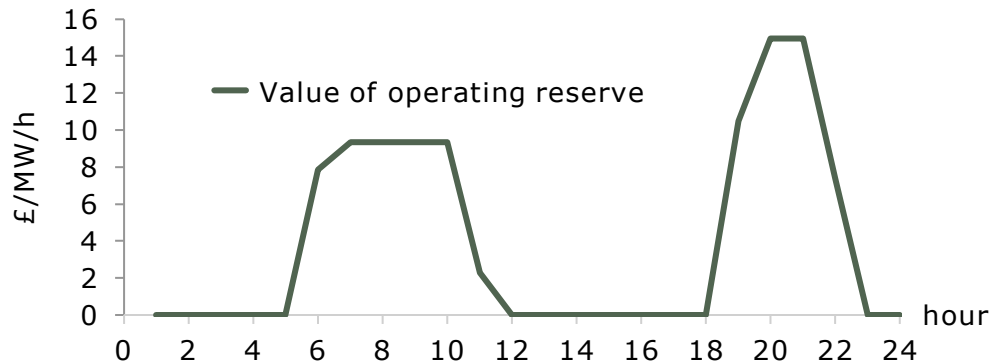

KEY IMPACT

- Transparency on what is an energy and what is a reserve action is reduced, limiting understanding of underlying value by market participants

Discussion


Instructions for breakouts

- Each table will have:
 - 2 sheets of paper
 - ‘What have we missed?’
 - ‘What are the impacts of these issues?’
 - 3 colours of post it notes (one for each issue).
- First 5 minutes, people will write into post it notes in one of the colours for anything we’ve missed.
- Next 5 minutes, people write into post it notes (same colour) impacts on each group.
- Final 10 minutes, people will take turns to explain their ideas and discuss.
- After each issue, use a different colour of post-it

This sheet will be split in 4 areas: BMUs, Wholesale market participants, Bill payers, Balancing costs.

Content

1. Executive summary	12
2. Key limitations of the current scheduling and dispatch regime	19
2.1 Incentives	20
2.2 Visibility and access	33
2.3 Intertemporal issues	45
3. Conclusions	54

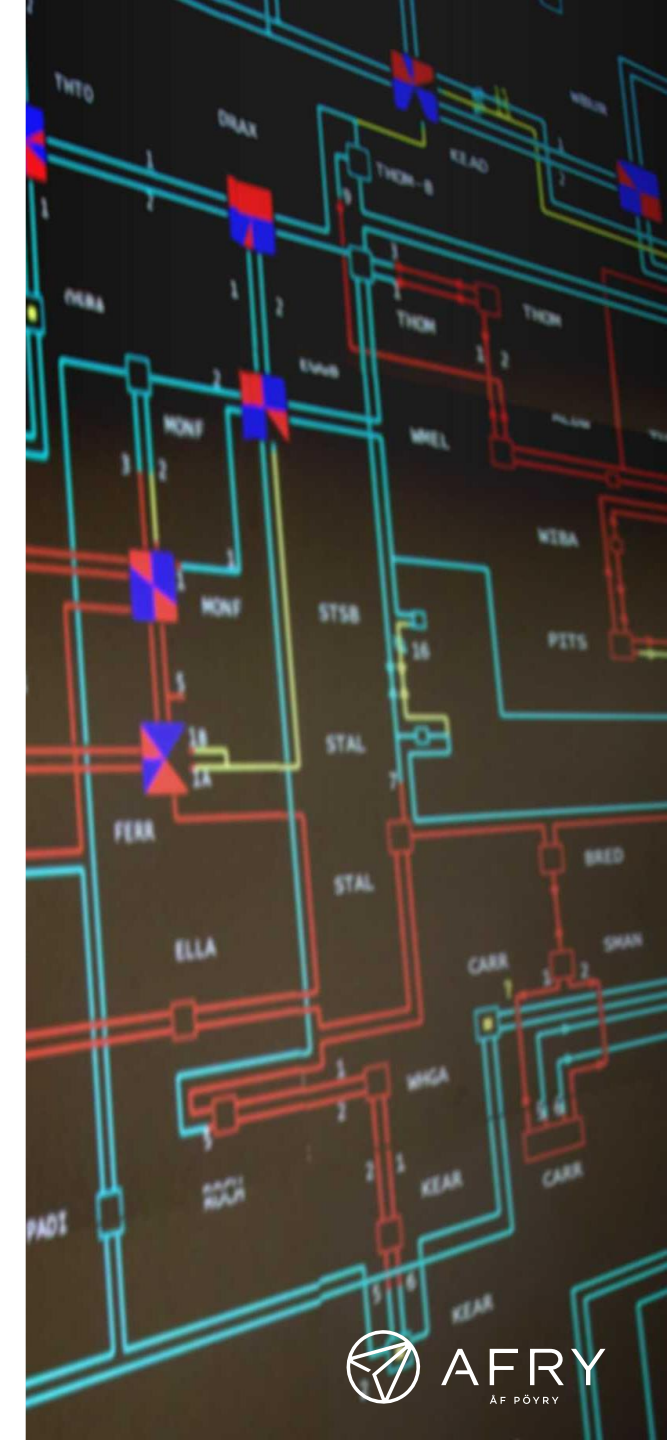

Embedded generation and flexible capacity is on the rise



INCREASE IN EMBEDDED GENERATION

- In the early 2000s, the electricity generation fleet in Great Britain consisted primarily of controllable thermal plants connected at the transmission level
- Since then, embedded generation has been steadily increasing

INCREASE IN FLEXIBLE RESOURCES, BUT NOT ALWAYS SUPPORTING SYSTEM BALANCE

- Flexible resource capacity is also on the rise. However, this resource is not all visible to or accessible by ESO
- The introduction of the single Imbalance Price gives incentives to the market to manage system imbalance, but from an ESO perspective this adds an additional layer of uncertainty as non-BMU resources are acting in ways which ESO finds hard to predict

HISTORICAL INSTALLED CAPACITY IN GB, BY CONNECTION LEVEL

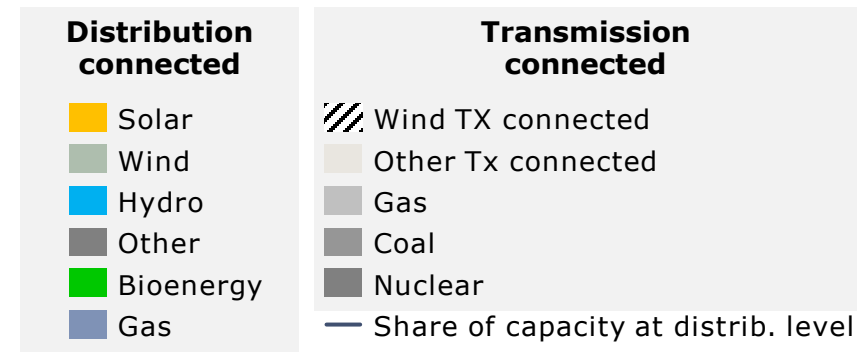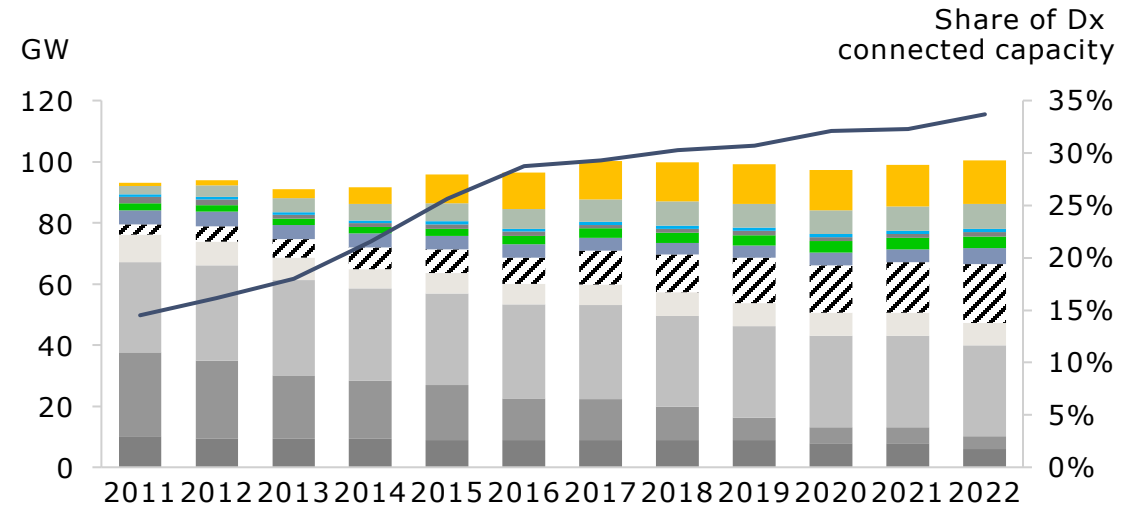

Incomplete ESO visibility of market outcomes and limited access to some resources impacts coherence between wholesale market and balancing


- 1 Incomplete coverage:** Coverage of FPNs is incomplete, particularly for the growing share of flexible non-BM resources, meaning ESO has limited visibility of full market schedules when doing contingency planning
- 2 Inaccurate information:** Schedules change significantly before gate closure meaning ESO decisions are taken with inaccurate information
- 3 Behaviour:** Uncertainty on the expected level of system support for balancing by flexible non-BM resources (e.g. NIV chasing or response to retail tariffs)
- 4 ESO access to resources:** Key resources respond to wholesale market signals but are not dispatchable by ESO in balancing timeframes
- 5 Coordination:** Sequential procurement of balancing services adds uncertainty to decision making for both ESO and market participants



INCOMPLETE COVERAGE

Coverage of FPNs is incomplete meaning both ESO and the market are dealing with poor information

NATIONAL DEMAND FORECAST 19/03/2022, MW

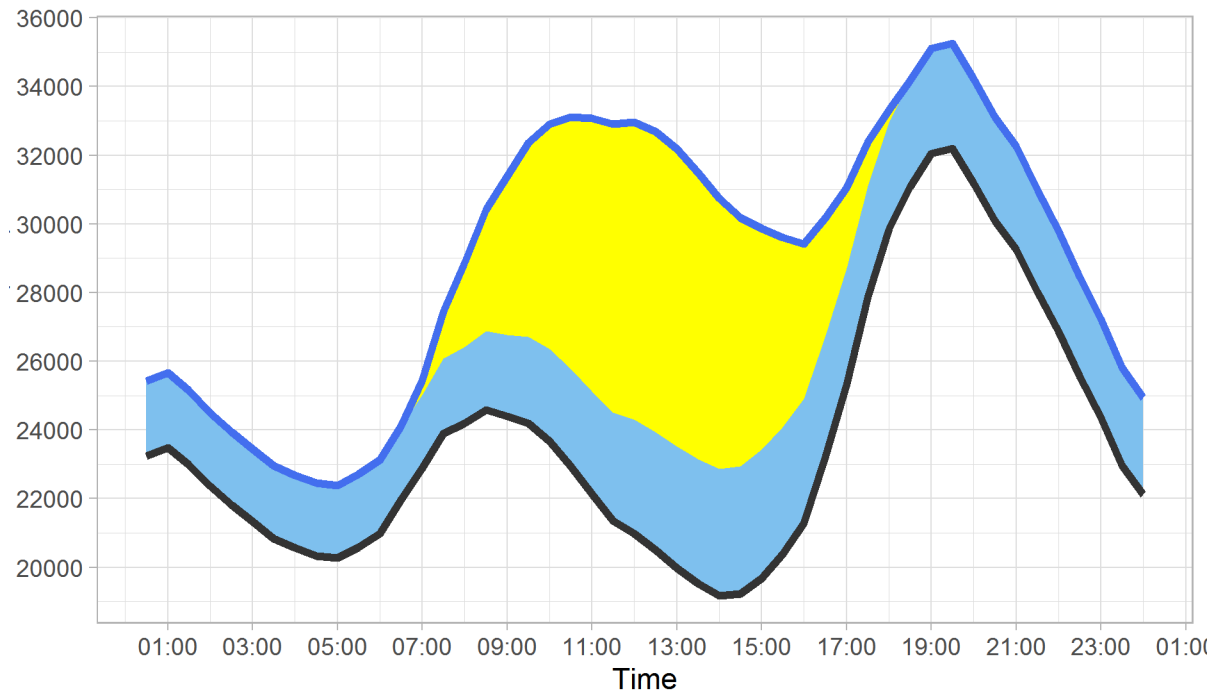


- ESO forecasts total 'gross' demand, and subtracts embedded RES generation forecasts to obtain national demand
- Reaction to market prices by controllable embedded generation and demand response cannot be considered in the published national demand forecast according to the Grid Code
- This can have an impact on the market expectations and price formation

INCOMPLETE COVERAGE

Coverage of FPNs is incomplete, meaning ESO has limited visibility of full market schedules when doing contingency planning

NATIONAL DEMAND FORECAST AND OUTTURN ON 09/07/2023

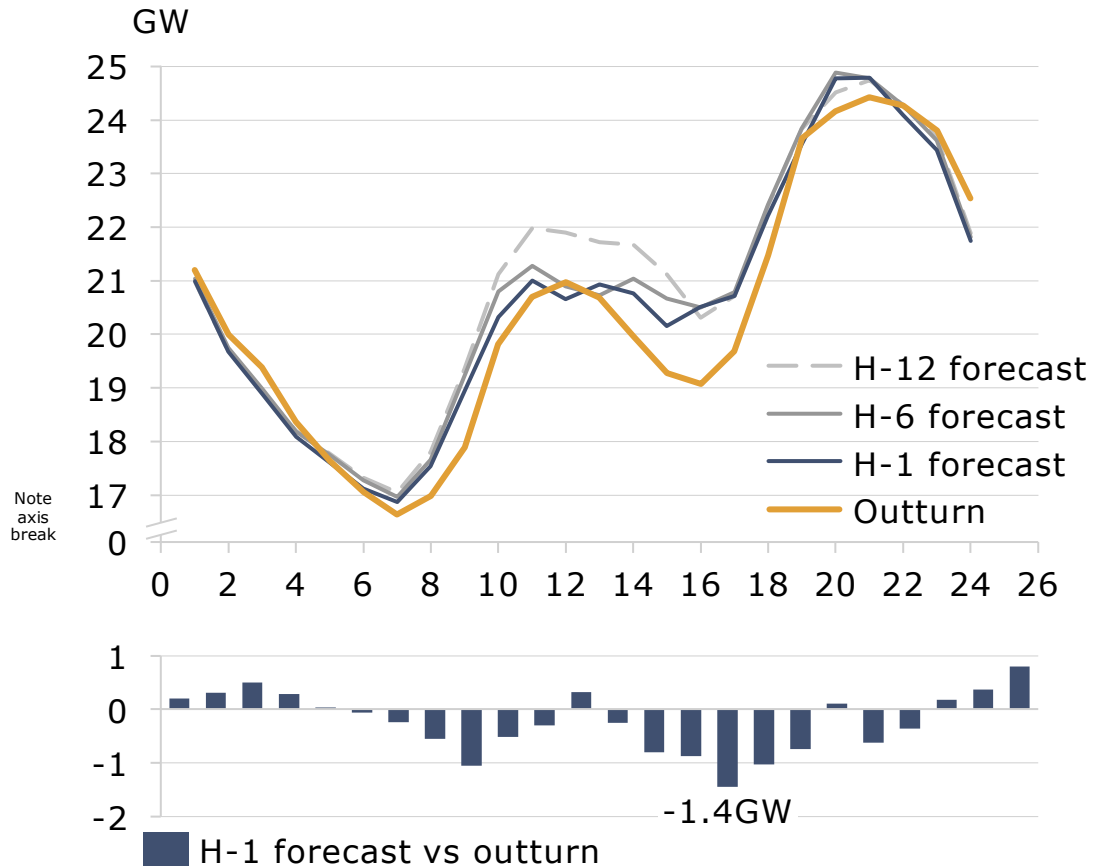

- When the market was set up, aggregate FPNs were a good indication of the overall market position
- **Aggregate PNs are no longer a meaningful indication of the system position** with more than 30% of overall installed capacity now being embedded
- Price responsive embedded generation makes national demand forecasting even more complex


KEY IMPACT

- Over- and under-procurement of energy and reserve
- Potential for inefficient dispatch decisions

BEHAVIOUR

Uncertainty on the expected level of system support for balancing by flexible non-BM resources (e.g. NIV chasing or response to retail tariffs)

BSC PARTY IMBALANCE VS. SYSTEM POSITION, MWH

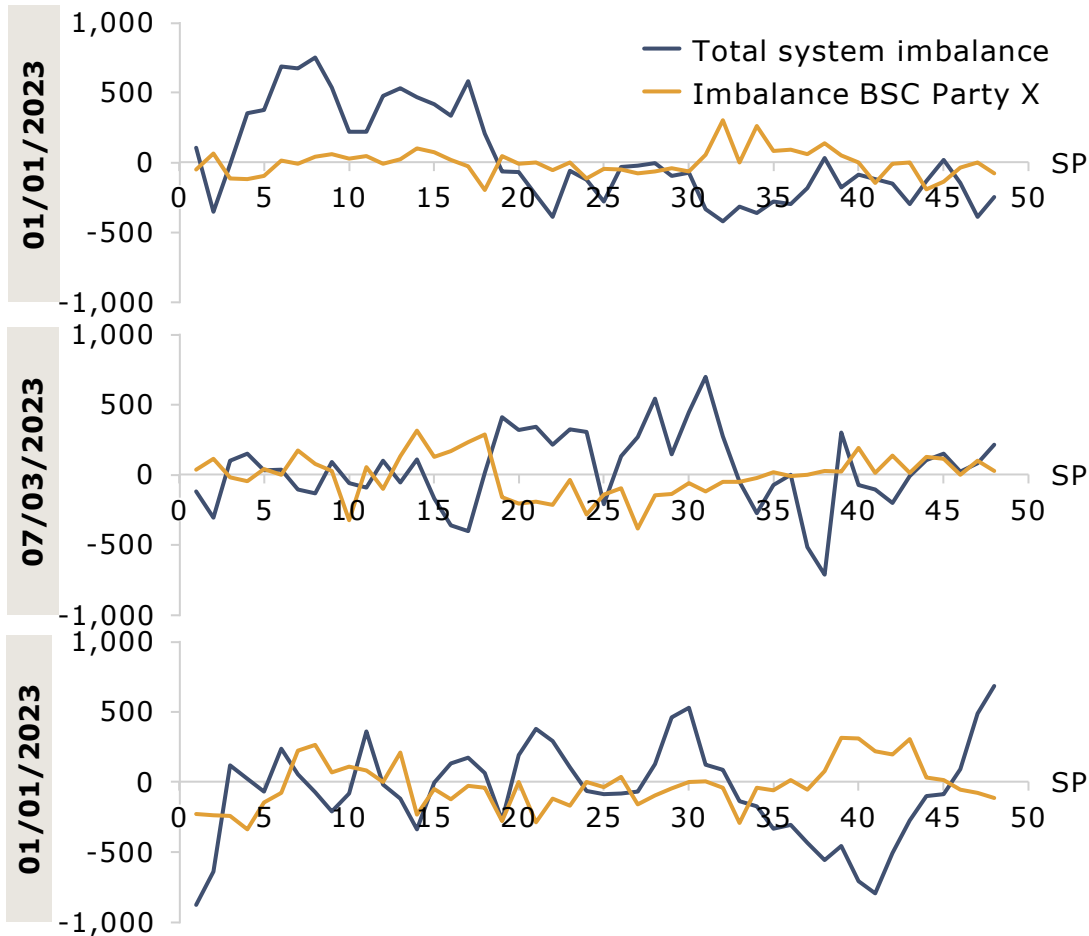

- NIV chasing can support total system balance
- However, ESO has no visibility on the potential level of NIV chasing and cannot formally rely on it when making balancing decisions


KEY IMPACTS

- Over- and under-procurement of energy and reserve
- Potential for unnecessary actions

INACCURATE INFORMATION

Schedules change significantly before gate closure

MONTHLY VOLUME DIFFERENCE BETWEEN PNs 4H AHEAD AND FPNS, %

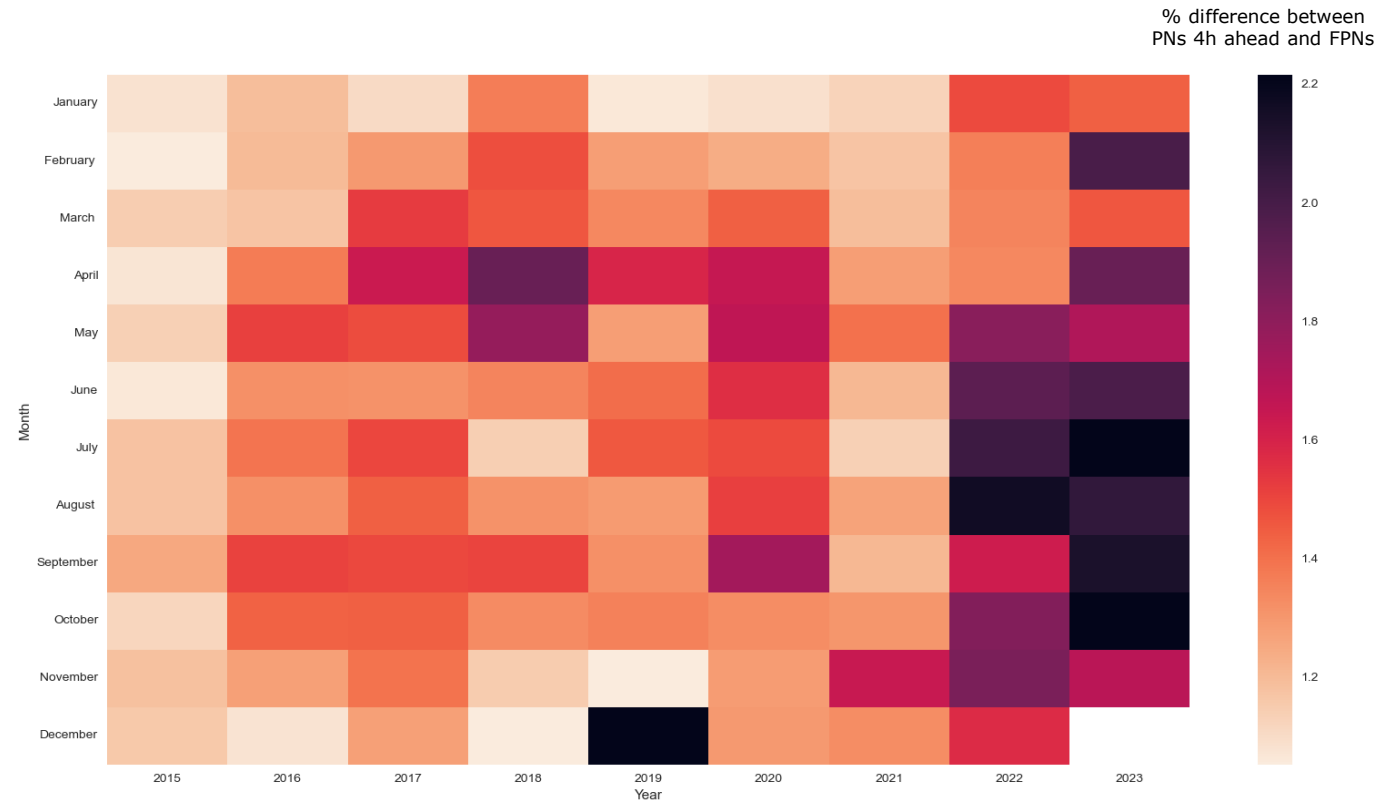

- Changes in PNs as we approach real-time are increasing
- ESO needs to take decisions with increasingly inaccurate information

KEY IMPACT


- Unnecessary risk mitigation
- Potential for inefficient dispatch decisions

Source: ESO analysis, monthly average of % difference between PNs 4h hours ahead and FPNS for each settlement period

INACCURATE INFORMATION

ESO takes scheduling decision based on inaccurate information [2/2]

OVERVIEW OF THE MARGIN FOR DARKNESS PEAK AT 5:40 PM (01/01/2023)

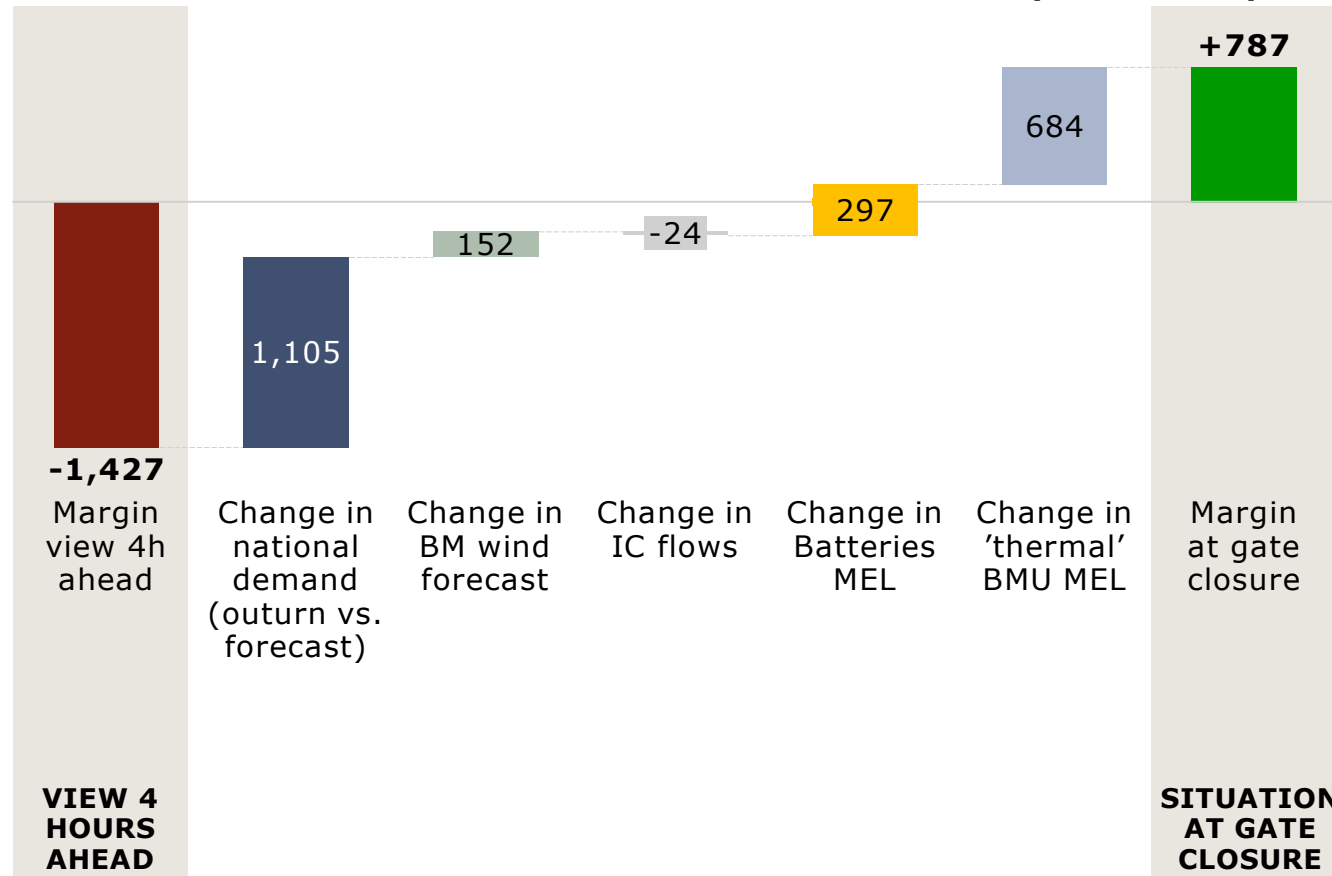

- On 01/01/2023, ESO was expecting a margin shortfall for the evening peak based on information 4h hours ahead
- This led to the synchronisation of several units during the afternoon to ensure sufficient margin
- Compared to the view 4 hours ahead, at GC:
 - National demand didn't reach the forecast level
 - Several BMUs with an interim PN=0 at the peak self-scheduled in the afternoon, resulting in an increase in the overall headroom
 - Outturn battery contribution at the peak was higher than the operating plan estimate
 - Wind generation slightly higher than forecast


MEL= Maximum Export Limit, SOP=System Operating Plans

INACCURATE INFORMATION

Large changes in interconnector schedules before gate closure are becoming increasingly frequent

DISTRIBUTION OF DIFFERENCE IN PNS 4H AHEAD AND FPNS FOR INTERCONNECTOR SCHEDULES

Difference in sum of I/C schedules, MW

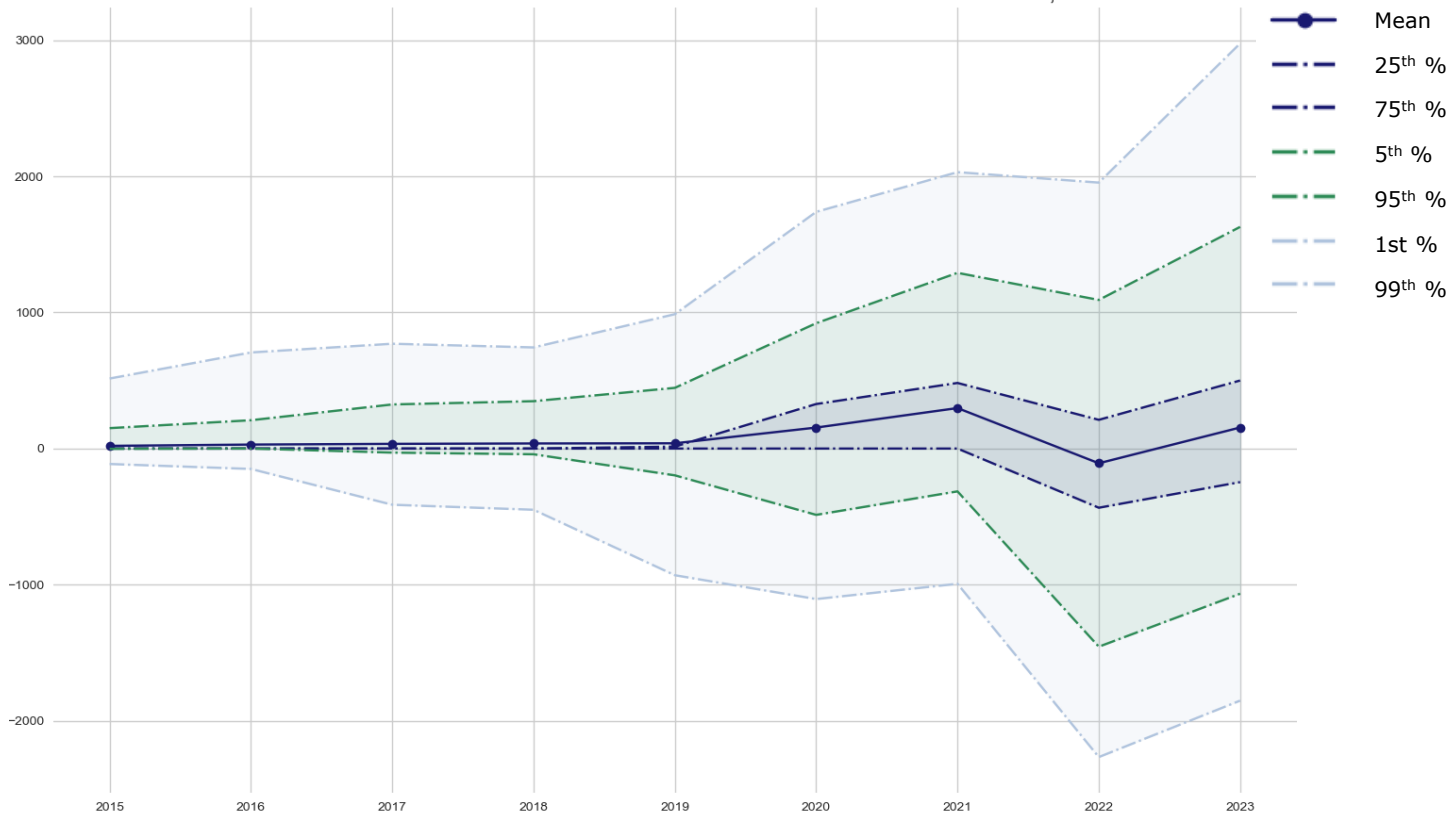

- Interconnector capacity between GB and other European countries has increased over the last few years
- They have now become the single largest source of change in schedules close to real-time
- Predicting changes in interconnector schedules is challenging, as it typically reflects the relative price evolution in two markets


Source: ESO analysis

INACCURATE INFORMATION

Changes in interconnector schedules close to delivery are particularly significant


EVIDENCE FROM 09/07/2023

TOTAL INTERCONNECTOR PHYSICAL NOTIFICATION (NET IMPORTS TO GB)

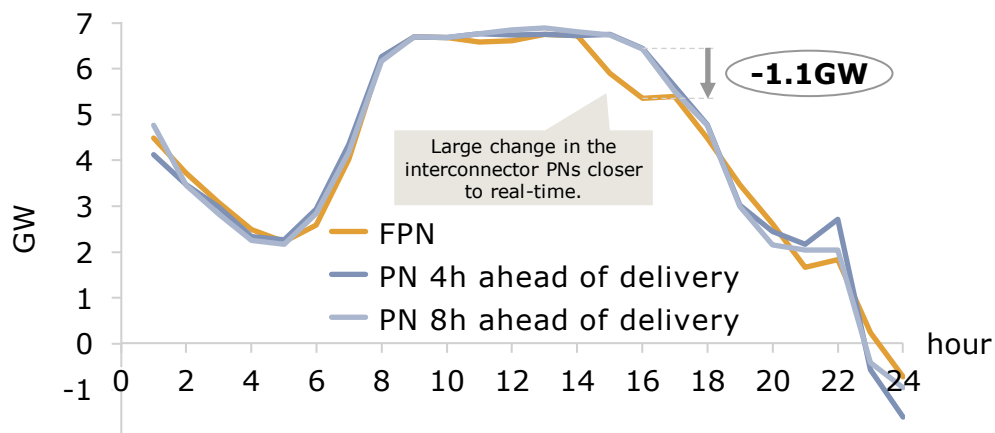

- Interconnector schedule swings typically come alongside a corresponding change in generation (embedded or otherwise), and should therefore not lead to a large energy imbalance. However:
 - changes in interconnectors flows can have an impact on the level of available reserve and on transmission constraints; and
 - such large, sudden changes can still be a risk for system operation from an ESO perspective

NATIONAL DEMAND FORECAST AND OUTTURN

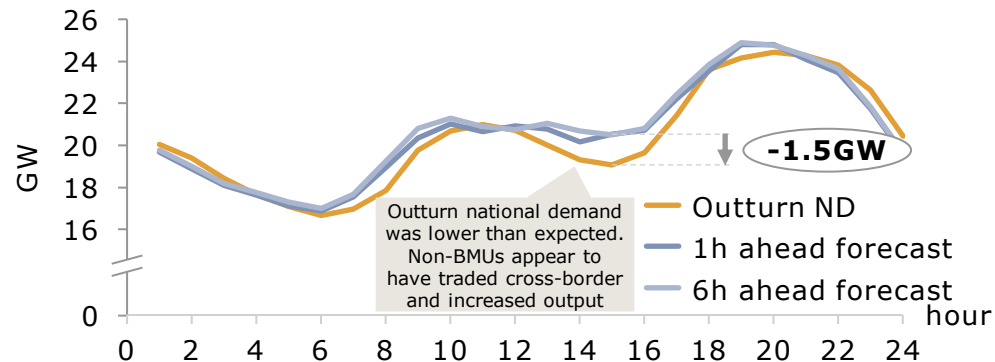


KEY IMPACT

- Need to react fast to large changes, leading to operational difficulties and expensive actions

COORDINATION

Sequential procurement of balancing services adds uncertainty to decision making for both ESO and market participants

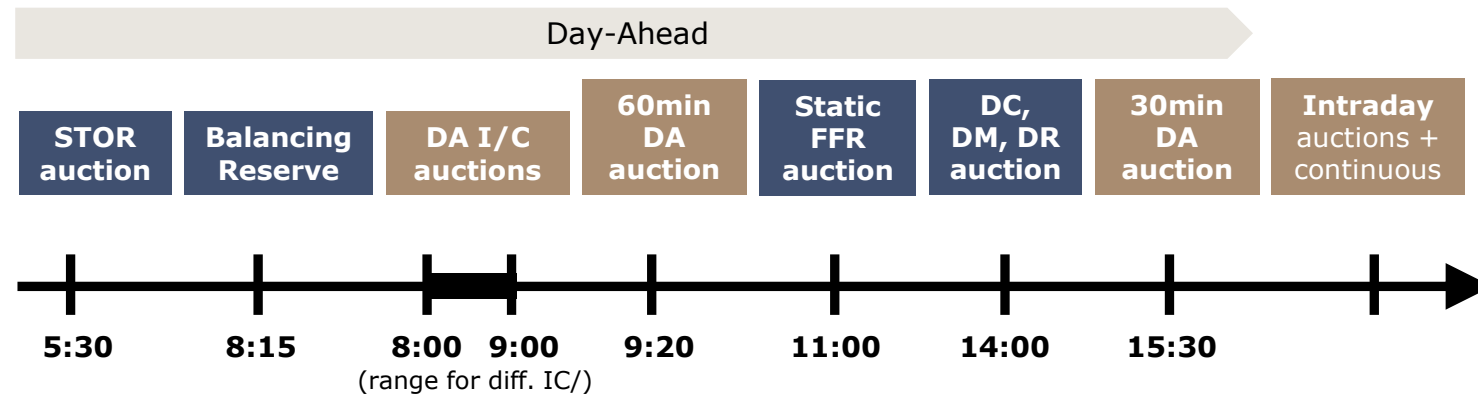

- Balancing services are procured at different times
- Market players need to take decisions in different timeframes against a moving intraday target
- For some services, ESO does not procure the entire volume (e.g. headroom for reserve) in advance

Pro/cons of procuring Balancing reserve before the DA auction

- + Allows market to trade out its position for scheduling units
- Difficulty for market participants if their estimate of the DA price is wrong

Pro/cons of response products after the DA auction

- + Allows ESO to determine response requir. based on largest loss (I/C)
- Less opportunity for market participants to trade out their position

Reserve and AS procurement

Energy markets

KEY IMPACT


- Market players face conflicting incentives and risk forecast errors when bidding
- Potential for inefficient dispatch
- Reduced competition

Discussion

BREAK

Content


1. Executive summary	12
2. Key limitations of the current scheduling and dispatch regime	19
2.1 Incentives	20
2.2 Visibility and access	33
2.3 Intertemporal issues	45
3. Conclusions	54

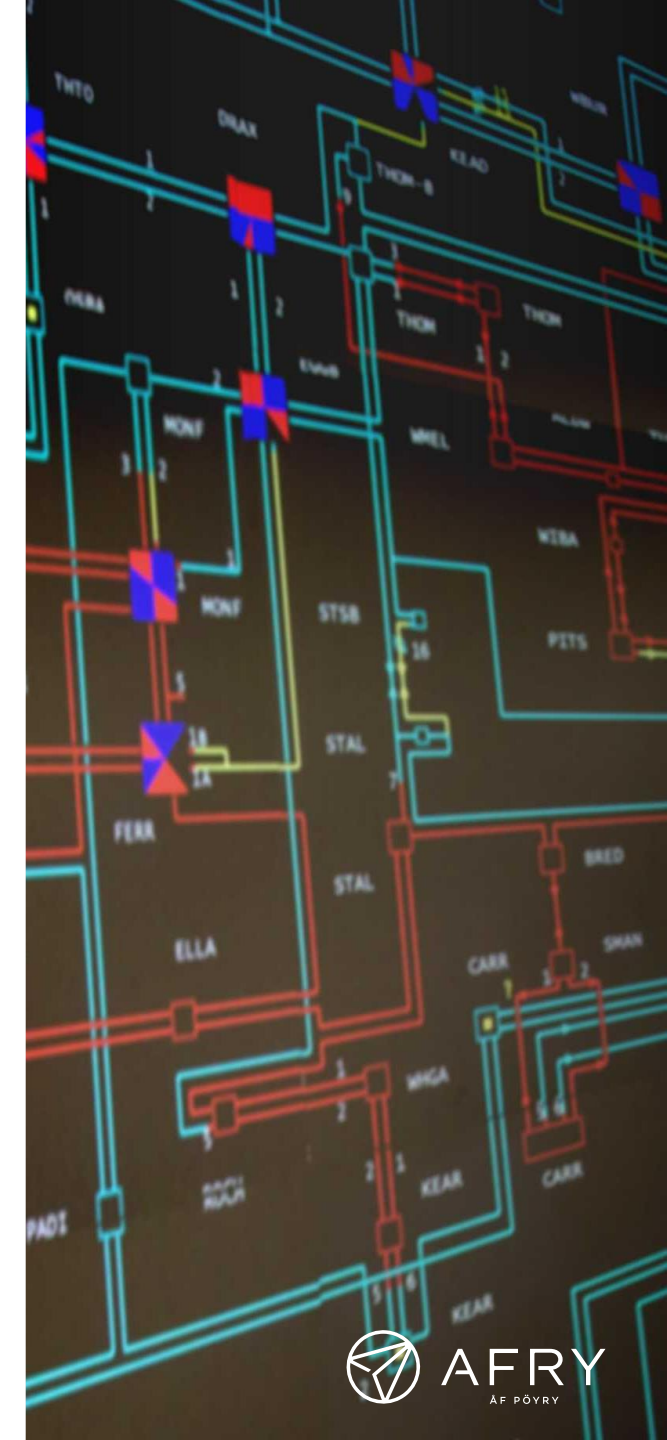


INTERTEMPORAL ISSUES

The market is intended to make unit commitment decisions with ESO dealing only with residual balancing – however, this is not what happens in practice



In theory ...

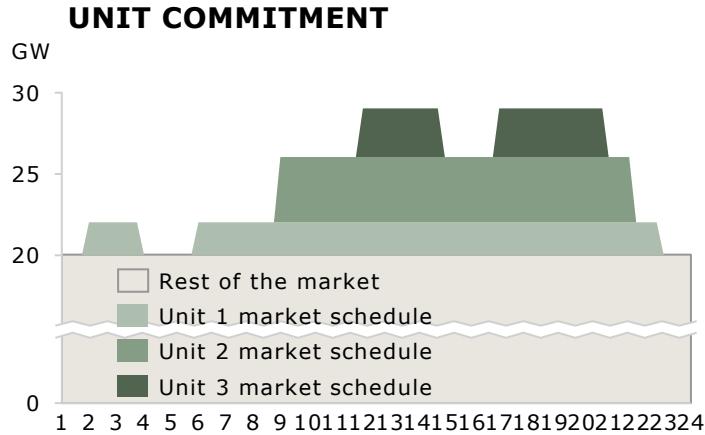

In practice ...

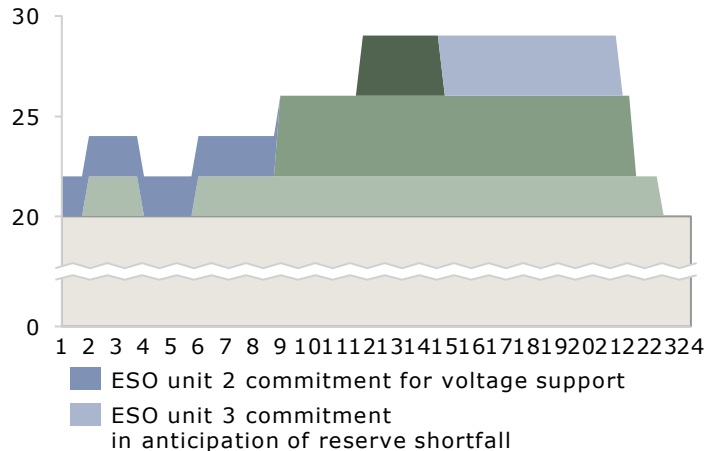

ILLUSTRATIVE BALANCING ACTIONS

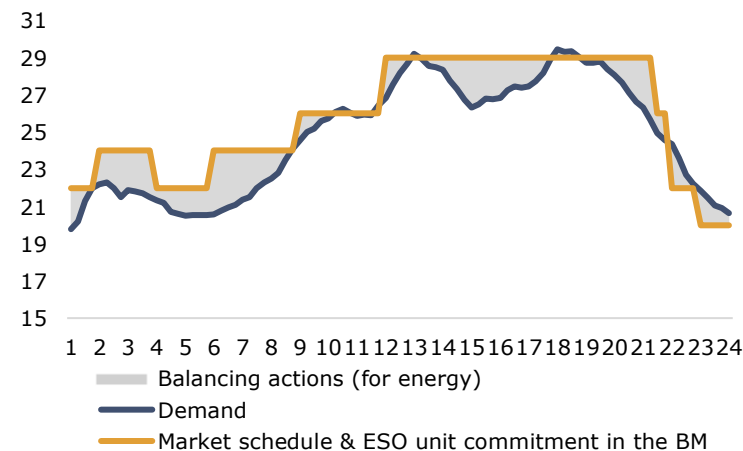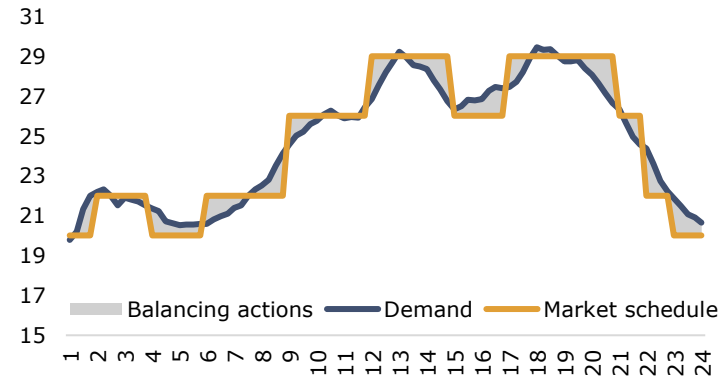


- Unit commitment decisions should be taken by market participants in response to expected market prices
- The role of the SO is 'residual' ensuring energy balance within SP

- This, however, does not happen in practice
- ESO ends up taking unit commitment decisions for:
 - other system needs; but also
 - reserve margin and energy balance

INTERTEMPORAL ISSUES

The current dispatch mechanism does not facilitate effective optimisation of costs and unit constraints over time

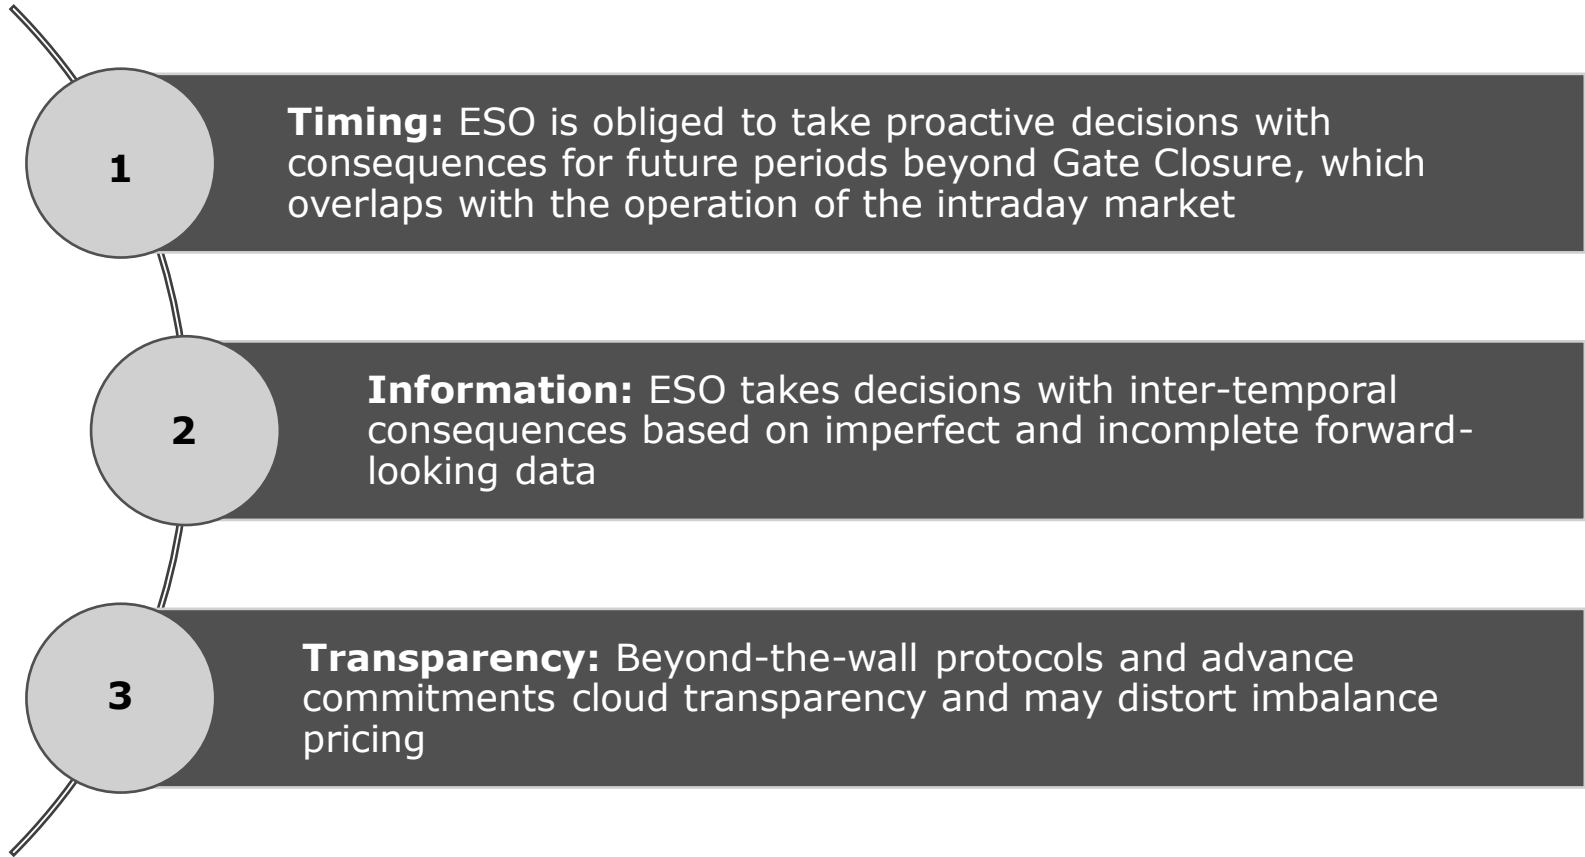

TIMING


ESO is obliged to take proactive decisions with consequences for future periods beyond Gate Closure, which overlaps with the operation of the IDM

- ESO typically needs to take actions for energy and Regulating Reserve 4-5 hours before Gate Closure given CCGT minimum on and off times
- Most of the intraday trading, however, happens over the two hours before Gate Closure
- This means the system may look short when ESO needs to decide whether to secure margin

Impact:

- The market may expect that ESO will intervene ahead of time to ensure sufficient margin
- Do ESO actions drive poor liquidity in the intraday market or is it that the intraday market is not facilitating effective repositioning?
- In any case, market players face conflicting incentives, with a lack of coordination between ESO actions and market scheduling decisions

TRADED VOLUMES FOR 30MIN PRODUCT ON THE GB CONTINUOUS INTRADAY MARKET

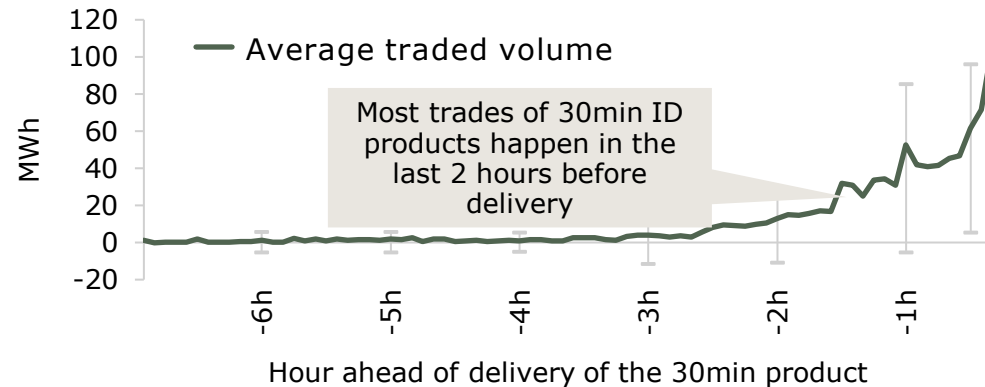

Average dynamic parameters across the CCGT fleet:


	Notice to deviate from zero	Time to full load (based on run up rate)	Min. nonzero time
CCGT	1.5h	1.5h	4.5h

Notes: Analysis based on 18 days in 2023, based on key study days
Source: EPEX, AFRY analysis

TIMING


ESO is obliged to take proactive decisions with consequences for future periods beyond GC, which overlaps with the operation of the IDM

**ORDERS ON THE CONTINUOUS INTRADAY MARKET
30MIN PRODUCT FOR DELIVERY AT 6.30PM**

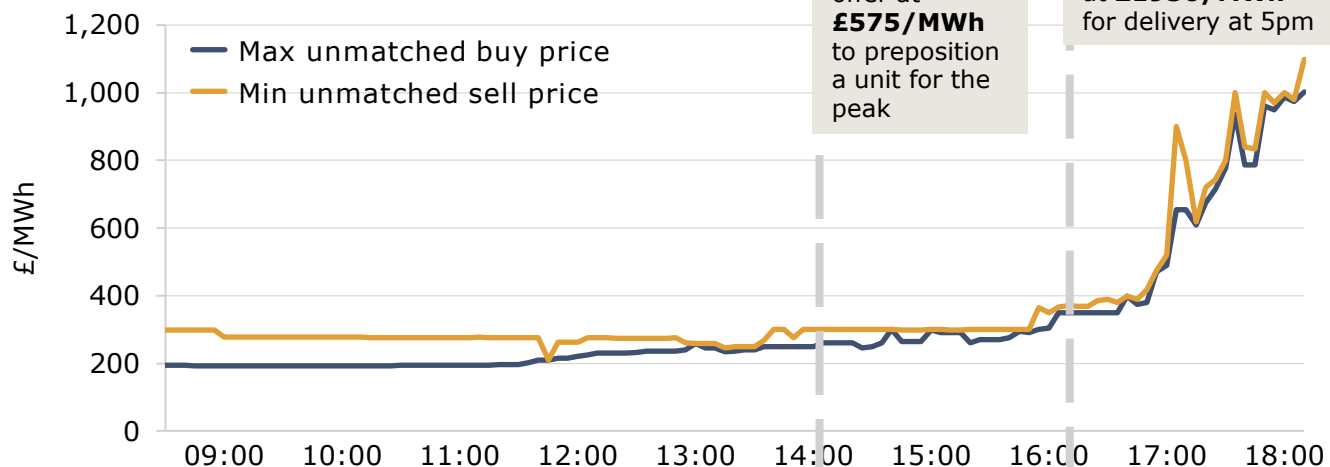

- On 03/07/2023, ESO accepted expensive BM offers through the afternoon in anticipation of the peak
- The intraday order data for delivery at 18.30 show limited market activity through the afternoon with intraday prices converging closer to delivery time
- Intraday prices were high, but not as high as the Imbalance Price
- The **BM appears to be supplanting the ID market** because of ESO risk management

**TRADED VOLUMES ON THE CONTINUOUS INTRADAY MARKET
30MIN PRODUCT FOR DELIVERY AT 6.30PM**

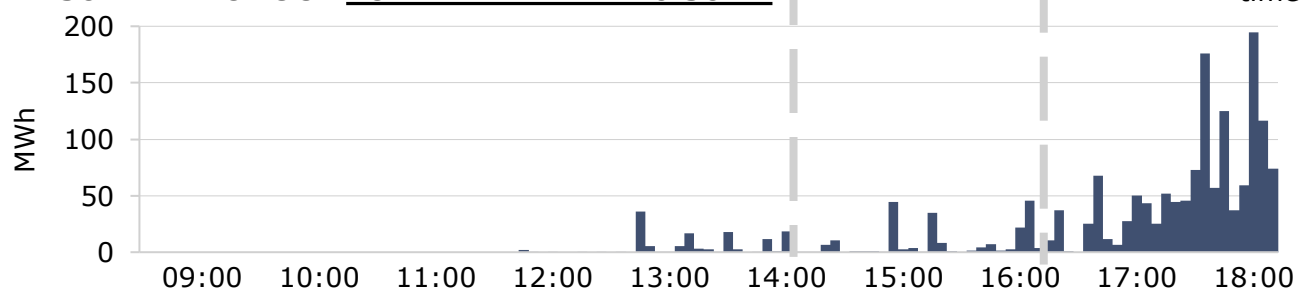

Source: EPEX


KEY IMPACT

- Market players face conflicting incentives, with a lack of coordination between ESO actions and market scheduling decisions

INFORMATION

When taking long notice scheduling actions in the BM, forward-looking data available to ESO is incomplete and non-firm

DELAY DE-SYNC EXAMPLE WITH MIN-ZERO TIME OF 6H

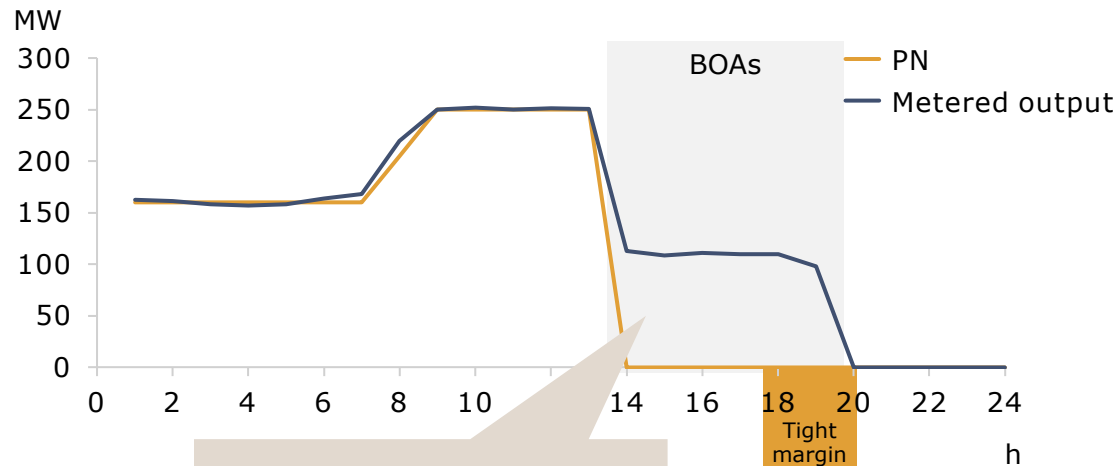


- In this example, ESO expects a deficit at the evening peak based on information available in the afternoon
- ESO keeps a CCGT synchronised through the afternoon to be able to use it at the peak
- This **unit commitment decision is taken at a time when other BMU PNs are not firm, and BOD have not been finalised**

INFORMATION

Energy-limited asset capability is uncertain when ESO is making 'advance' scheduling decisions


CURRENT APPROACH FOR THE MANAGEMENT OF BATTERIES IN THE BM

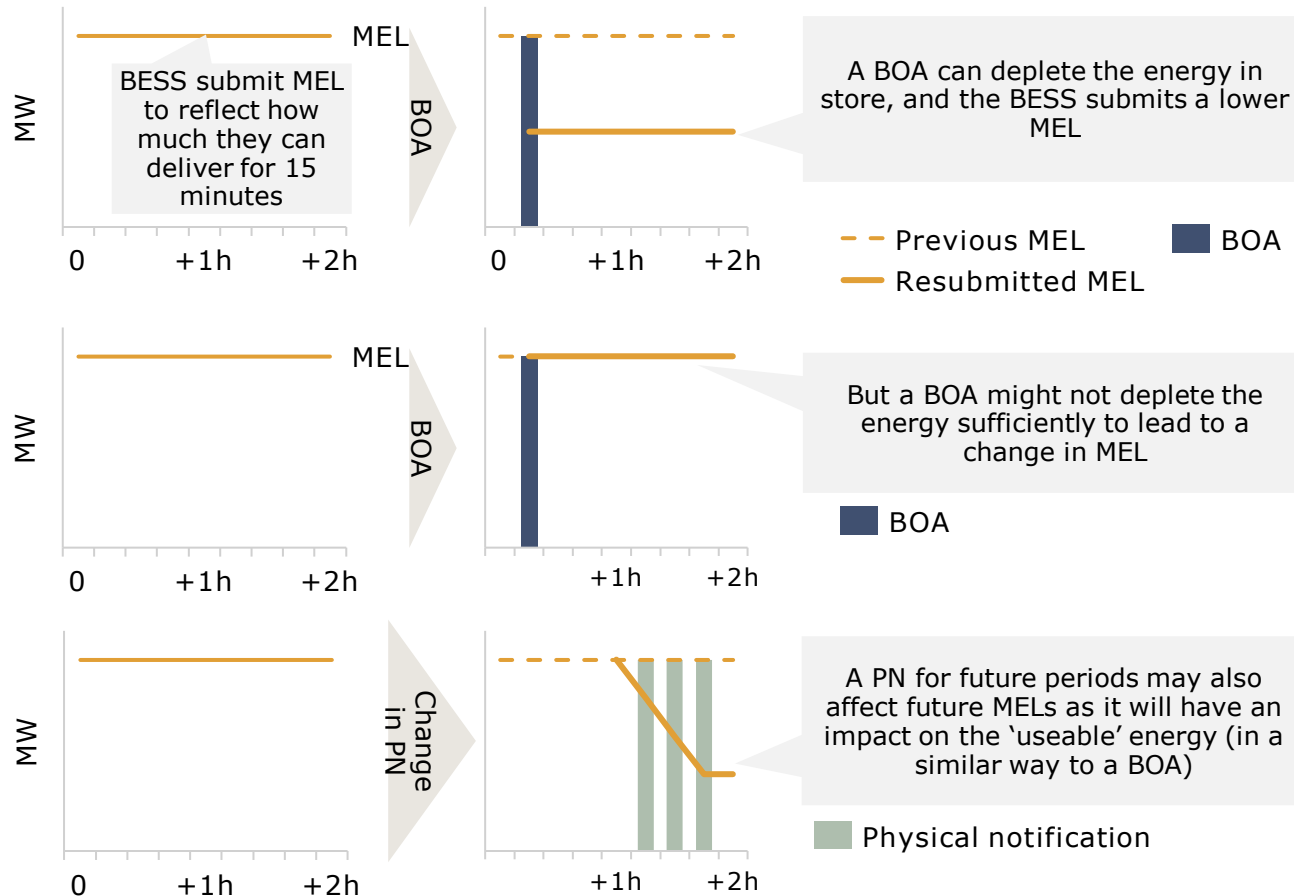

- ESO has **no information about the State of Charge of energy-limited units**
- The '30 minute' rule is used as a compromise: MEL submissions reflect capabilities for the next 30 minutes
- Even if ESO had clear visibility of the State of Charge of energy-limited assets, it **cannot be certain about the 'usable' energy for future settlement periods**
- Energy-limited assets can change their PNs until gate closure as trading continues

INFORMATION


ESO takes decisions with inter-temporal consequences based on imperfect and incomplete forward-looking data

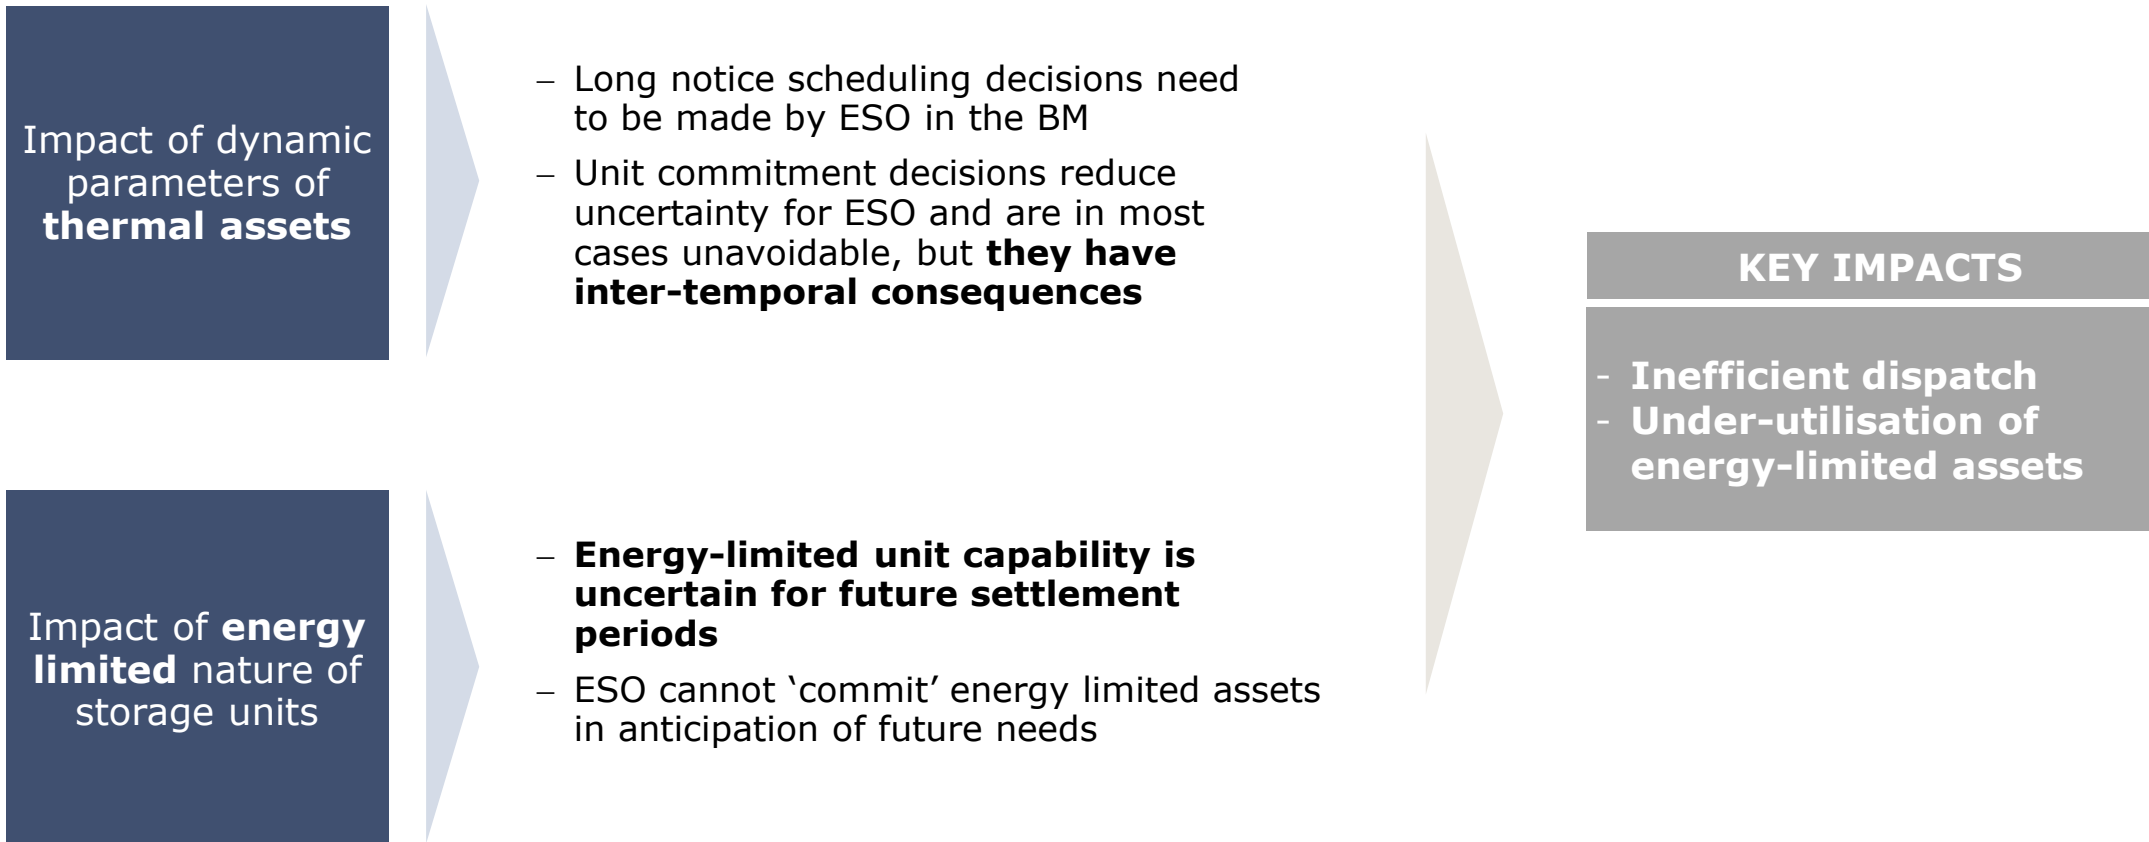

TRANSPARENCY

Beyond-the-wall actions and advance commitments cloud transparency and may distort imbalance pricing

**THEORETICAL SYSTEM PRICE ON THE 01/01/2023
ASSUMING START-UP COSTS OF UNITS SYNCHRONISED FOR IS
RECOVERED DURING THE PEAK**

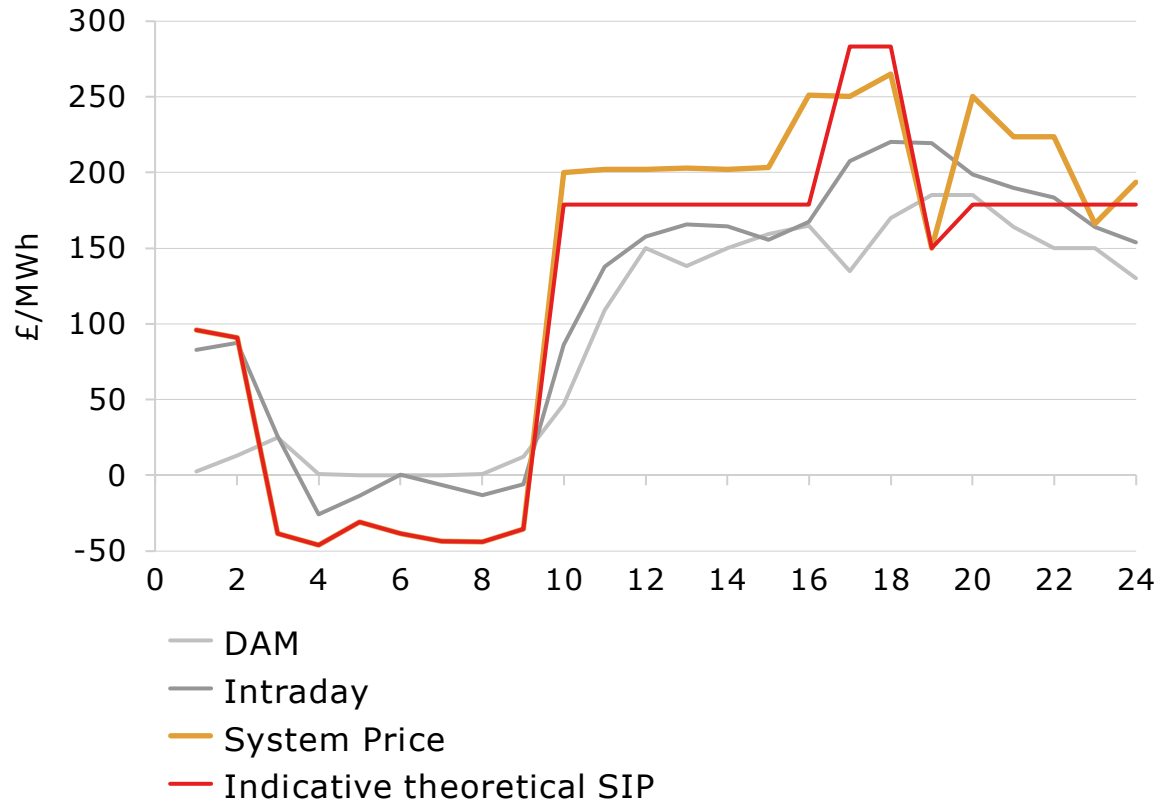


- On 01/01/2023, actions were taken:
 - in the morning for inertia and voltage; and
 - in the early afternoon to cover for the evening peak
- Part of the cost of the 'early' actions is allocated to those early periods when the need is actually for the evening peak period
- Market participants embed their start-up costs in their offer price
- Imbalance Price formation is unclear, potentially impacting incentives for market participants to support system level energy balance

KEY IMPACT

- Cross-subsidisation between periods
- Dampened incentives for market participants to support system energy balance
- Under-utilisation of flexible assets


Content

1. Executive summary	12
2. Key limitations of the current scheduling and dispatch regime	19
2.1 Incentives	20
2.2 Visibility and access	33
2.3 Intertemporal issues	45
3. Conclusions	54

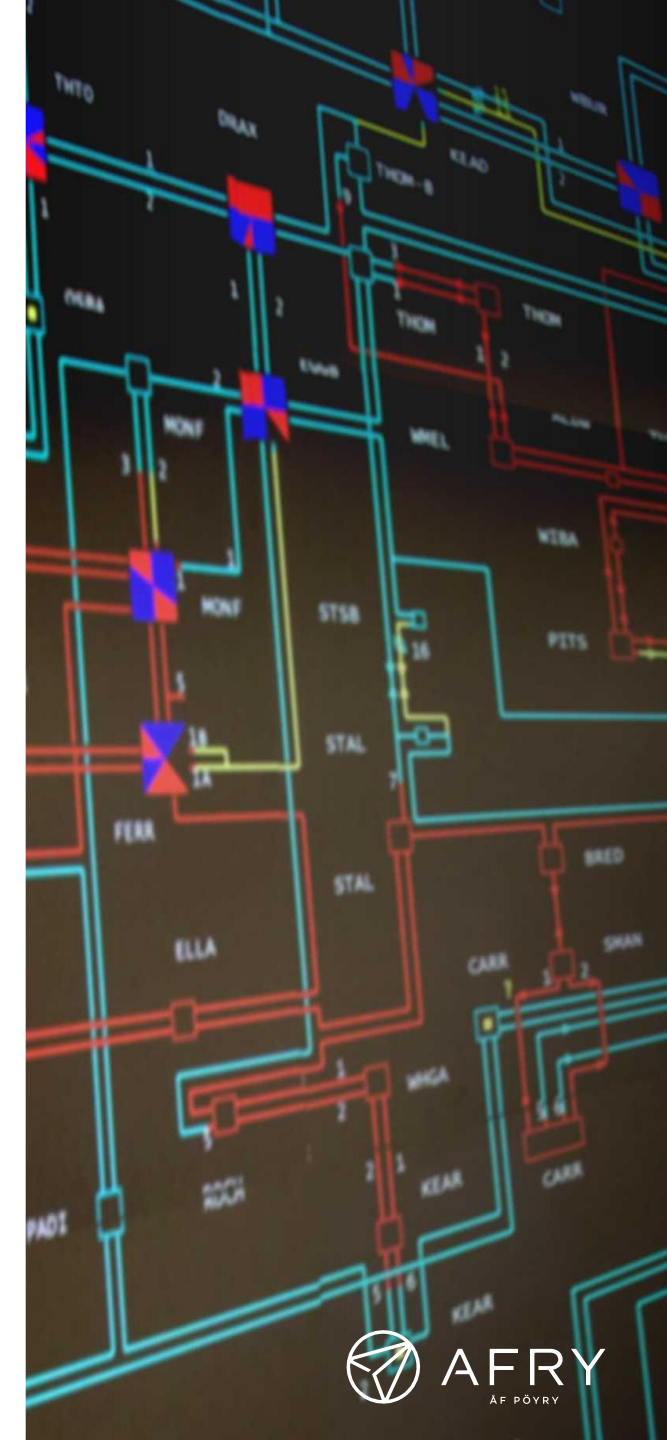

There is a clear case for change of the 'status quo' as the underlying conditions have changed since NETA was introduced

What are the key limitations of the 'status quo' scheduling and dispatch regime?

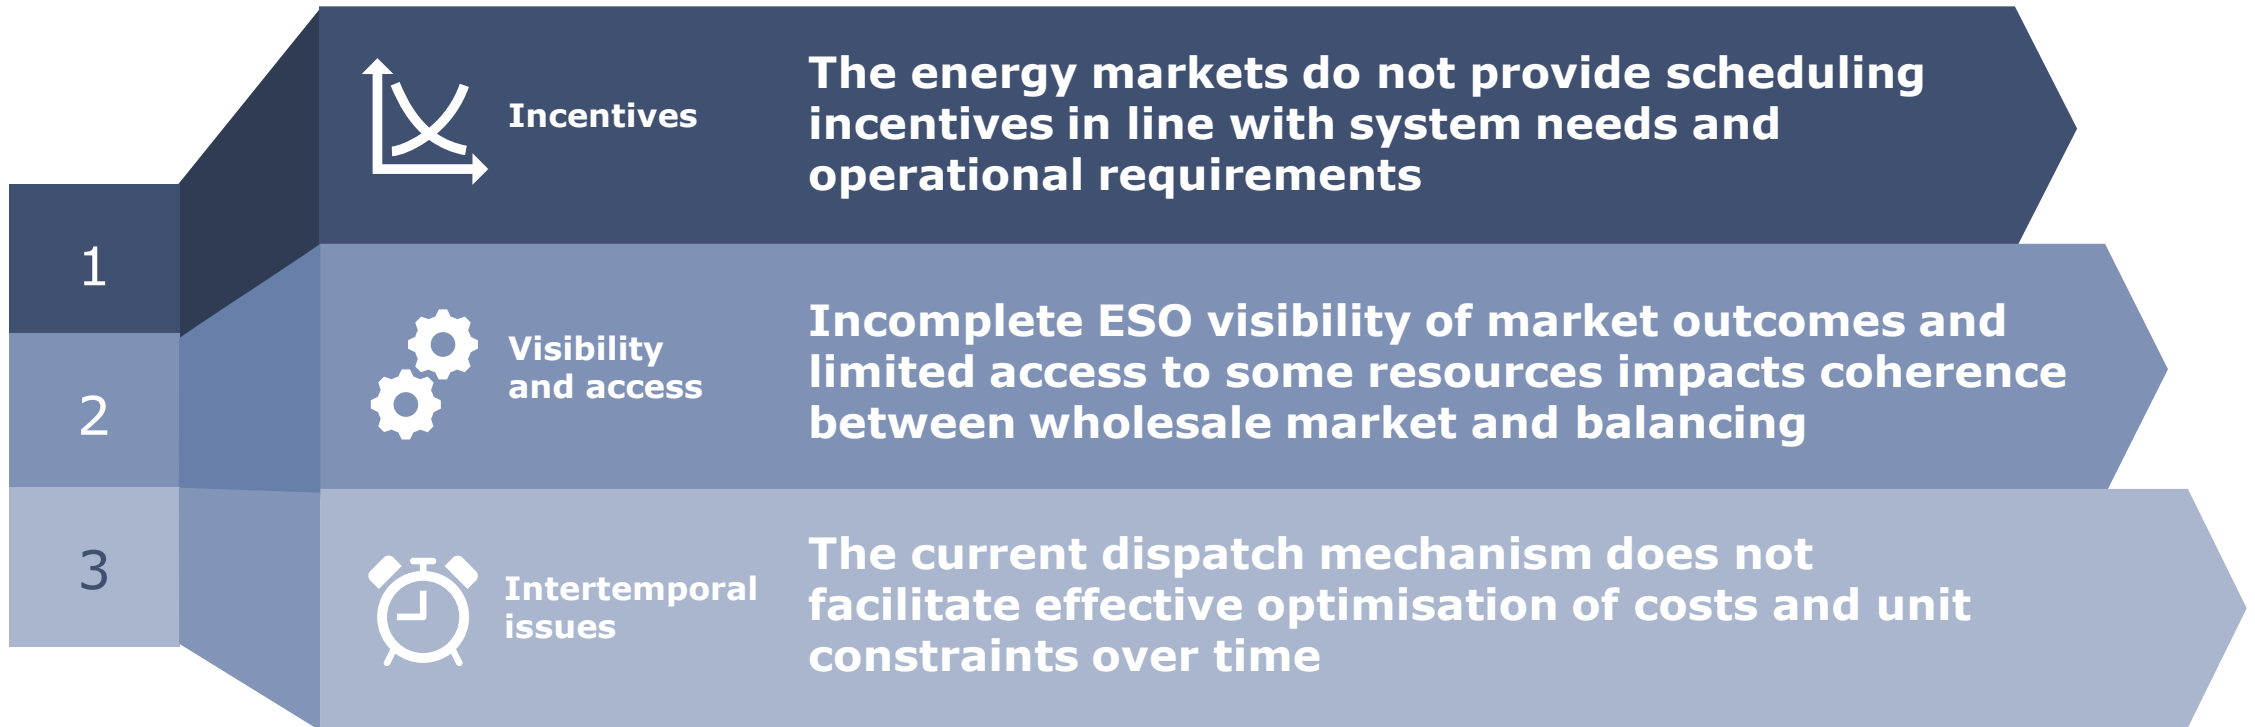

In addition to network capacity challenges, the limitations of the current market design challenge system operation and can result in inefficient dispatch


		Reason for ESO actions			
		Energy balance	Network congestion	Reserve	Other system needs
Limitations of the current market design and processes	Incentives: the energy markets do not provide scheduling incentives in line with system needs and operational requirements	Limited impact, although improvements are possible	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency
	Visibility and access: incomplete ESO visibility of market outcomes and limited access to some resources impacts coherence between wholesale market and balancing	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency	Moderate impact on dispatch efficiency, cost to consumers and/or transparency
	Intertemporal issues: the current dispatch mechanism does not facilitate effective optimisation of costs and unit constraints over time	Limited impact, although improvements are possible	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency	Significant impact on dispatch efficiency, cost to consumers and/or transparency

While each aspect is potentially manageable individually, the combination of the three creates the current limitations of the scheduling and dispatch processes

Solving the underlying reasons for ESO action is another way to limit potential difficulties

What is less clear is what to change to ...

There are two high-level approaches:

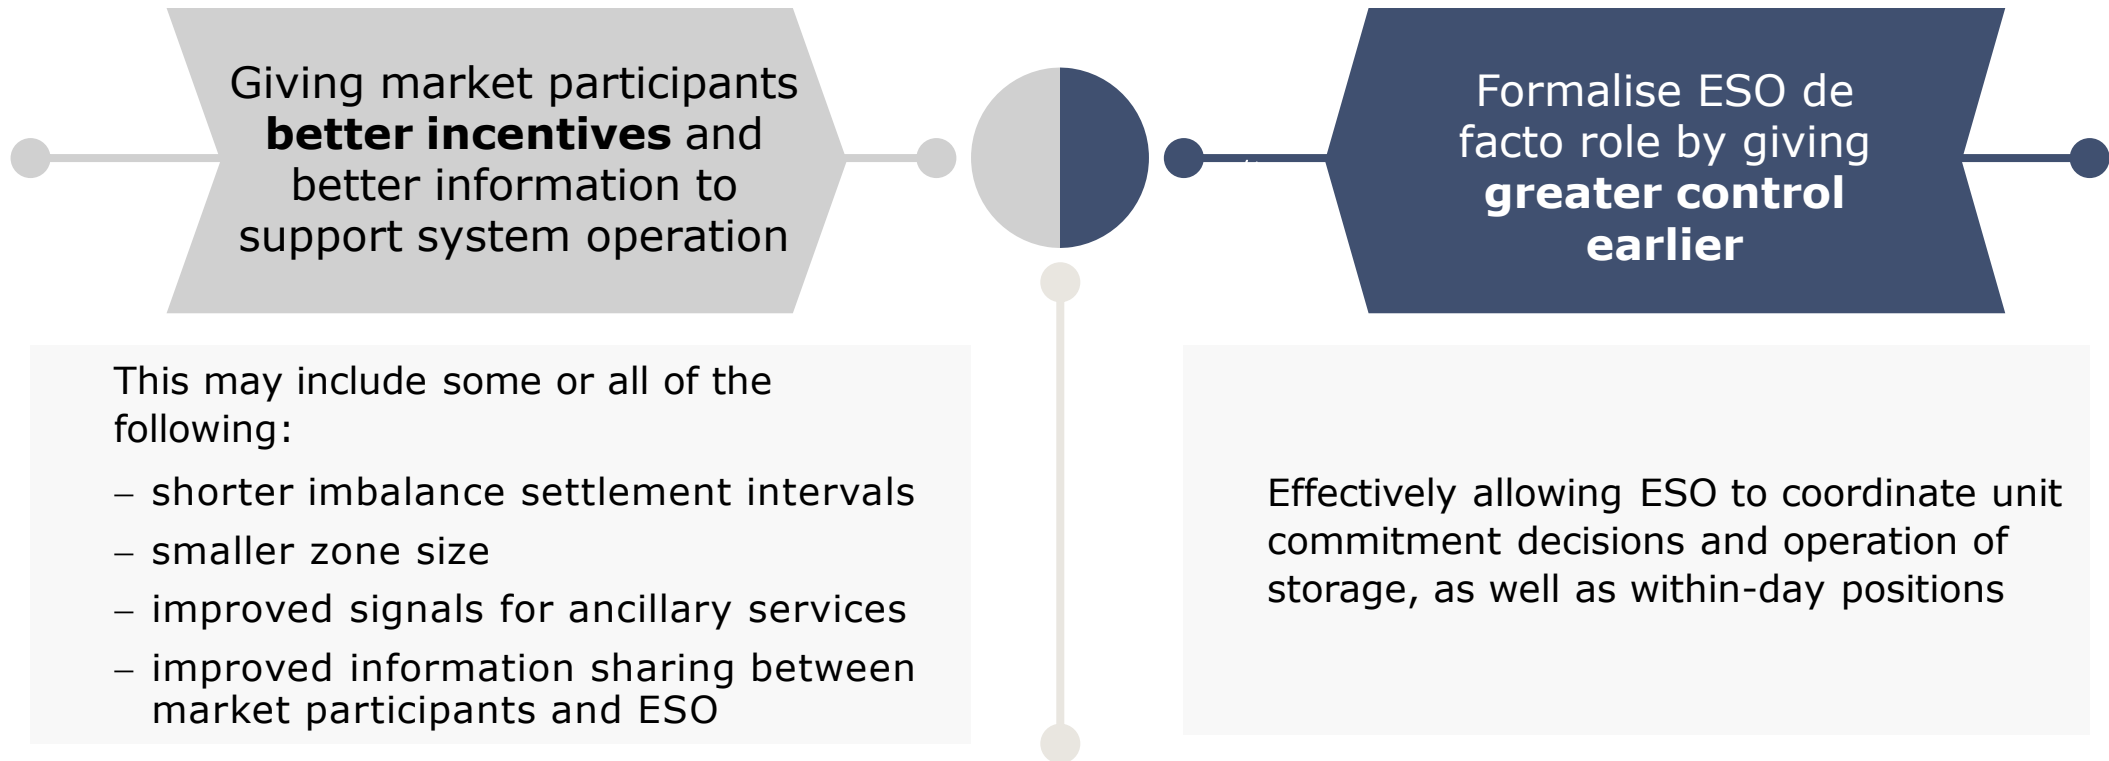

Next Steps

Feedback

- We would hugely appreciate your feedback on this work.
- Following today we will send a form with questions relating to the presentation content

Case for Change

- The slides and a summary of the discussion today will be published on our Net Zero Market Reform [website](#)
- We will then integrate workshop feedback into the final 'Case for Change' report

Options for Reform

1. **Industry idea generation:** Following the workshop, we will welcome organisations sending us their proposals for how the issues raised can best be addressed
2. **ESO option sharing:** We plan to run a follow-up workshop outlining the spectrum of options we have identified to address the issues raised, **likely in May**

Other related work

- We have in parallel been assessing the interactions between energy and ancillary service procurement looking at the pros and cons of more co-optimised procurement
- We will run be engaging with stakeholders on this project in the coming months


Q&A



Glossary

Glossary

- **BMU:** A Balancing Mechanism Unit (BMU) is a unit which participates in the balancing mechanism and exports or imports electricity . and to ensure the security and quality of electricity supply across the transmission system. These services include reserve, frequency control and voltage control.
- **non-BMU:** A unit whose output or usage cannot be changed by ESO in the Balancing Mechanism timescales
- **System Imbalance Price:** The System Imbalance Price is the price used to settle the difference between contracted production (and consumption) and the amount actually generated (or consumed) in each settlement period
- **PN:** A Physical Notification (PN) is the best estimate of the level of generation or demand that a participant in the BM expects a BM Unit to export or import, respectively,
- **FPN:** A Final Physical Notification (FPN) is the Physical Notification, which is submitted to the System Operator by Gate Closure for each Settlement Period and used in Settlement calculations.
- **NIV:** The Net Imbalance Volume (NIV) is the volume of the overall System energy imbalance, as a net of all System and energy balancing actions taken by the ESO for the Settlement Period
- **Operating reserve:** headroom or footroom capacity that can be called on with short notice to correct energy imbalances (differences between generation and demand) on the GB power system. Currently, operating reserves consist of 'regulating reserve' procured continuously and via the newly introduce 'Balancing Reserve' service and STOR (Short term operating reserve)

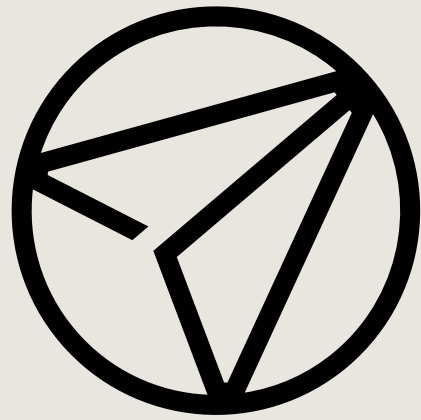

AFRY

ÅF PÖYRY