

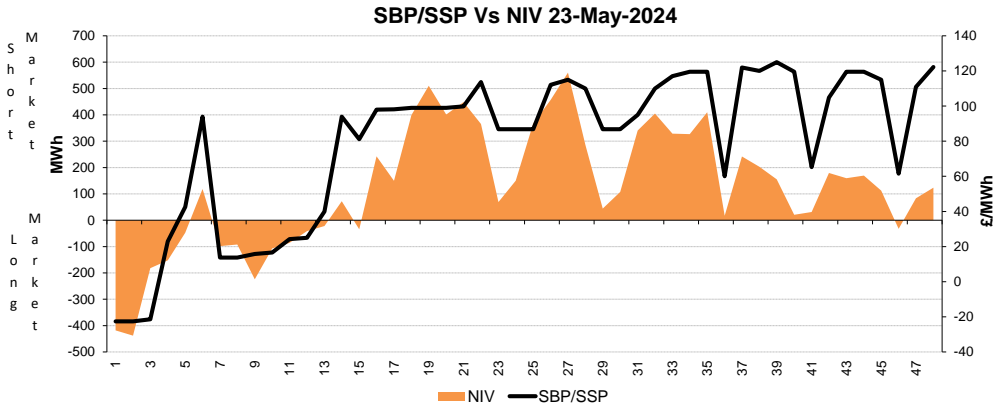
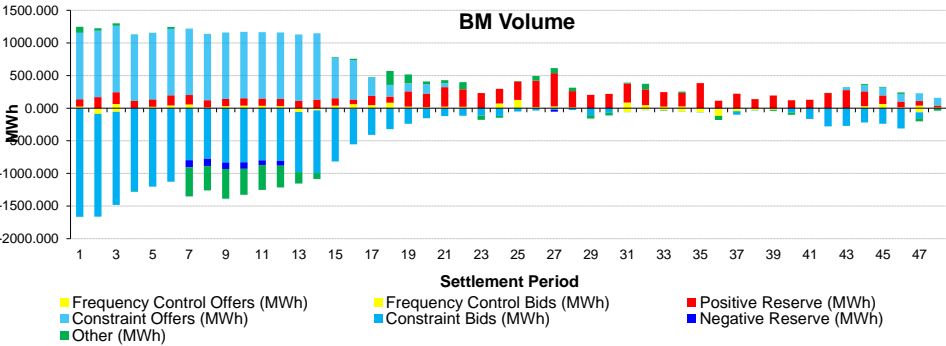
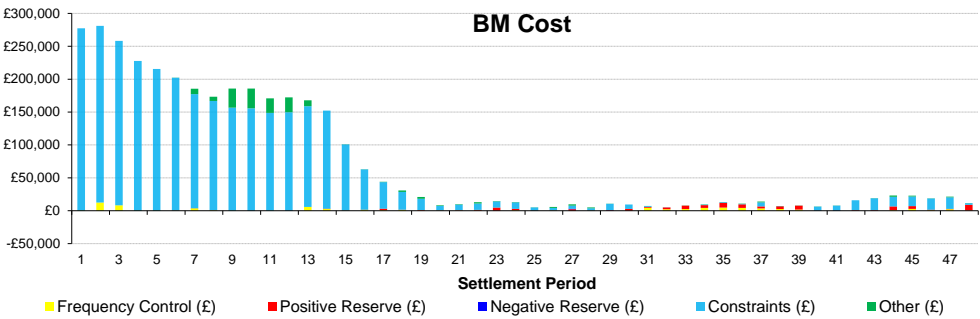


# Daily Balancing Costs

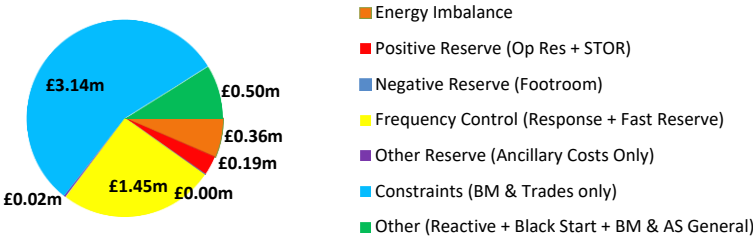

BM Cost (Indicative)

AS Cost (Estimate)



**Commentary**

The market was short from 07:30 onwards, except for one long period between 22:30-23:00. Trades were required for Downward Regulation.

BM Actions helped manage thermal constraints predominantly during the first half of the day. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.