

Date:

Sunday 12 May 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £12.31m

Daily Balancing Costs




nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

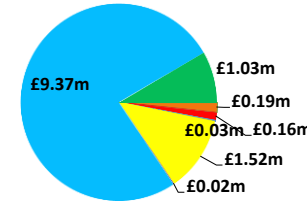

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

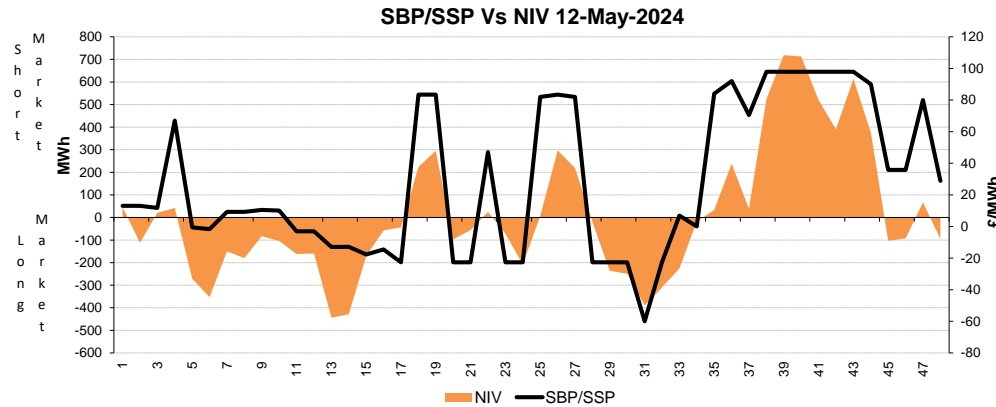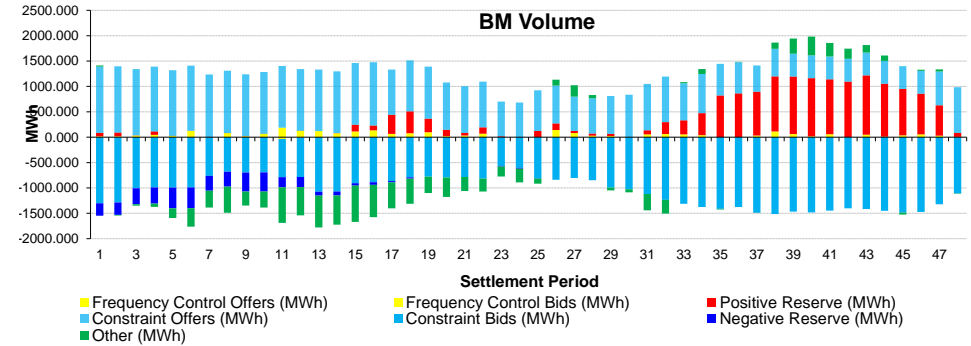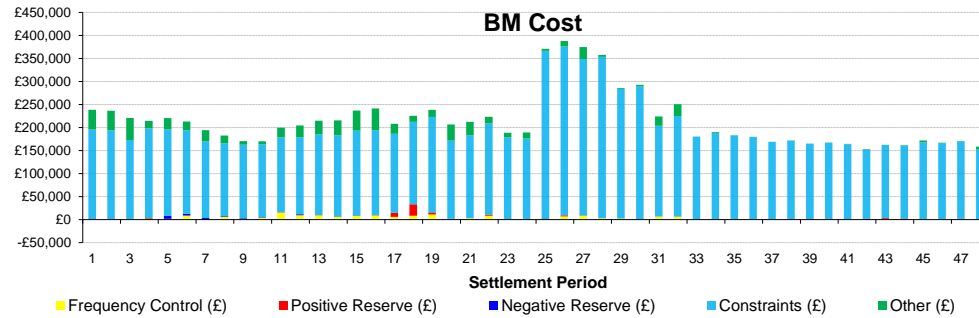

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions helped to manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control. BM Actions supported System Inertia.