

Date: **Saturday 08 Jun 2024**

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £12.48m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

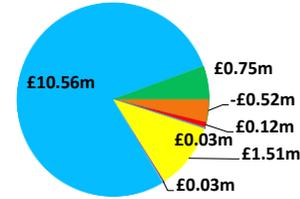

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

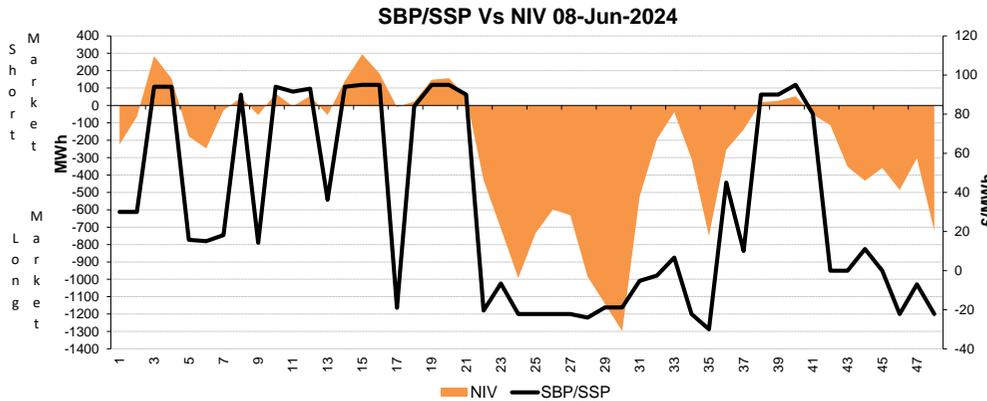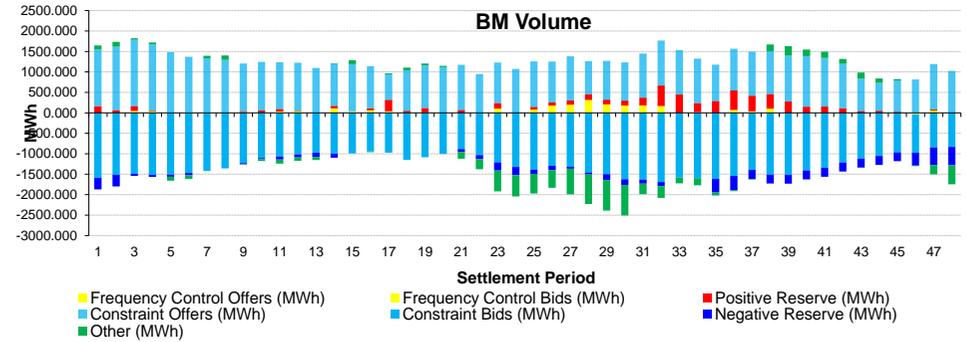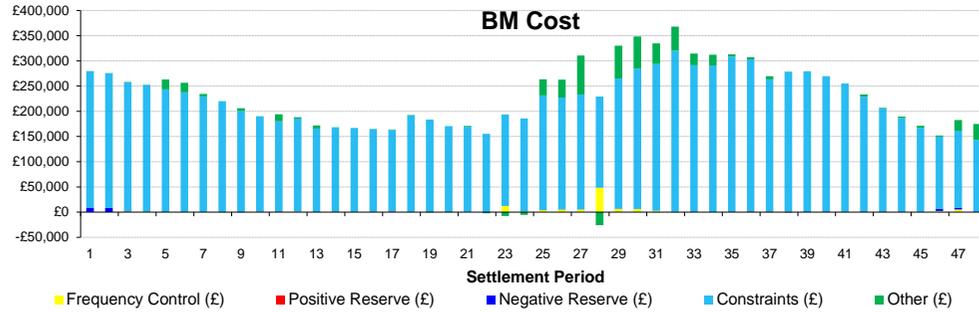

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped manage thermal constraints in Northern England and Scotland throughout the day. Trades and BM Actions supported Voltage Control. BM Actions further supported System Inertia.