
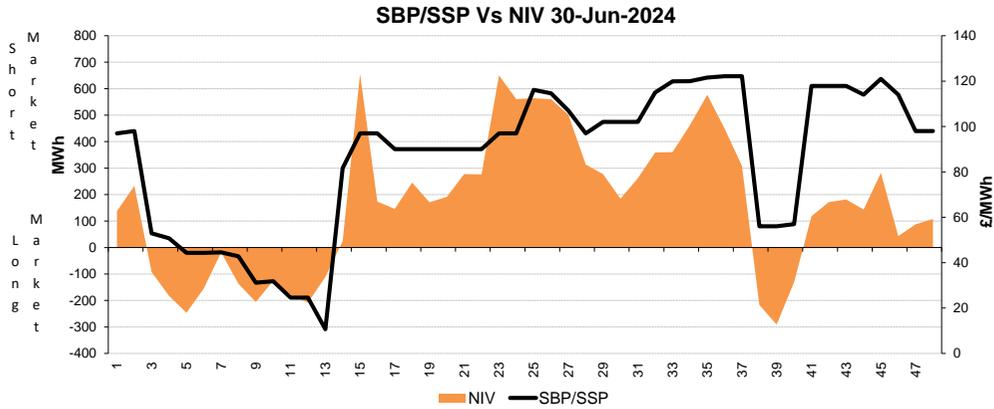
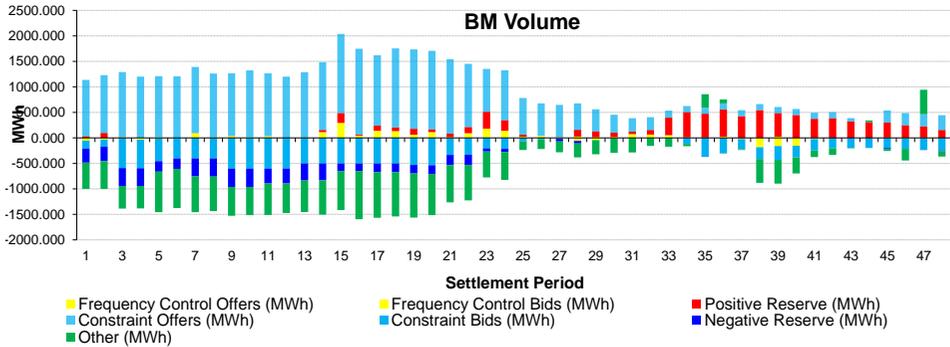
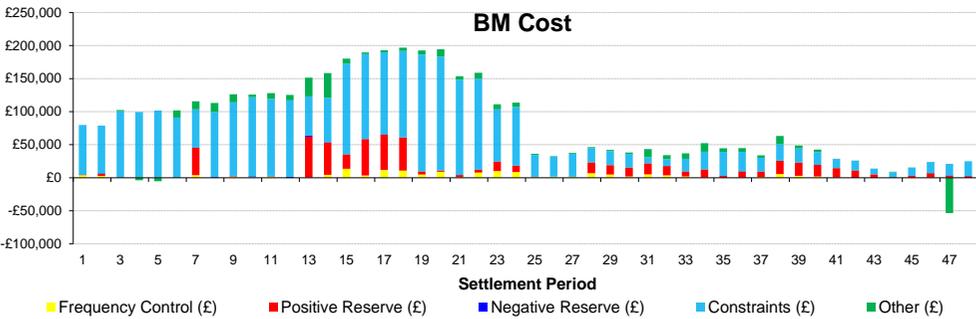
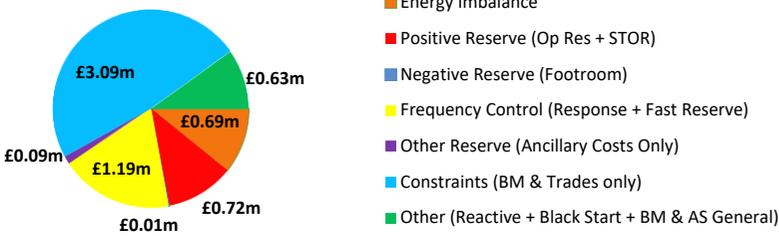


Date: **Sunday 30 Jun 2024**  
**BSUoS Final Tariff: £7.63/MWh**  
**Total Outturn: £6.43m**

# Daily Balancing Costs

■ BM Cost (Indicative)  
 ■ AS Cost (Estimate)



## Commentary

The market was short during the day between 6:30am and 6:30pm and alternated between long and short during the morning and evening. Trades were required for Downward Regulation. Trades and BM Actions were required to manage thermal constraints in Southern England throughout the day and BM Actions helped to manage thermal constraints in Scotland during the first half of the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.