



Date: Wednesday 05 Jun 2024

BSUoS Final Tariff: £7.63/MWh
Total Outturn: £7.95m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

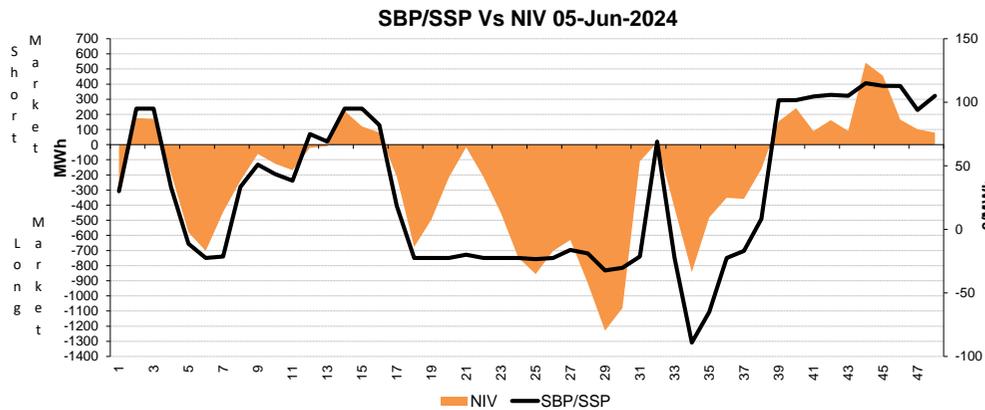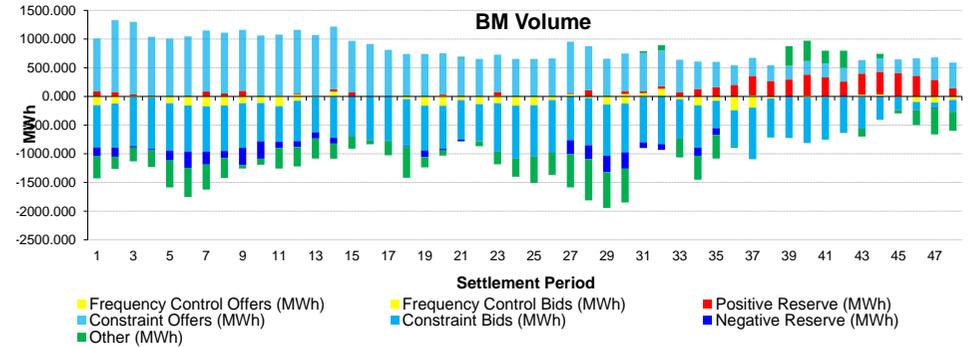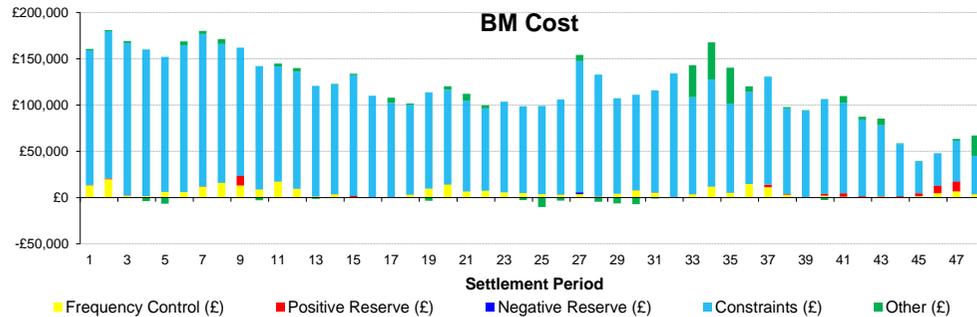

Commentary

The market was predominantly long until 19:00, though there were a few short periods between 00:30 - 01:30, 06:30 - 08:00 and 15:30 - 16:00. Trades were required for Downward Regulation and Margin. Trades and BM Actions were required to manage thermal constraints throughout the day. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.