

Date:

Sunday 09 Jun 2024



BSUoS Final Tariff: £7.63/MWh

Total Outturn: £8.98m




Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

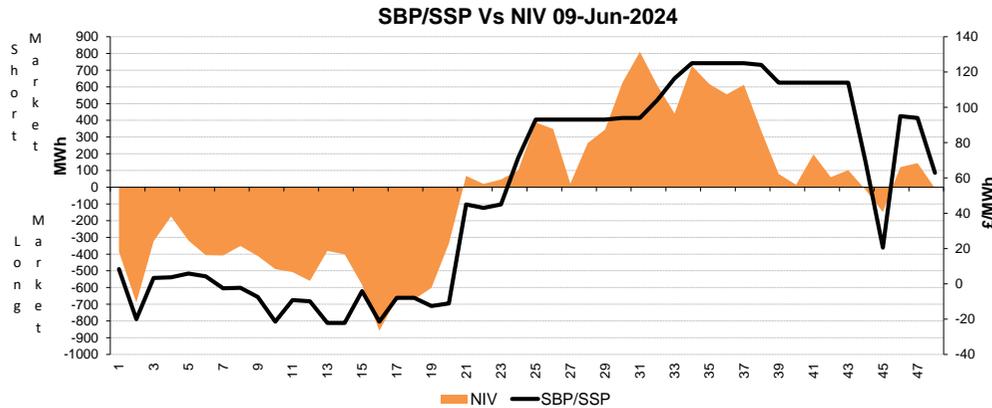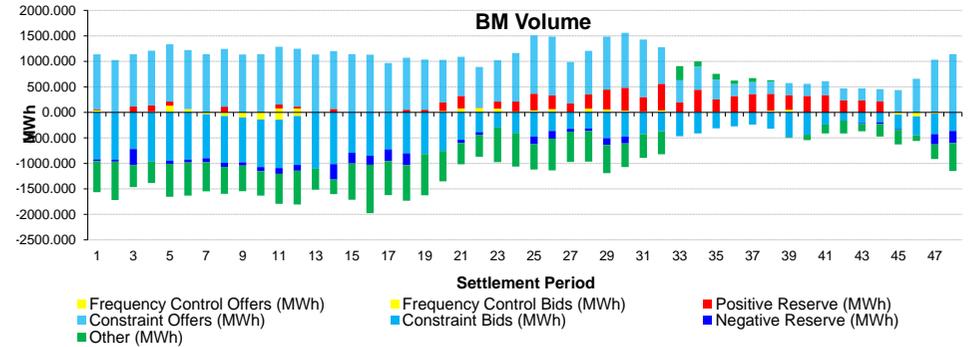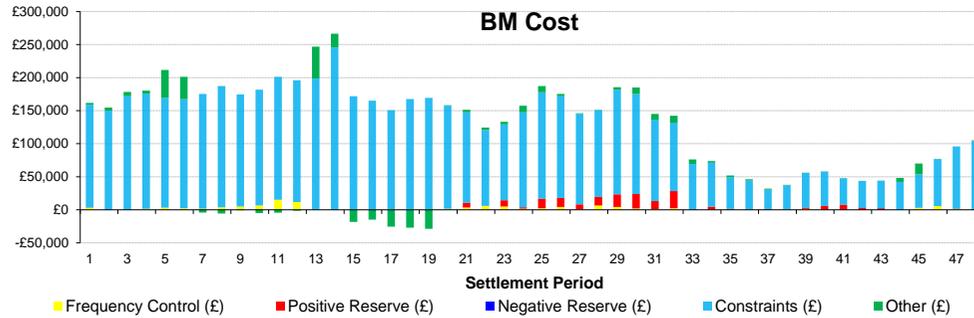

Commentary

The market was long until 10am and then short until 9.30pm. Trades were required for Downward Regulation. BM Actions and trades helped manage thermal constraints throughout the day. Trades and BM Actions supported Voltage Control. BM actions also supported System Inertia.