

Date:

Tuesday 25 Jun 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £2.70m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

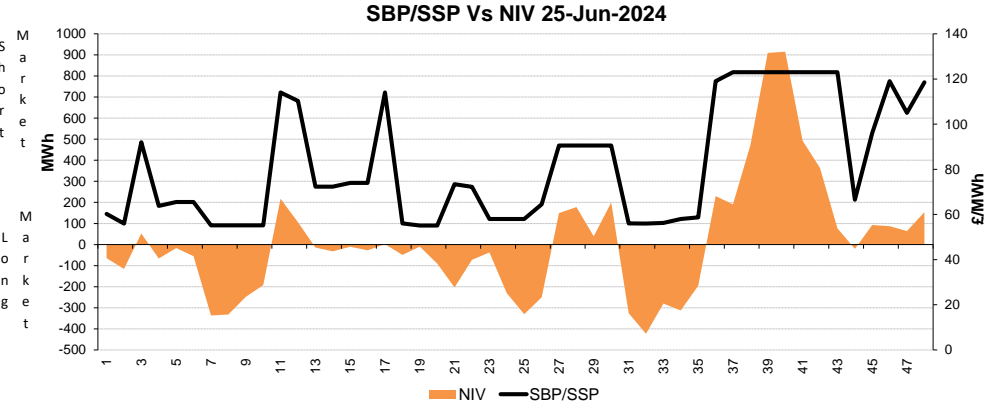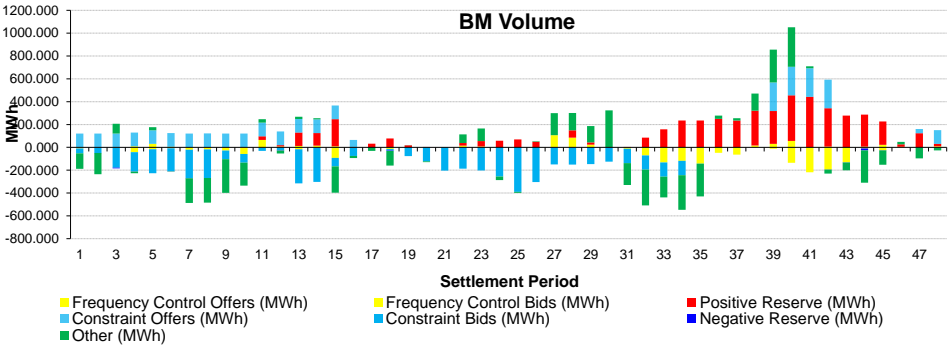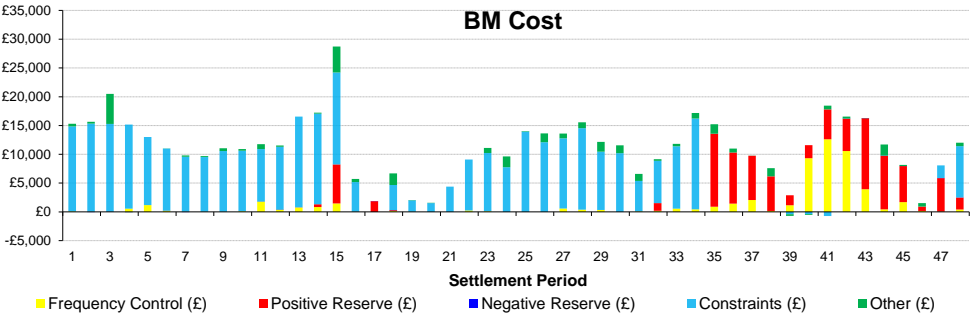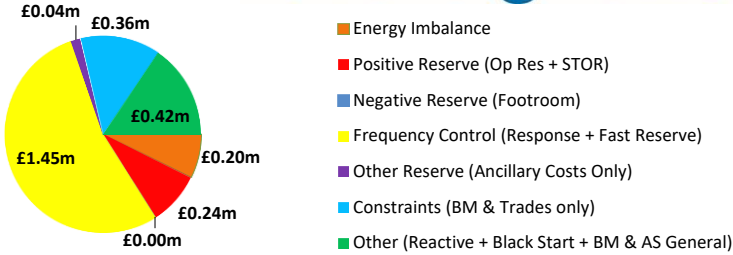

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. Trades and BM actions were required to manage thermal constraints in Southern England throughout the day and BM Actions also helped to manage thermal constraints in Scotland during the early morning. BM Actions supported Voltage Control.