

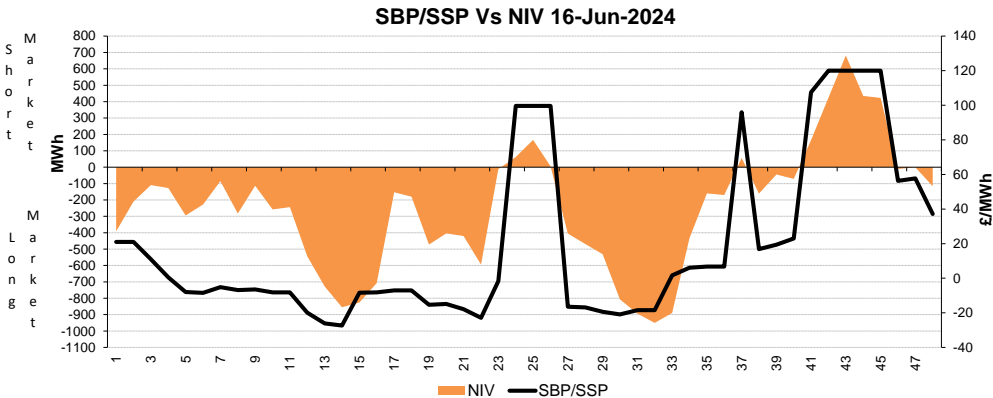
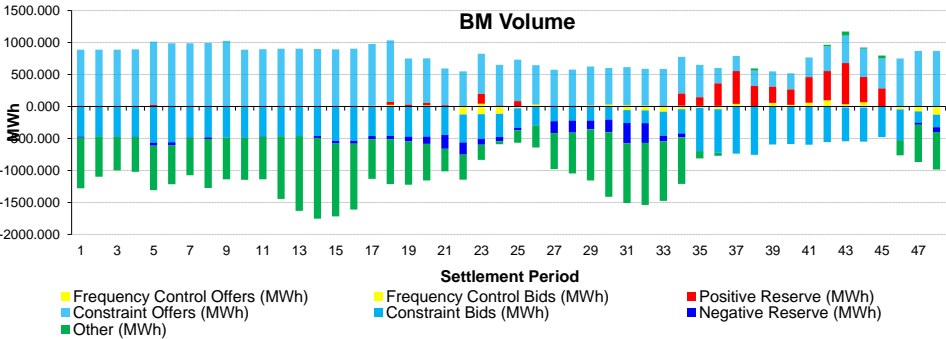
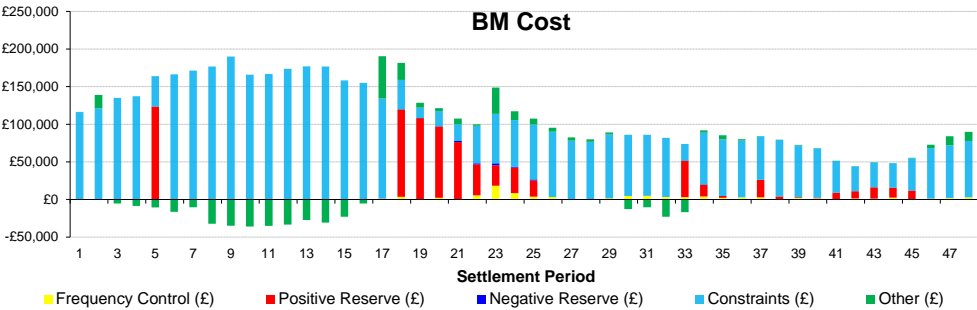


Daily Balancing Costs

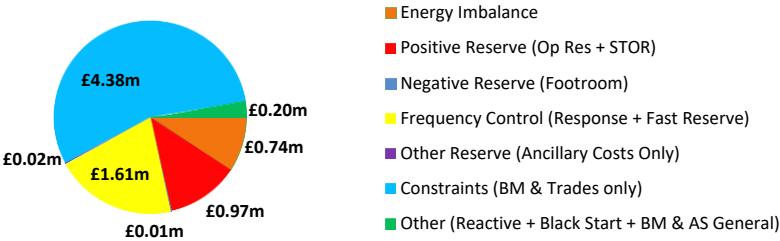

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was predominantly long except for some short periods between 11:30-13:00, 18:00-18:30 and 20:00-22:30. Trades were required for Downward Regulation. Trades and BM Actions helped manage thermal constraints in Southern England and Scotland throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.