

Date: Monday 03 Jun 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £9.18m

Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)

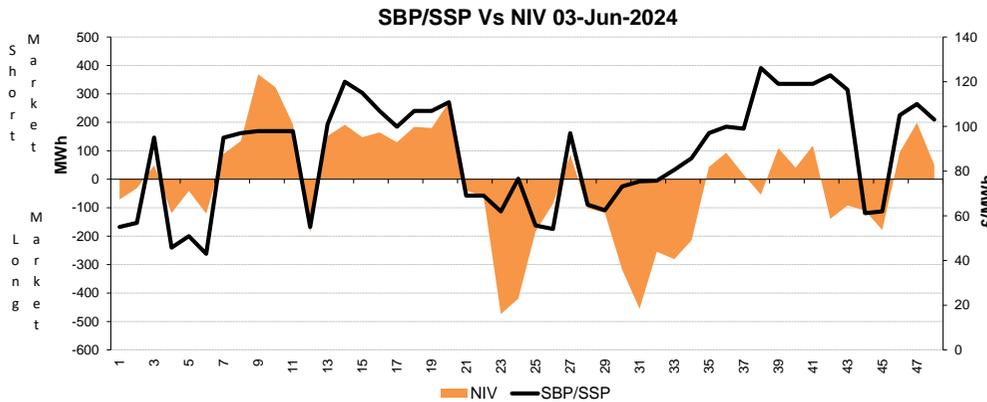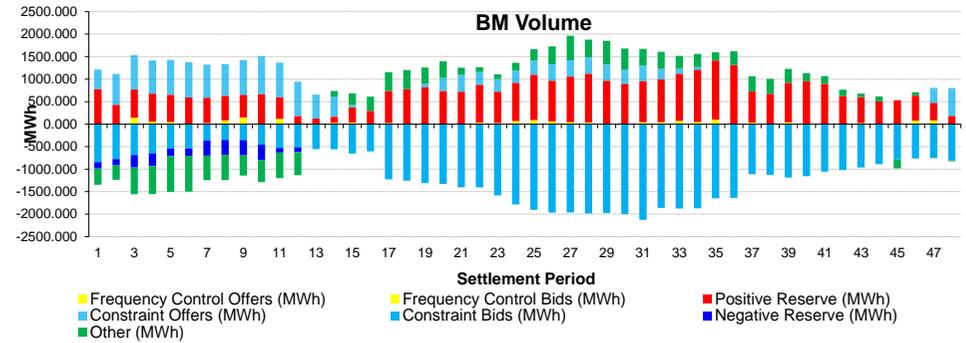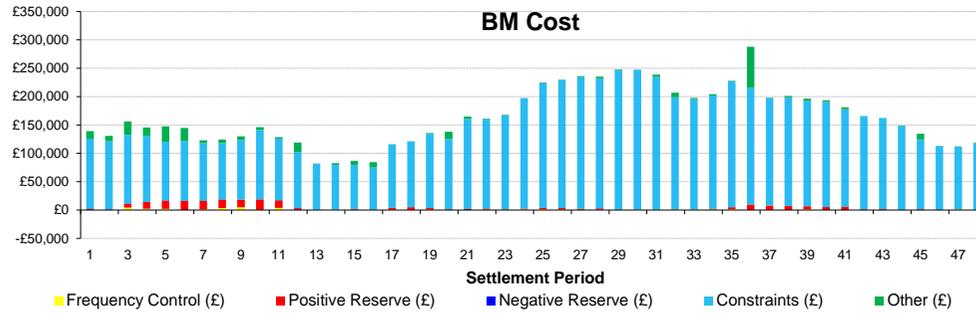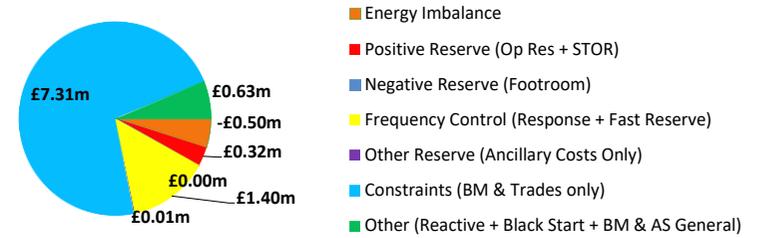

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation and Margin. Trades and BM Actions were required to manage thermal constraints throughout the day. Trades and BM Actions supported Voltage Control. BM Actions supported System inertia.