

Date:

Friday 14 Jun 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £7.80m

# Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

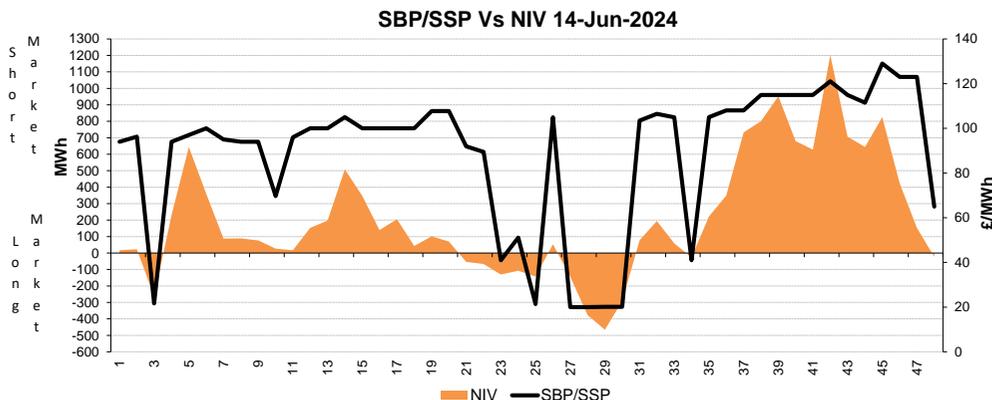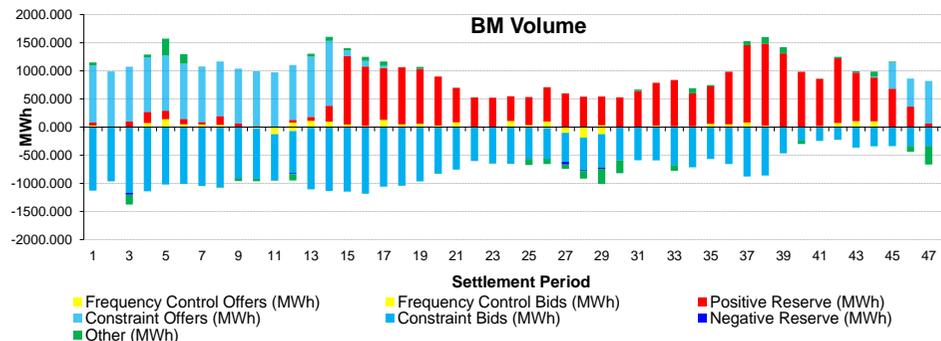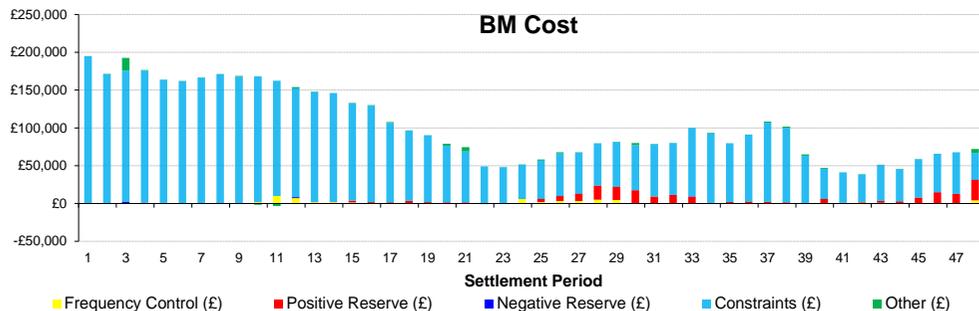

## Commentary

The market was alternating between long and short throughout the day. Trades and BM Actions helped manage thermal constraints in Southern England and Scotland throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.