






Date: **Sunday 07 Jul 2024**

BSUoS Final Tariff: £7.63/MWh
Total Outturn: £5.14m

Daily Balancing Costs



■ BM Cost (Indicative)
 ■ AS Cost (Estimate)

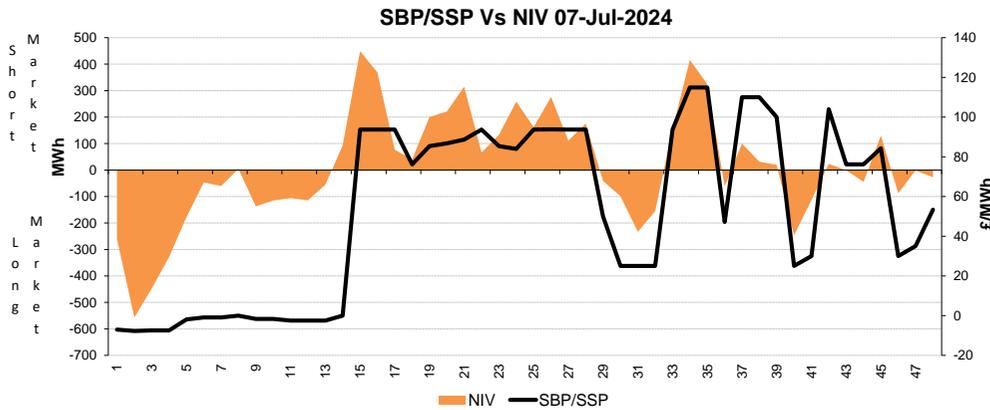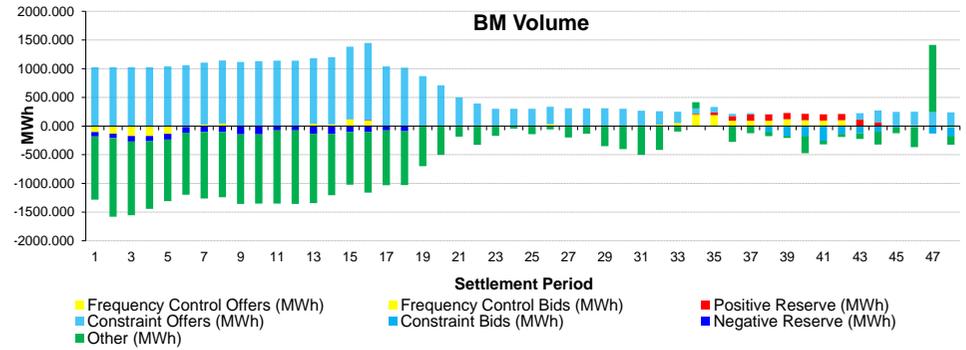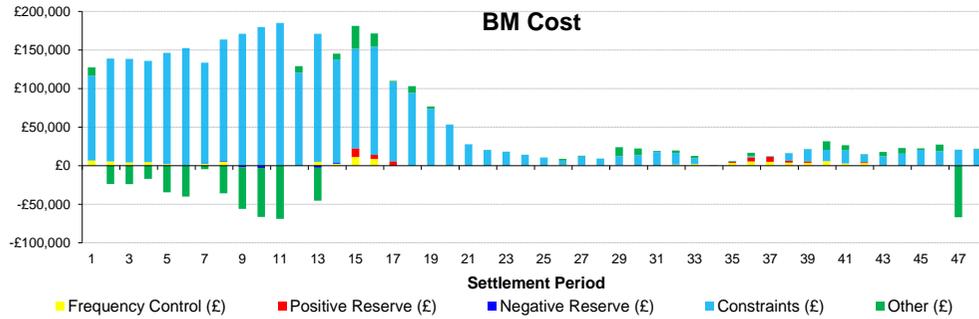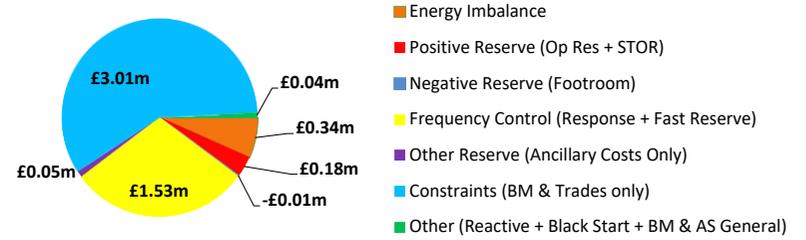

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions helped manage thermal constraints in Southern England during evening period. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.