
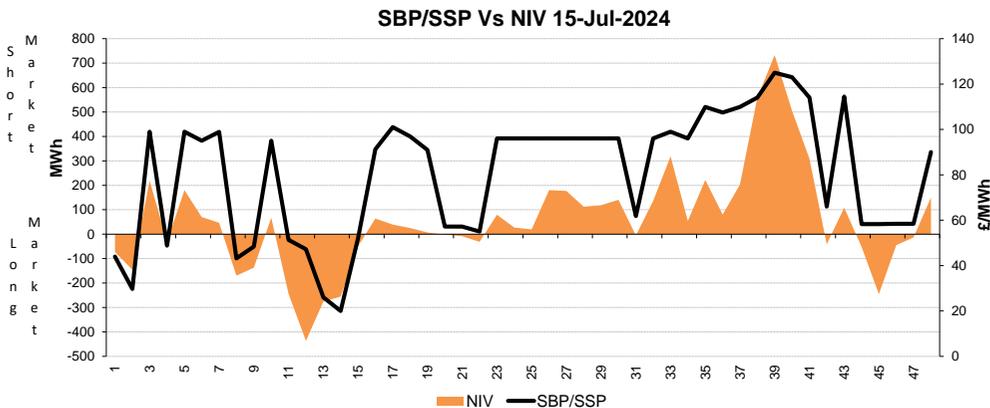
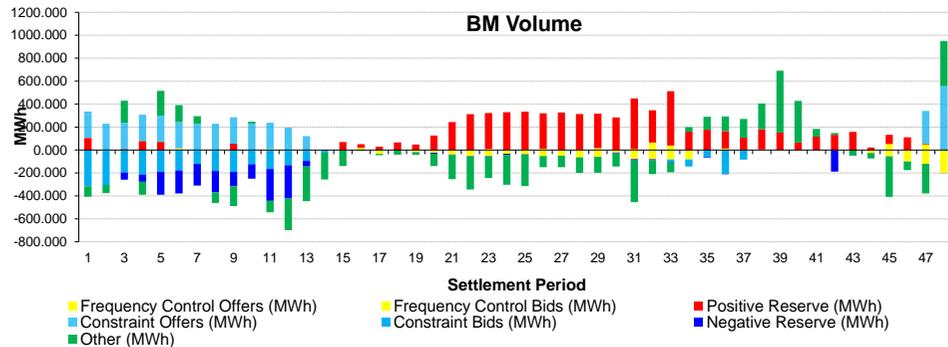
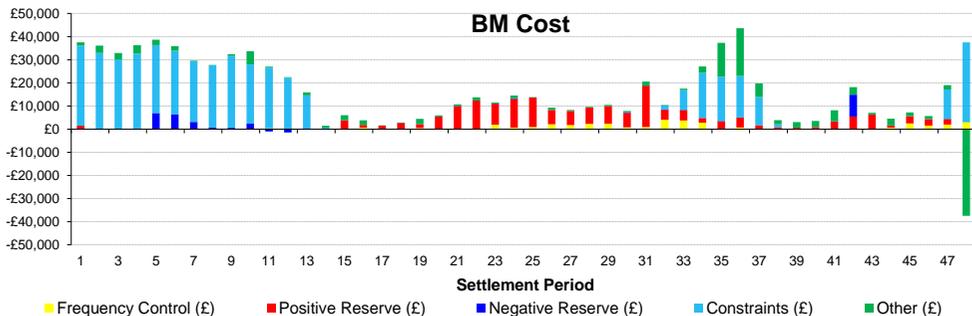
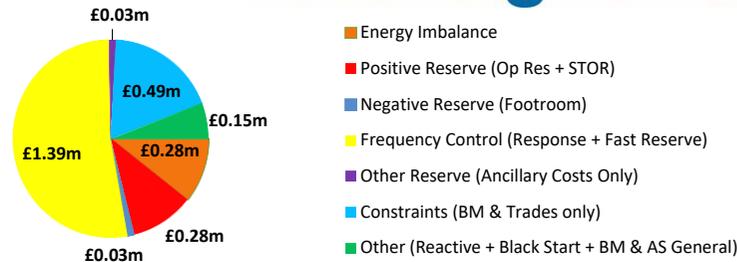


Date: Monday 15 Jul 2024

BSUoS Final Tariff: £7.63/MWh
Total Outturn: £2.66m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. BM Actions helped manage thermal constraints in Scotland and South England during early morning and afternoon respectively. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.