

Date:

Thursday 04 Jul 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £13.54m

# Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)

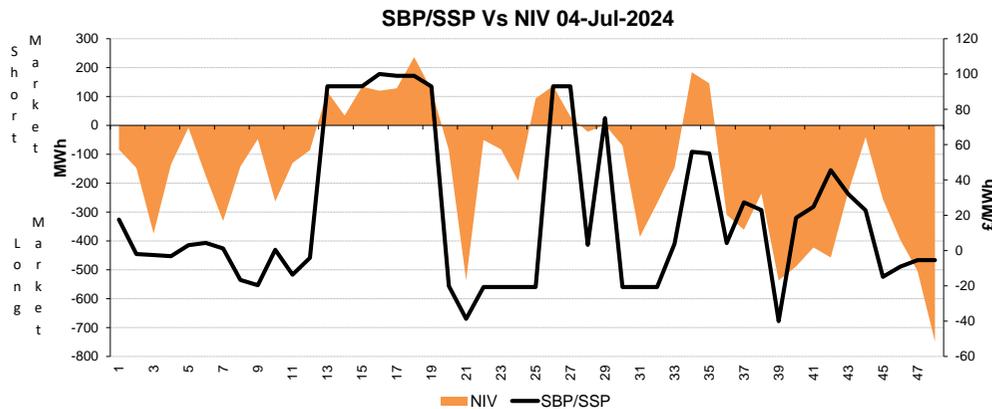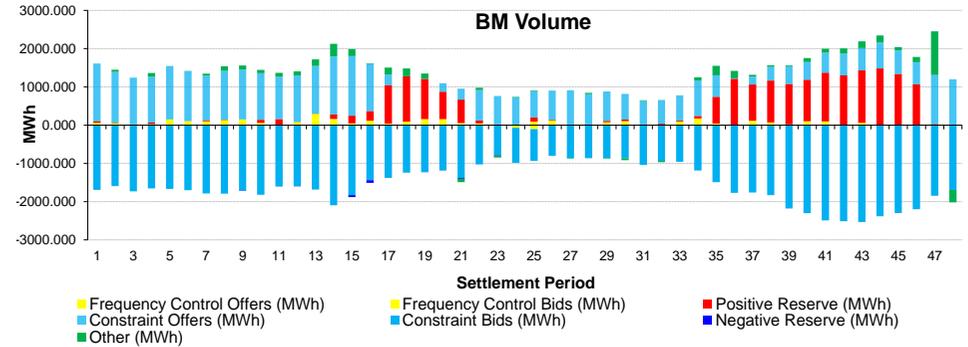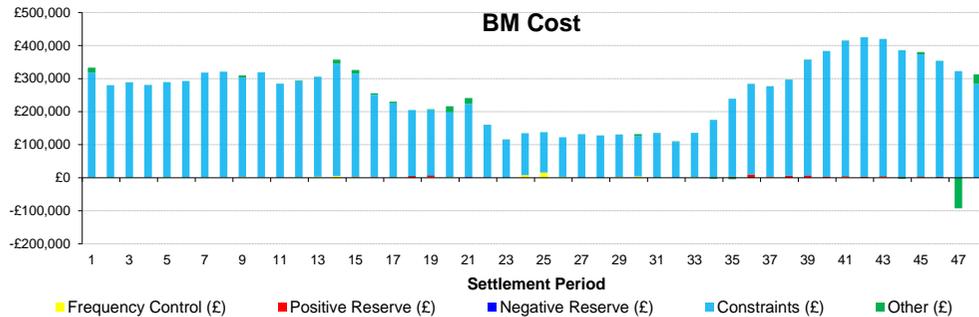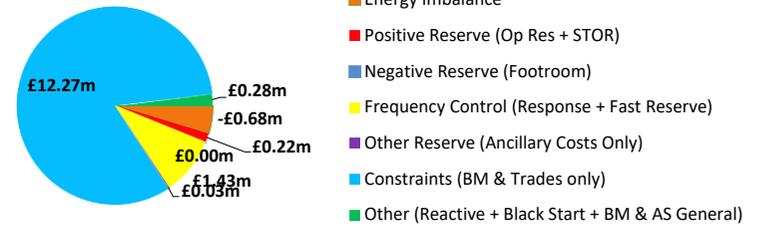

## Commentary

The market was long during the night time periods and alternated between long and short during the daytime. Trades were required for Downward Regulation. Trades and BM Actions were required to manage thermal constraints throughout the day. Trades and BM actions supported Voltage Control. BM Actions also supported System Inertia.