

Date:

Saturday 13 Jul 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £3.61m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

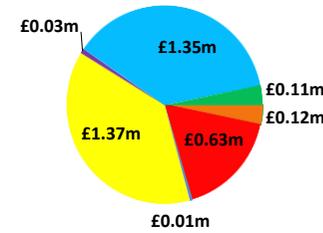

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

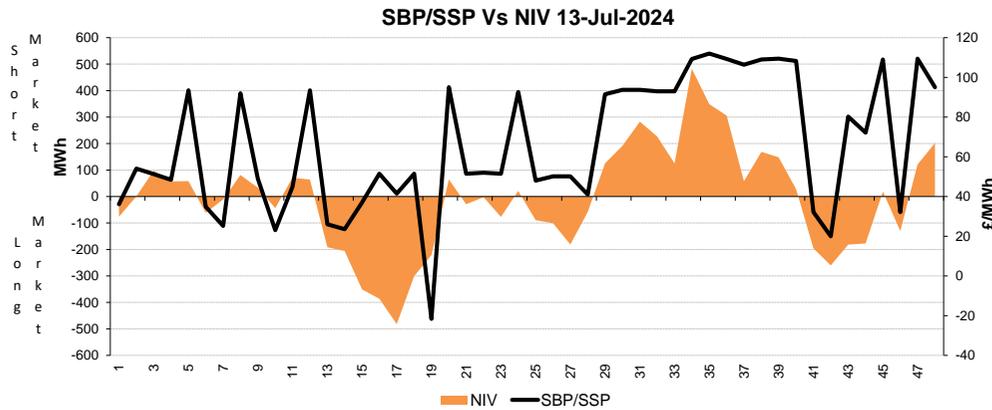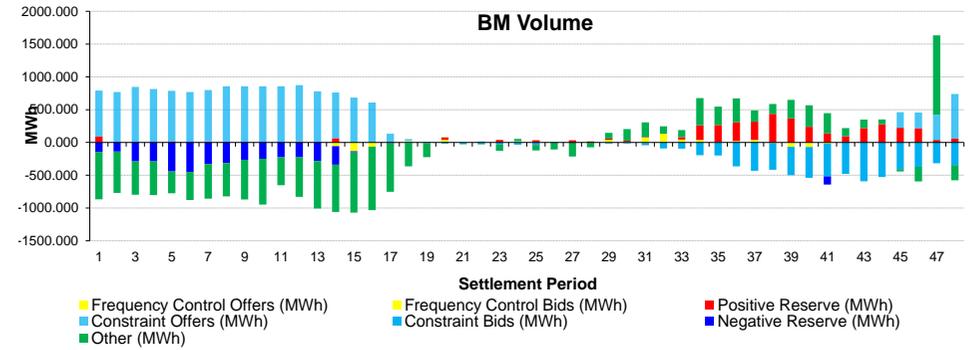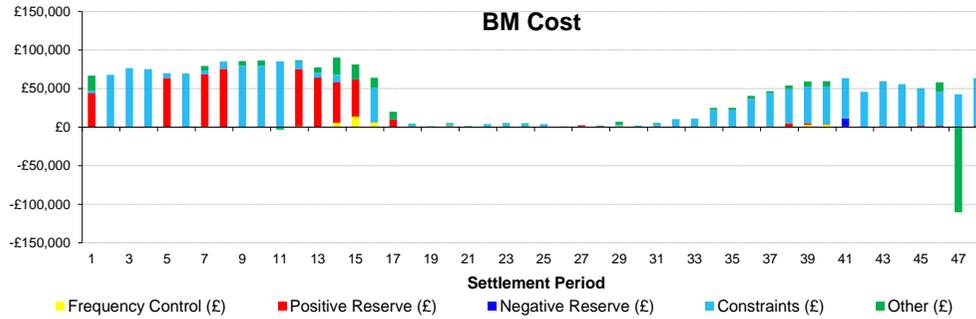

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped manage thermal constraints in Scotland throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.