

Date:

Tuesday 16 Jul 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £3.65m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

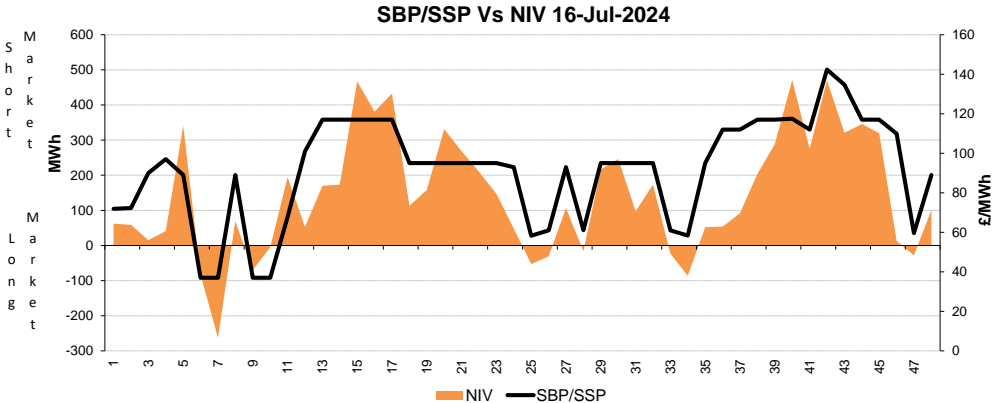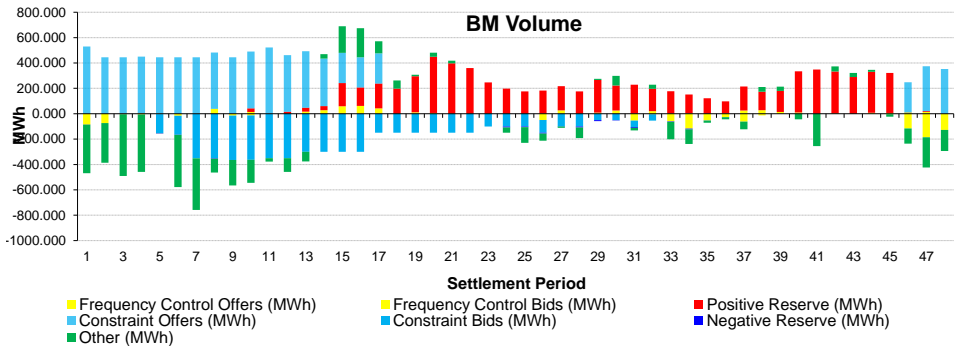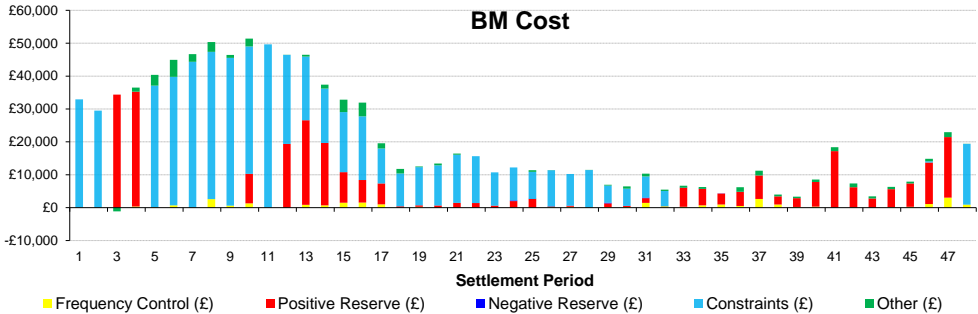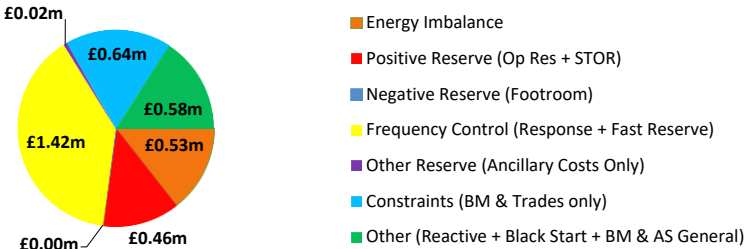

Commentary

The market was predominantly short throughout the day and long for few period. Trades were required for Downward Regulation. Trades and BM Actions helped manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control. BM Actions supported System Inertia.