

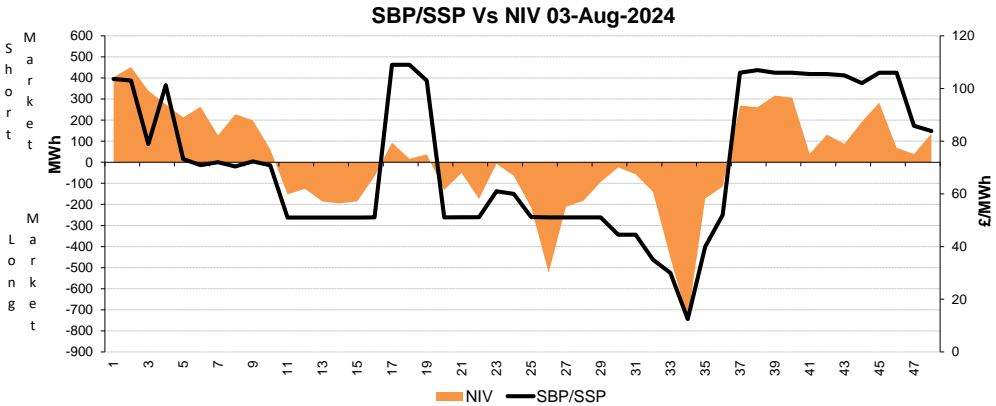
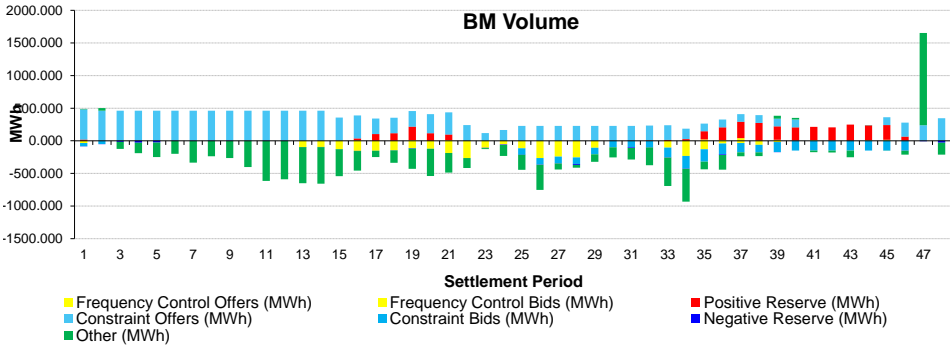
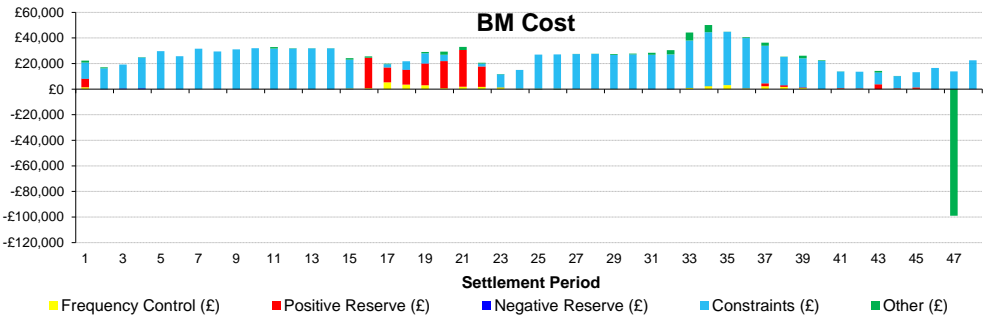


# Daily Balancing Costs

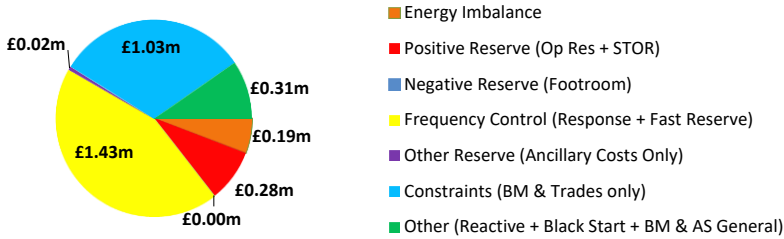

BM Cost (Indicative)

AS Cost (Estimate)



## Commentary

The market was short during the overnight/evening periods of 00:00-05:00 and 18:00-00:00, and predominantly long during the daytime period in between. No trades were required for Margin or Downward Regulation. Trades and BM Actions were required to manage thermal constraints in Southern England mainly during the second half of the day. Trades and BM Actions also supported Voltage Control.