

Date:

Tuesday 01 Oct 2024

BSUoS Final Tariff: £7.60/MWh



Total Outturn: £5.50m

# Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

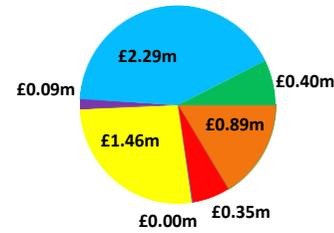

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

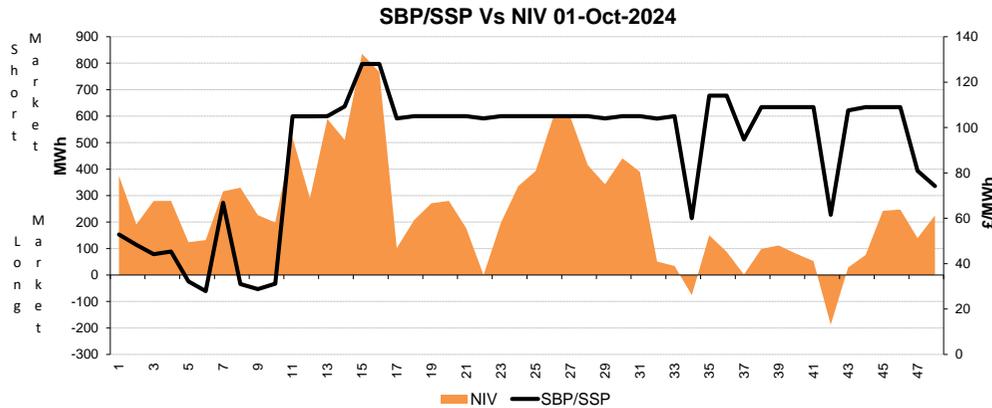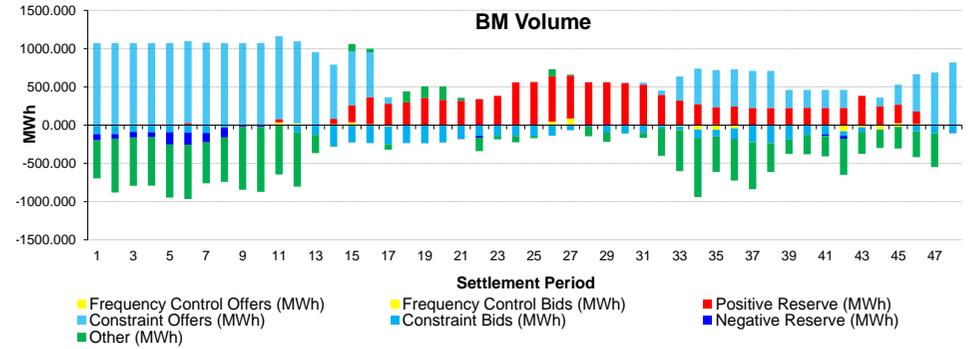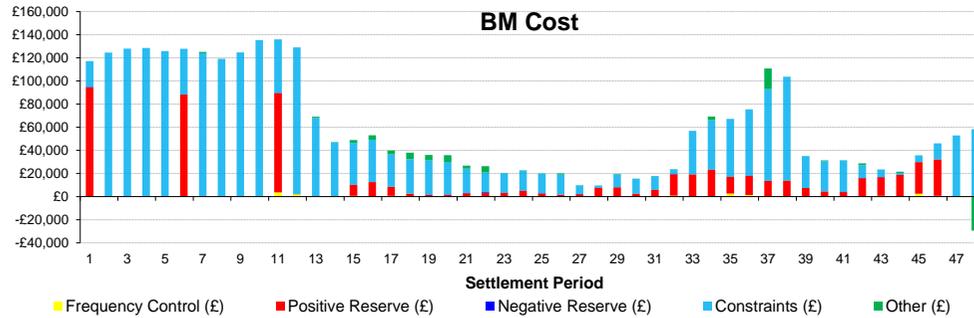

## Commentary

The market was short throughout the day except two long periods at 16:30-17:00 and 20:30-21:00. Trades were required for Downward Regulation. BM Actions helped to manage thermal constraints in Scotland throughout the day while Trades and BM Actions helped manage thermal constraints in Southern England during the afternoon. Trades and BM Actions also supported Voltage Control and further BM Actions supported System Inertia.