

Date: Thursday 03 Oct 2024



BSUoS Final Tariff: £7.60/MWh

Total Outturn: £3.40m




Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)

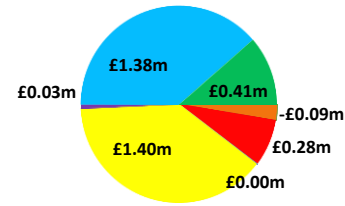

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

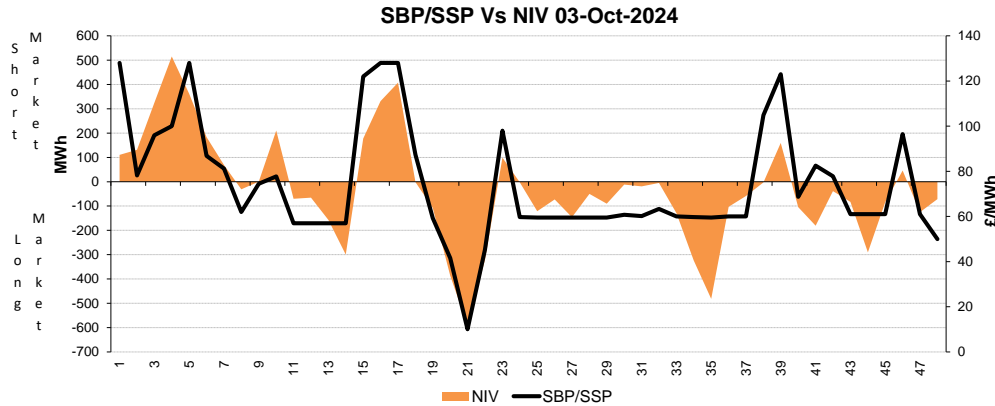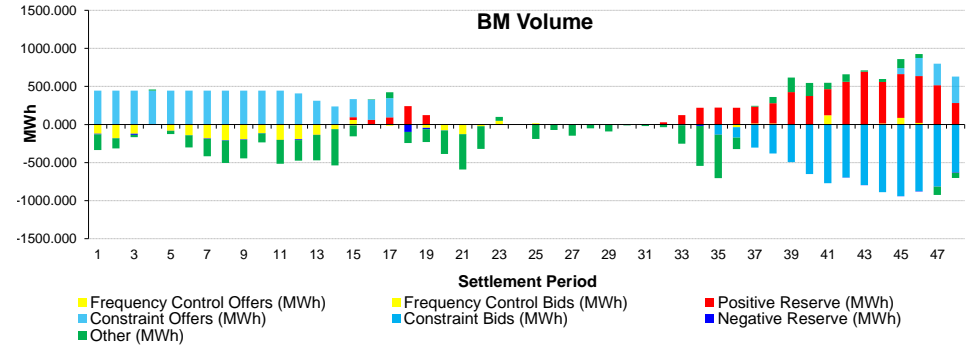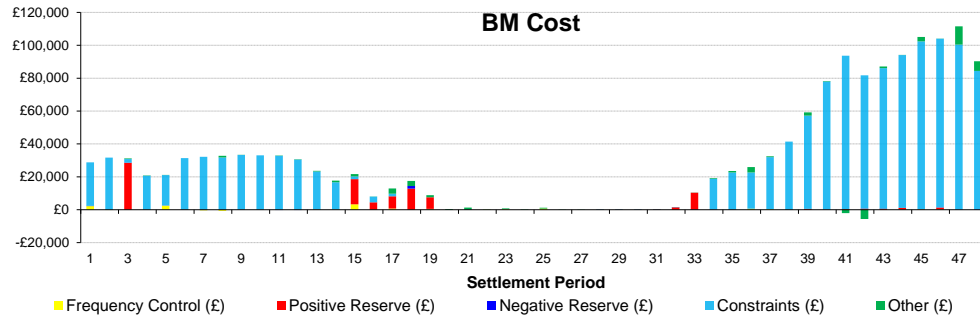

Commentary

The market alternated between long and short until 08:30 and then was predominantly long for the remainder of the day. No trades were required for Downward Regulation or Margin. BM Actions were required to manage thermal constraints in Scotland from the late afternoon through to the end of the day. BM Actions also supported Voltage Control.