

Date:

Saturday 28 Sep 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £4.40m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

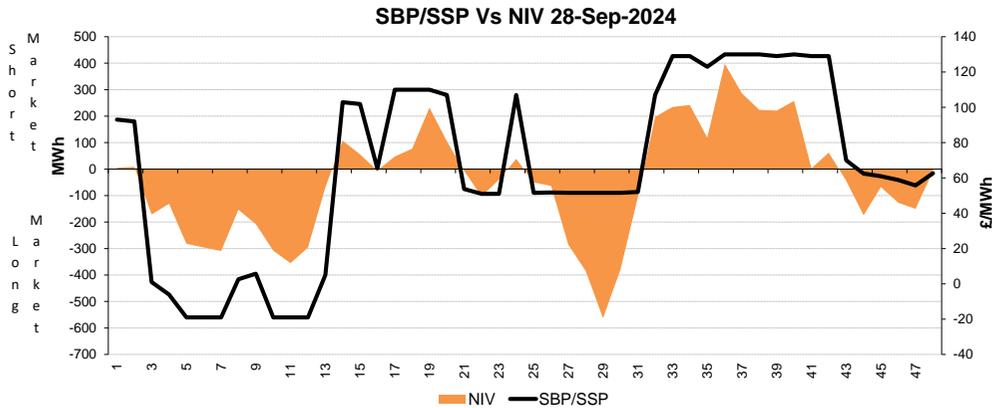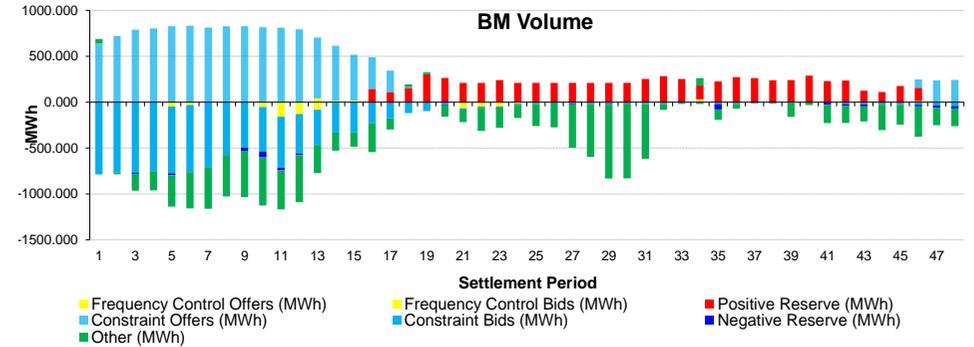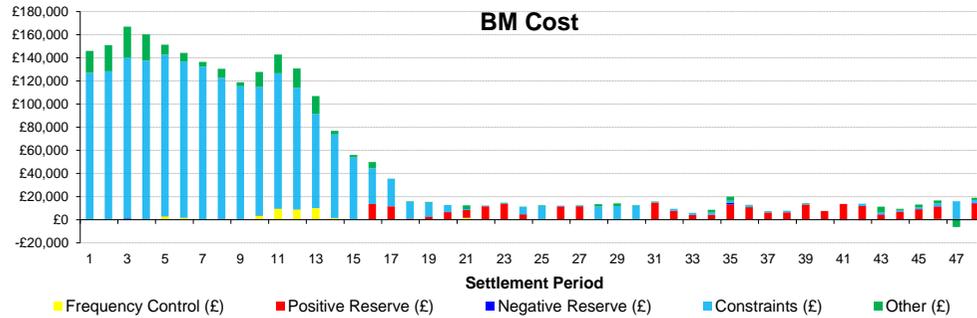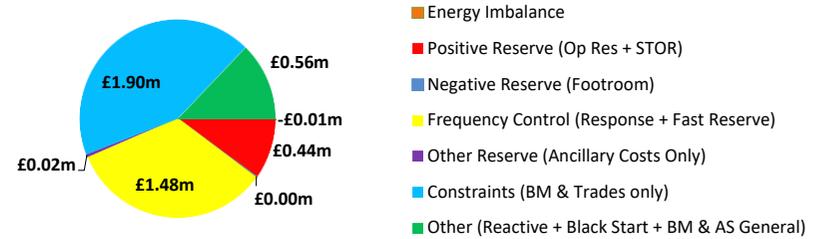

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped to manage thermal constraints in Scotland predominantly during the early hours and also helped to manage thermal constraints in England during the rest of the day. Trades and BM Actions supported Voltage Control and further BM Actions were required to support System Inertia.