

Date:

Saturday 14 Sep 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £18.92m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

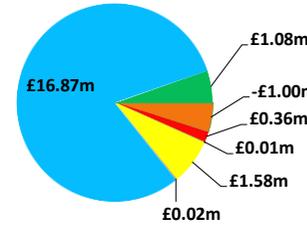

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

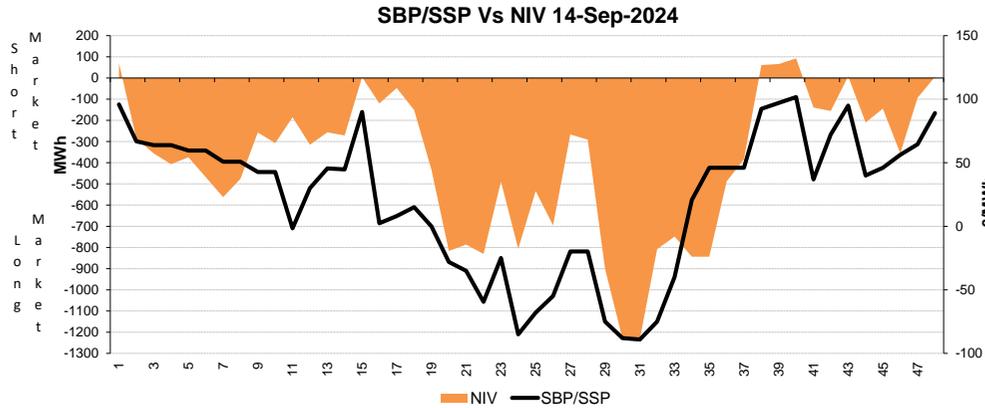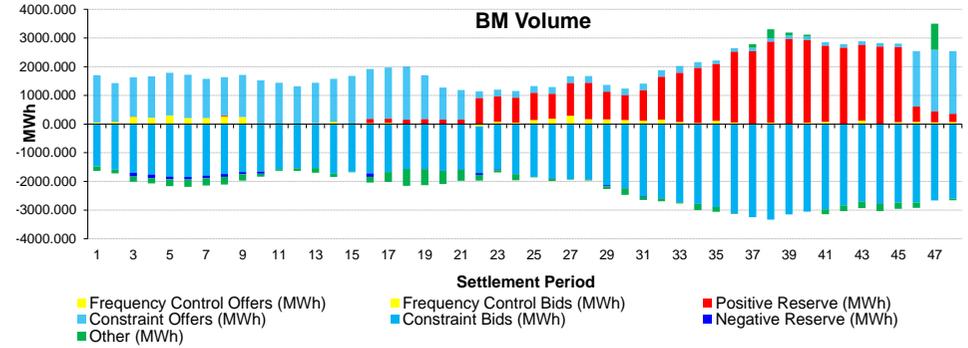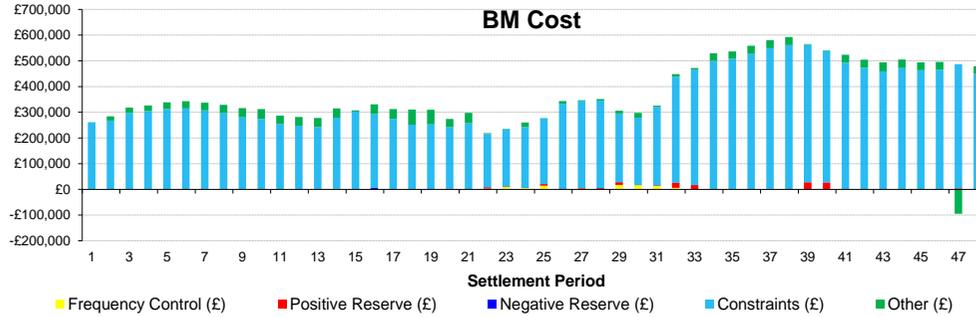

Commentary

The market was predominantly long throughout the day except for some short periods between 00:00-00:30, 07:00-07:30, 18:30-20:00, 21:00-21:30, 23:30-24:00. Trades were required for Downward Regulation and Margin. Trades and BM Actions helped to manage thermal constraints in England and Scotland throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.