

Date: Monday 30 Sep 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £4.67m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

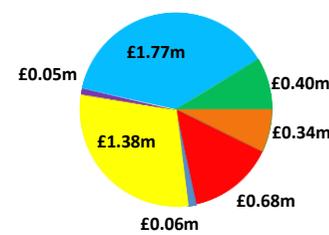

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

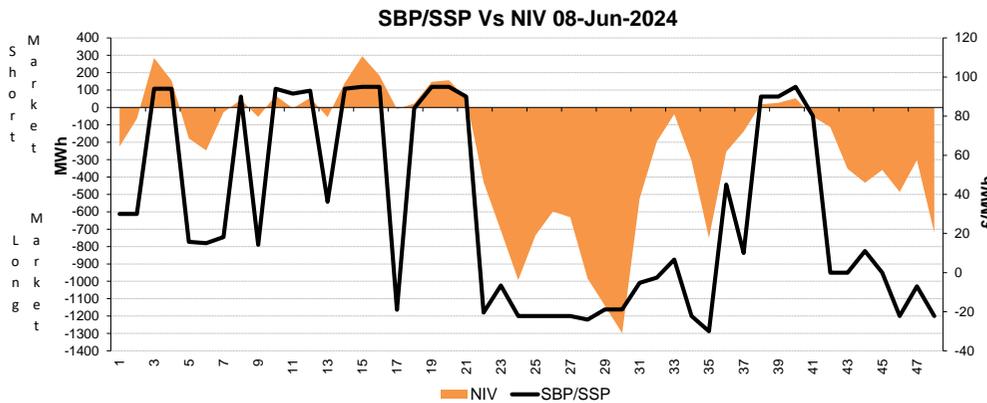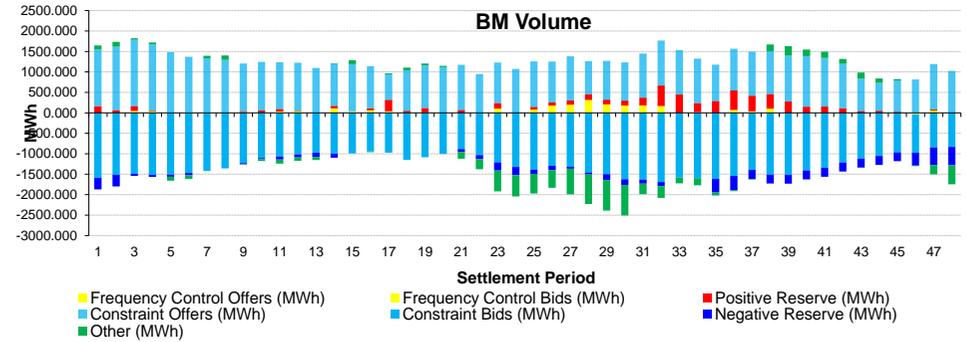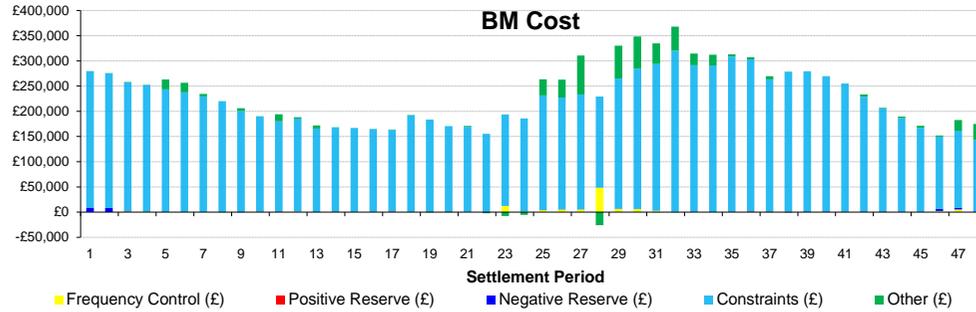

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation.

BM Actions helped manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.