






Date: Friday 13 Sep 2024

BSUoS Final Tariff: £7.63/MWh
Total Outturn: £3.80m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

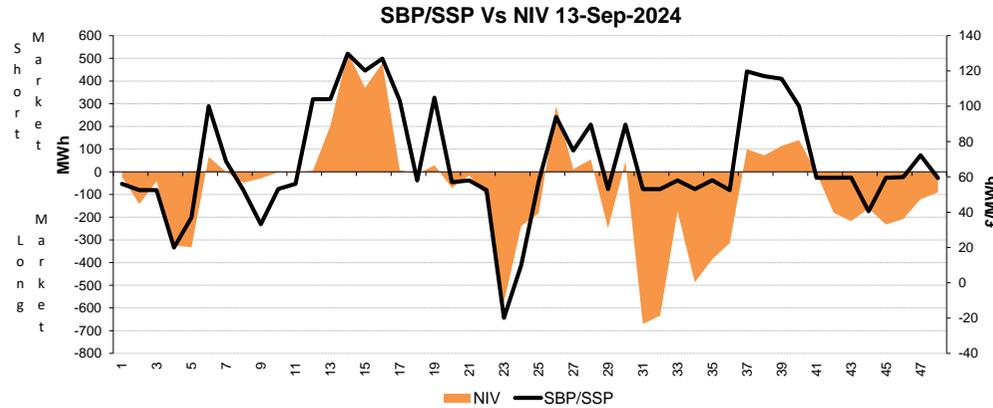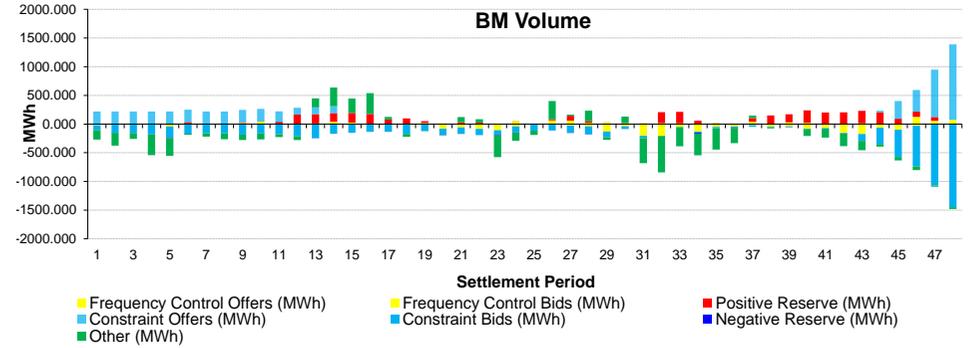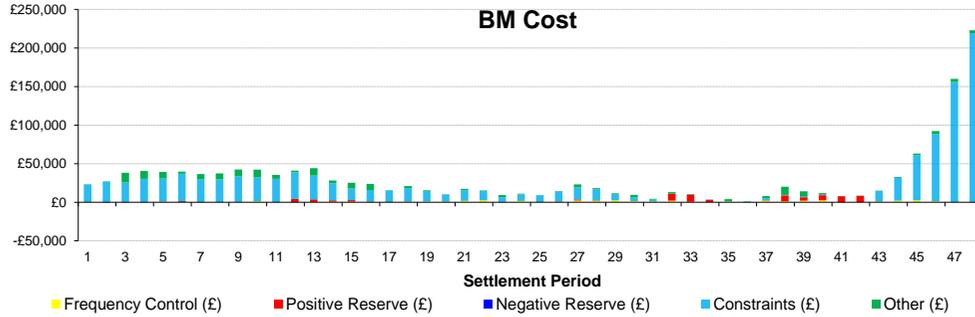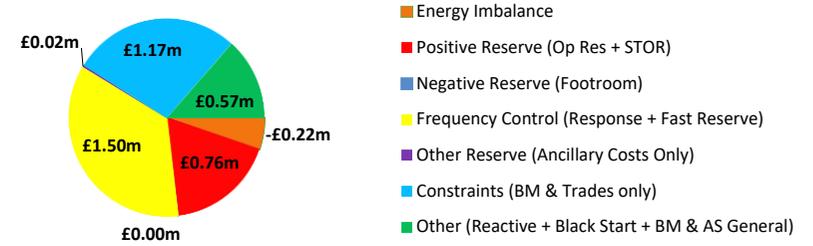

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. BM Actions helped to manage thermal constraints in Scotland until afternoon and late evening. BM actions also helped to manage thermal constraints in England predominantly during late evening periods. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.