

Date:

Monday 09 Sep 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £5.86m

Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)

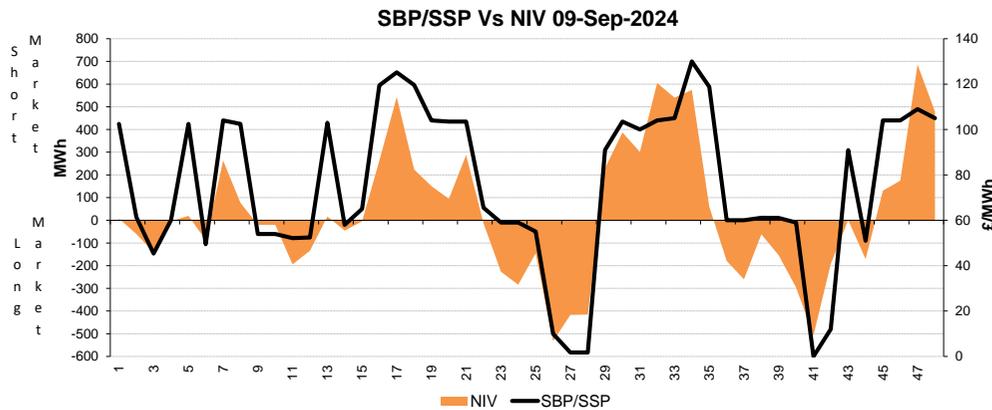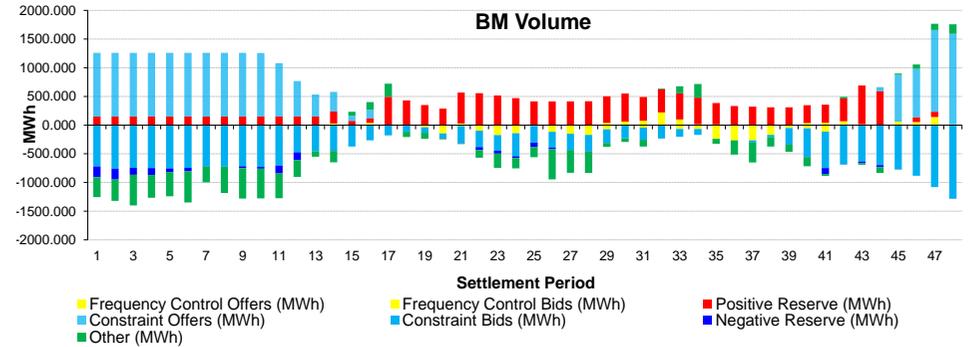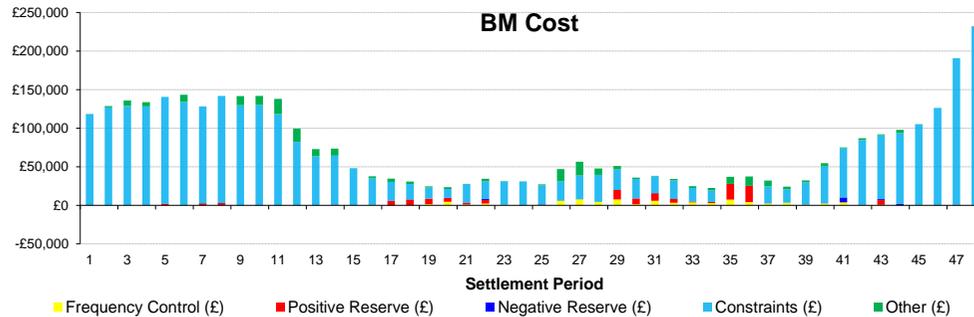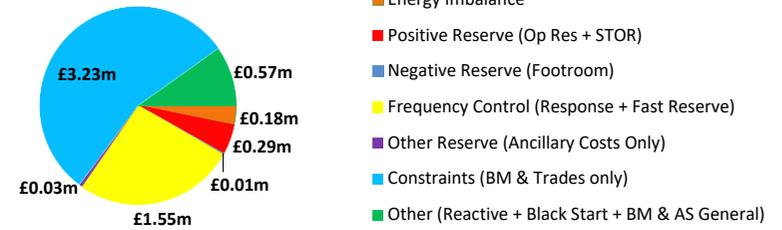

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions helped to manage thermal constraints across England, Scotland and Wales at points throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.