

Date:

Saturday 05 Oct 2024

BSUoS Final Tariff: £12.17/MWh



Total Outturn: £7.41m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

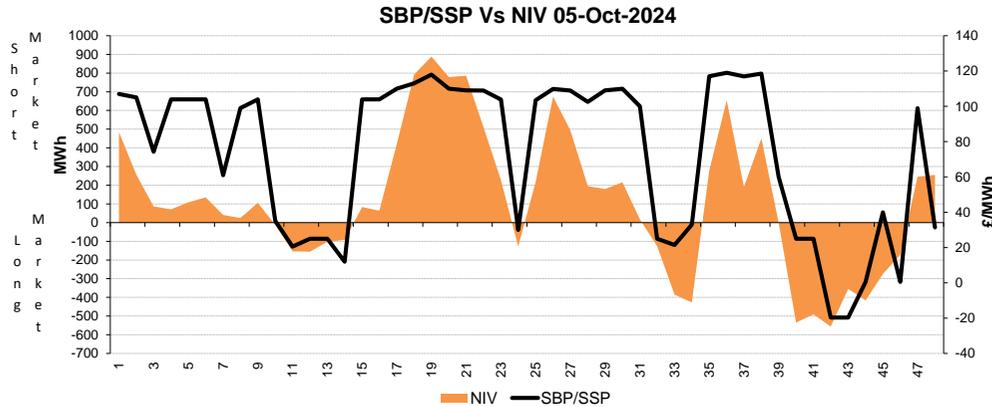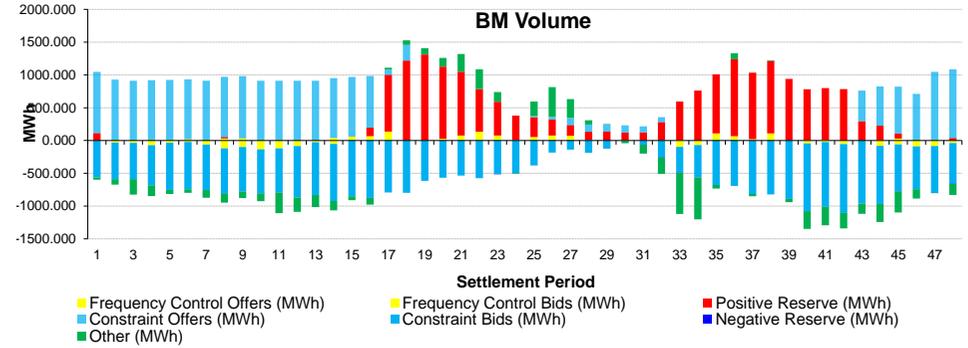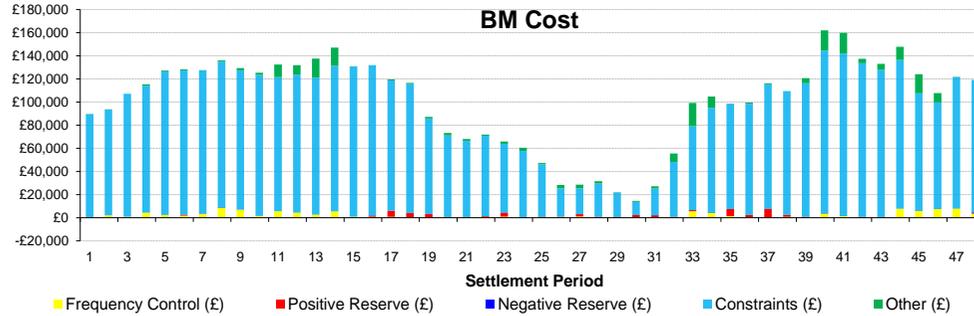

Commentary

The market was alternating between long and short throughout the day. No trades were required for Downward Regulation or Margin. BM Actions were required to manage thermal constraints in Scotland throughout the day. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.