

Date: Thursday 10 Oct 2024



BSUoS Final Tariff: £12.17/MWh
Total Outturn: £6.80m

Daily Balancing Costs





BM Cost (Indicative)


AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

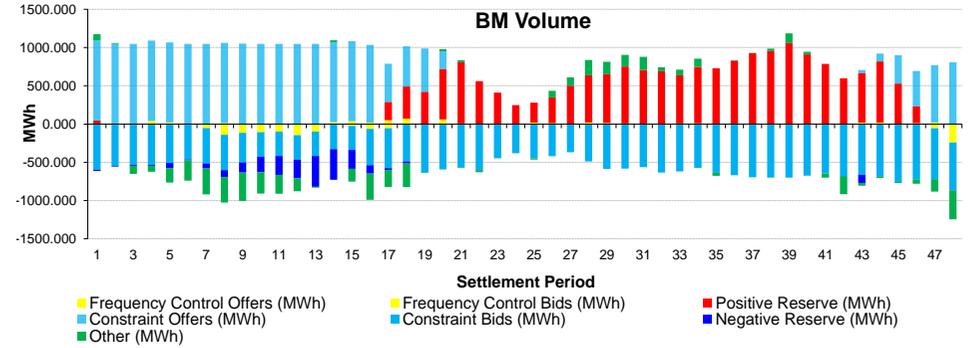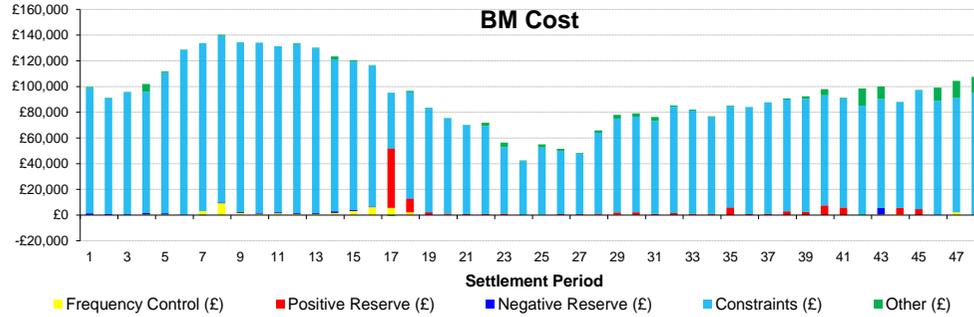

SBP/SSP Vs NIV 06-Oct-2024

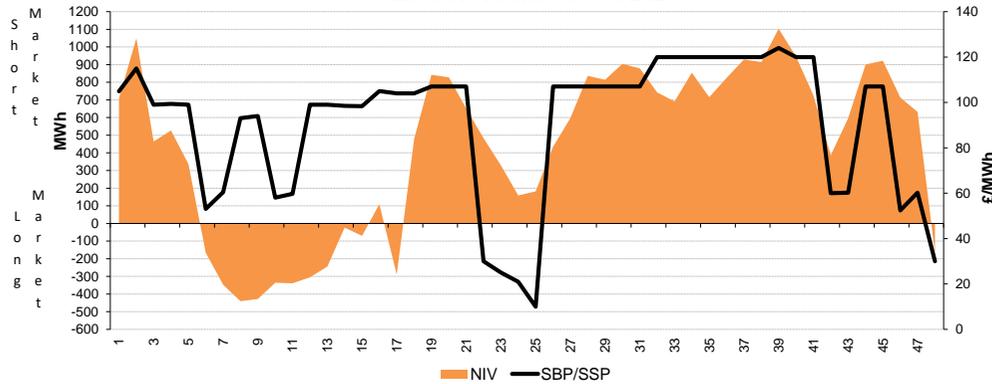

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped manage thermal constraints in Scotland throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were required to support System Inertia.