



Date: Sunday 06 Oct 2024

BSUoS Final Tariff: £12.17/MWh  
Total Outturn: £7.20m




# Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

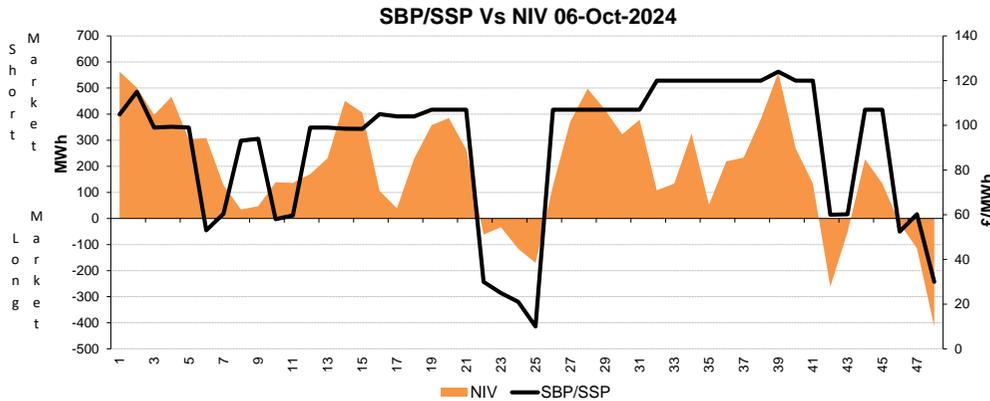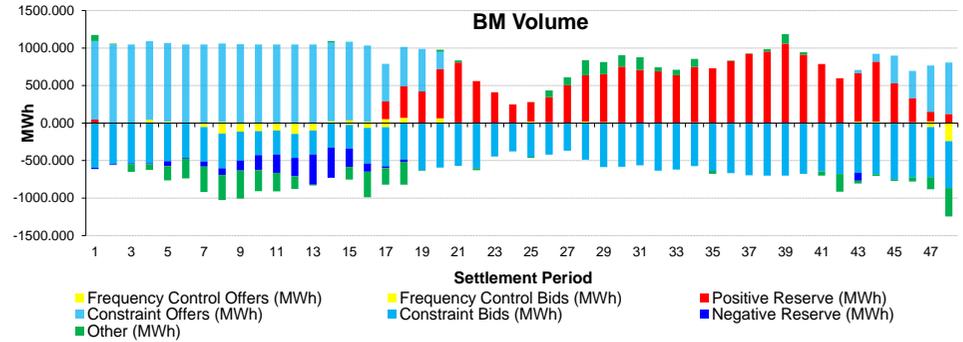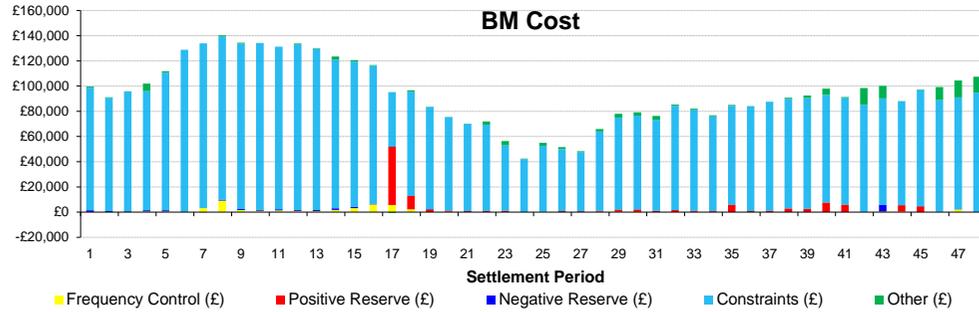

## Commentary

The market was predominantly short throughout the day except for some long periods between 10:30-12:30, 20:30-21:30, and 22:30-00:00. Trades were required for Downward Regulation. BM Actions helped amnange thermal constraints in Scotland throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were required to support System Inertia.