



Date: Monday 28 Oct 2024

BSUoS Final Tariff: £12.17/MWh
Total Outturn: £4.91m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

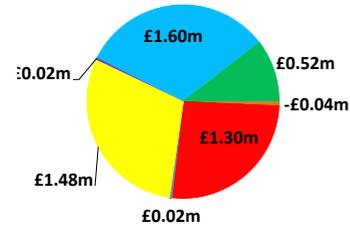

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

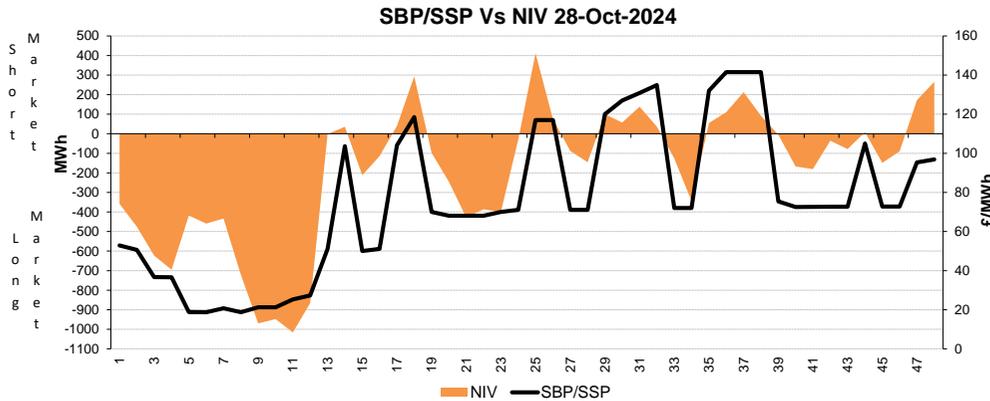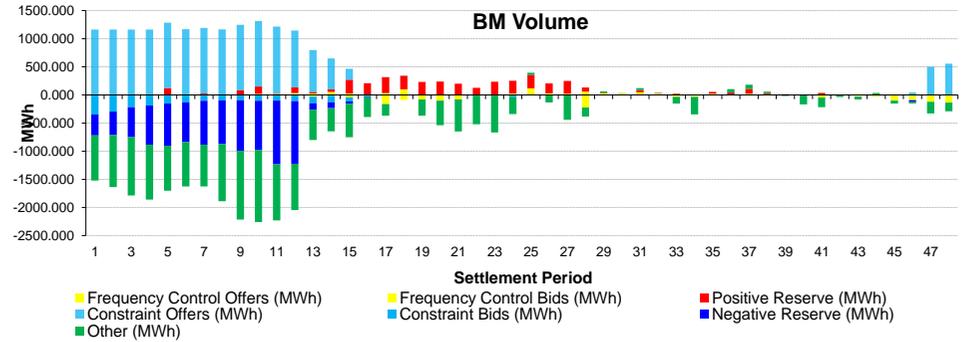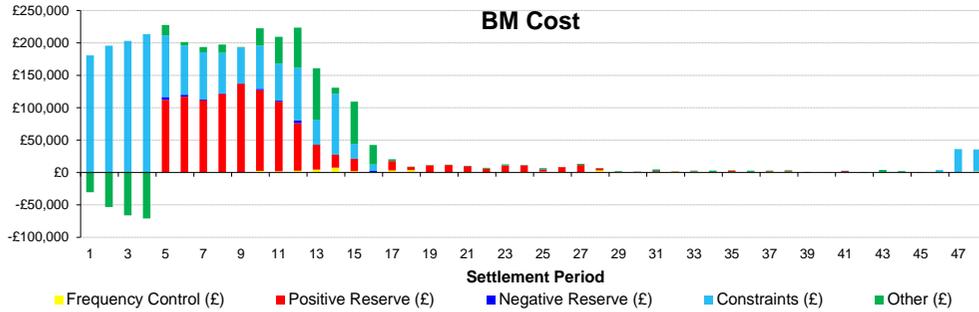

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions were required to manage thermal constraints in Scotland and southern England throughout the early morning. Trades and BM Actions supported Voltage Control. Further BM Actions supported System Inertia.