



Date: Wednesday 23 Oct 2024

BSUoS Final Tariff: £12.17/MWh
Total Outturn: £15.41m




Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)

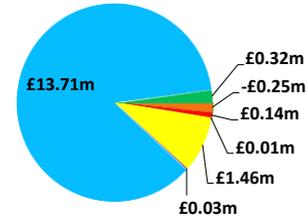

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

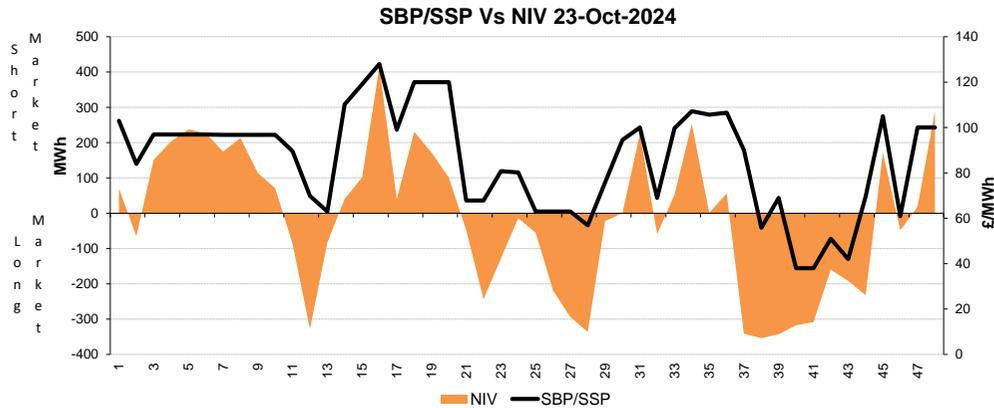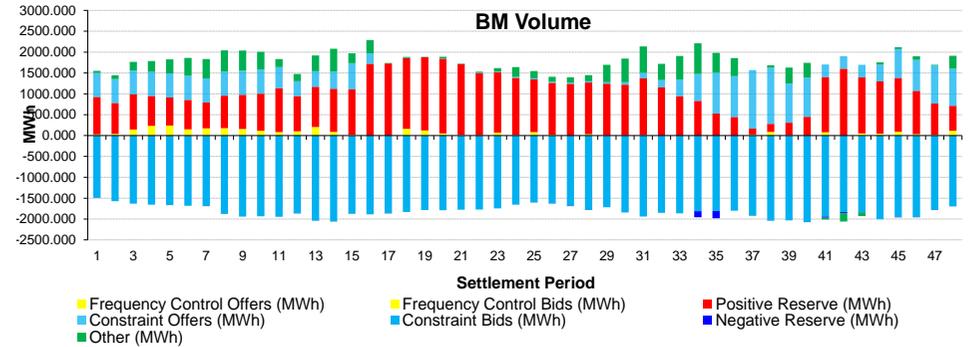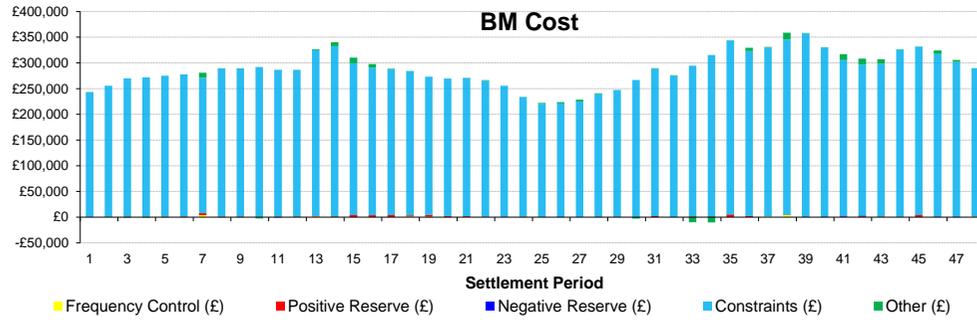

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. Trades and BM Actions were required to manage thermal constraints in Scotland throughout the day and at points during the day in England. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.