



Date: Monday 13 Jan 2025

BSUoS Final Tariff: £12.17/MWh
Total Outturn: £18.06m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

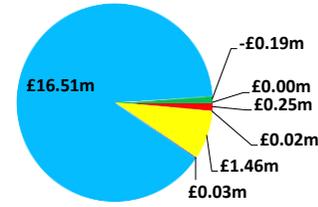

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

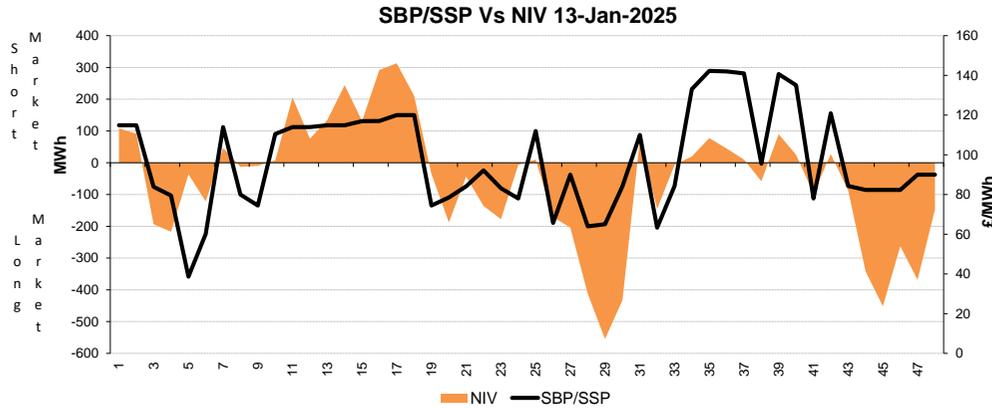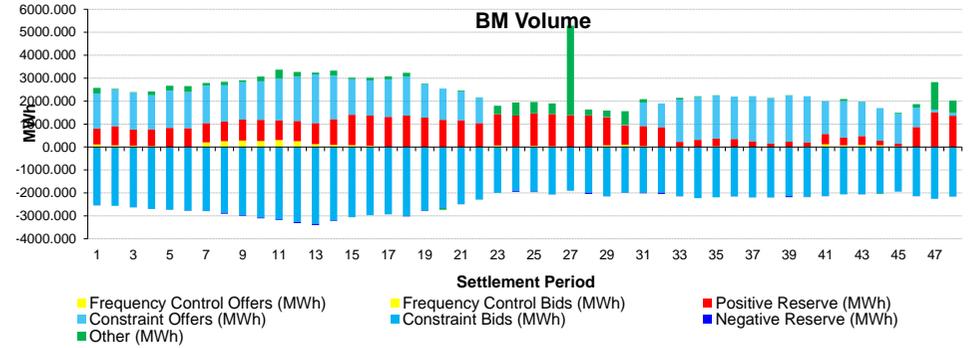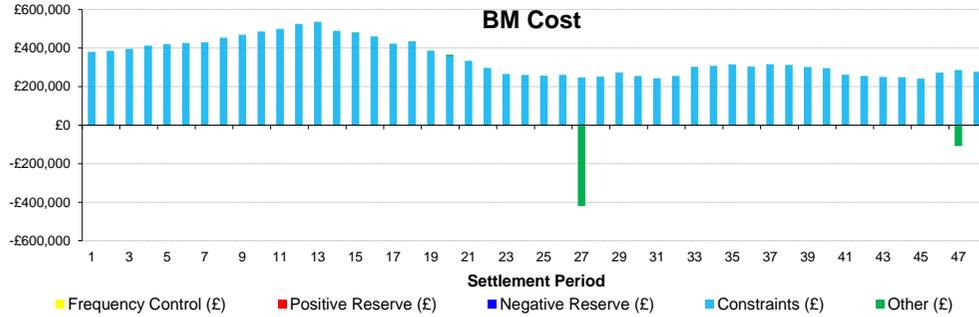

Commentary

The market was alternating between long and short throughout the day. No trades were required for Margin or Downward Regulation. Trades and BM Actions were required to manage thermal constraints in Scotland and England throughout the day. BM Actions supported Voltage Control.