



Date: Thursday 16 Jan 2025

BSUoS Final Tariff: £12.17/MWh  
Total Outturn: £11.82m




# Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)

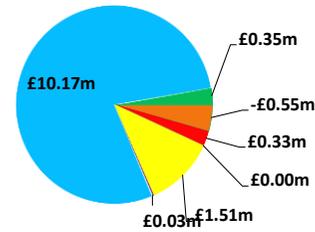

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

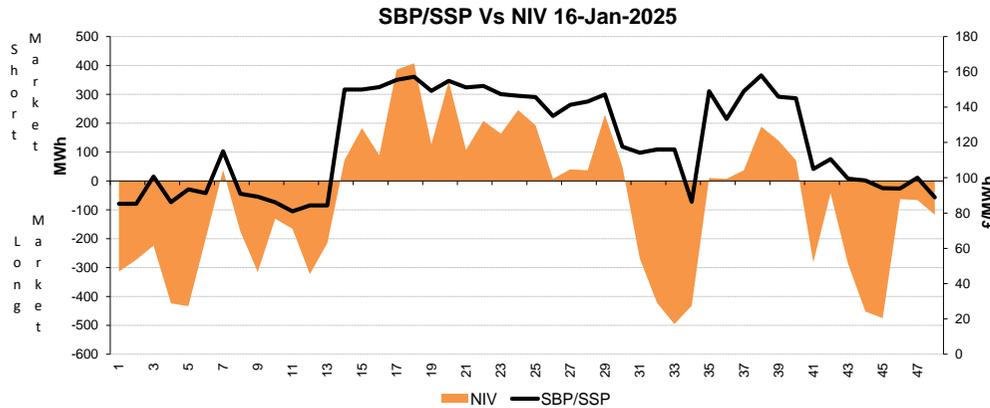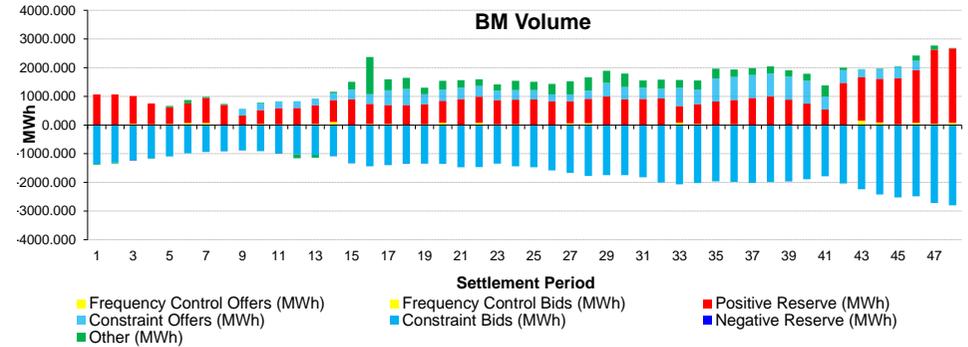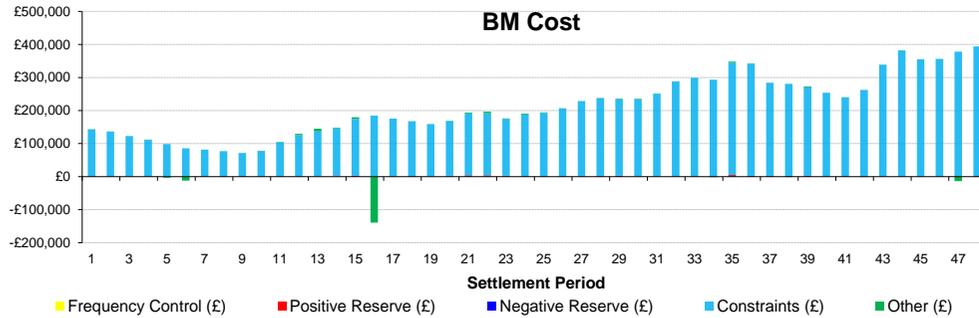

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. BM Actions were required to manage thermal constraints in Scotland/Northern England throughout the day. Trades and BM Actions also helped to manage thermal constraints in Southern England. BM Actions supported Voltage Control.