

Date: **Saturday 25 Jan 2025**



BSUoS Final Tariff: £12.17/MWh

Total Outturn: £8.29m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

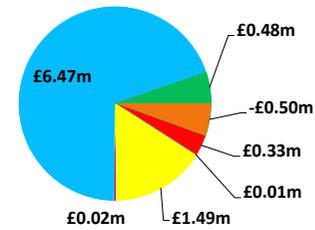

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

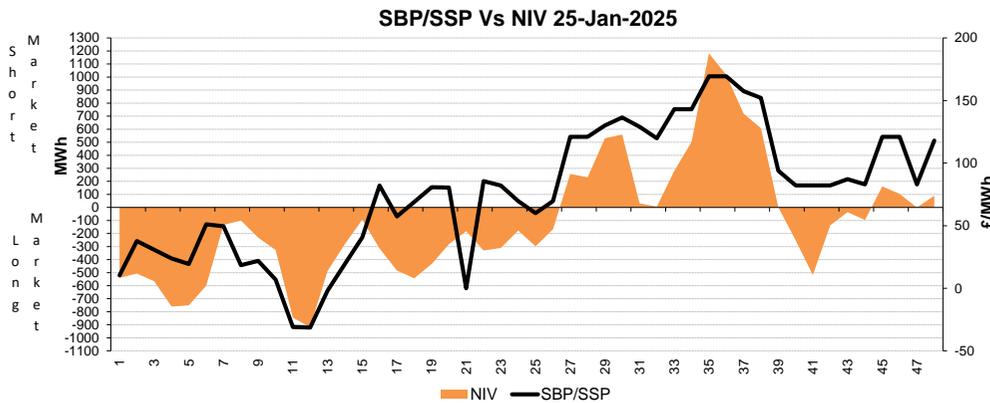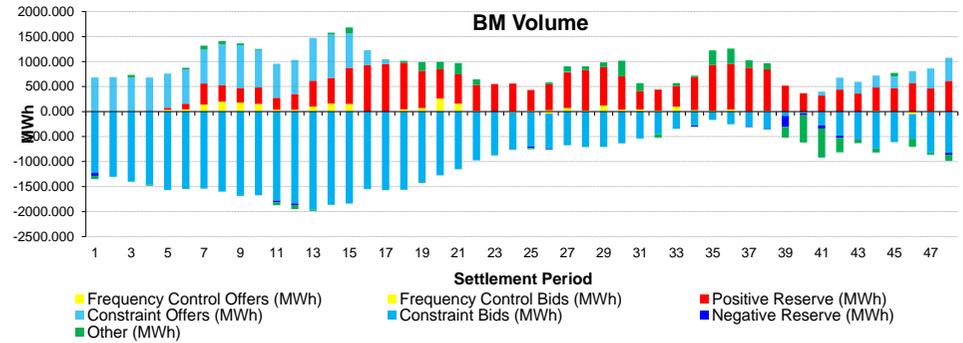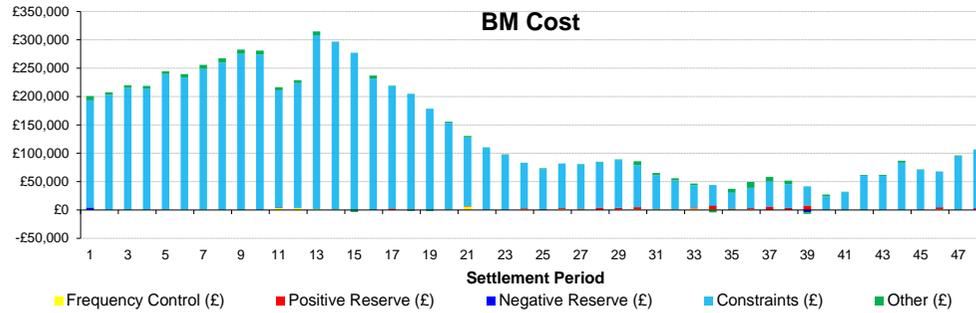

Commentary

The market was alternating between long and short throughout the day. No trades were required for Margin or Downward Regulation. BM Actions helped manage thermal constraints in Scotland and Northern England throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support RoCoF.