

Date: Wednesday 22 Jan 2025

BSUoS Final Tariff: £12.17/MWh

Total Outturn: £6.26m

Daily Balancing Costs




BM Cost (Indicative)




AS Cost (Estimate)

£2.00m

£4.26m

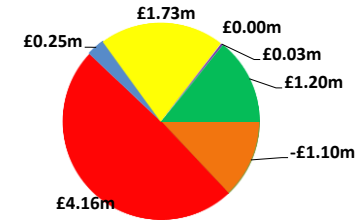

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

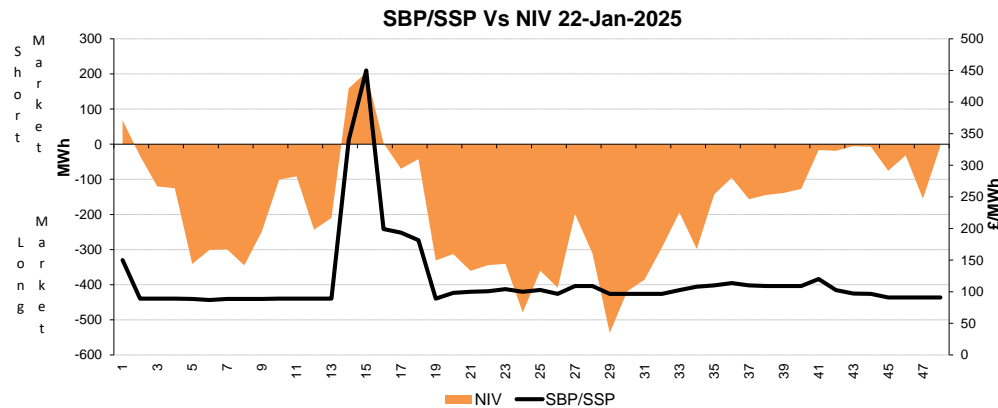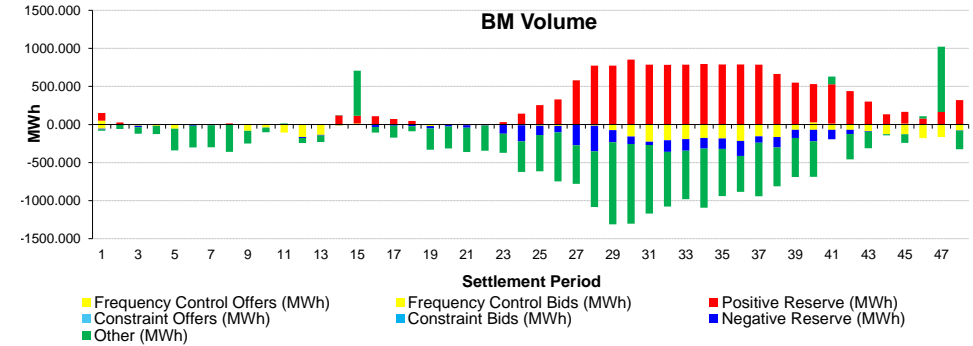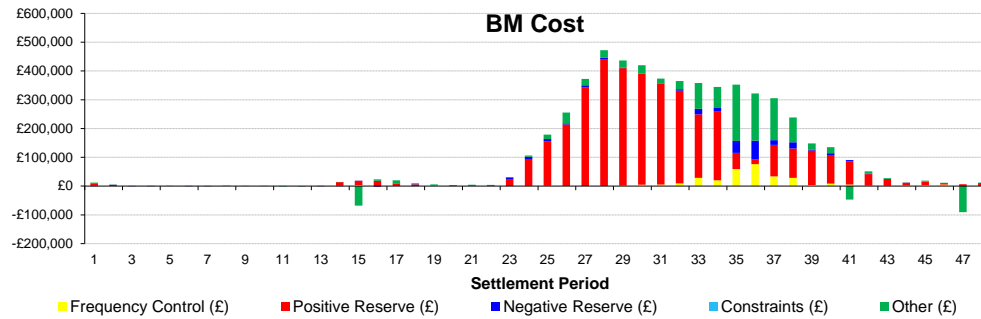

Commentary

The market was long throughout the day with only two short periods (00:00-00:30 and 06:30-08:00). No trades were required for Margin or Downward Regulation. No action was required to manage constraints.