
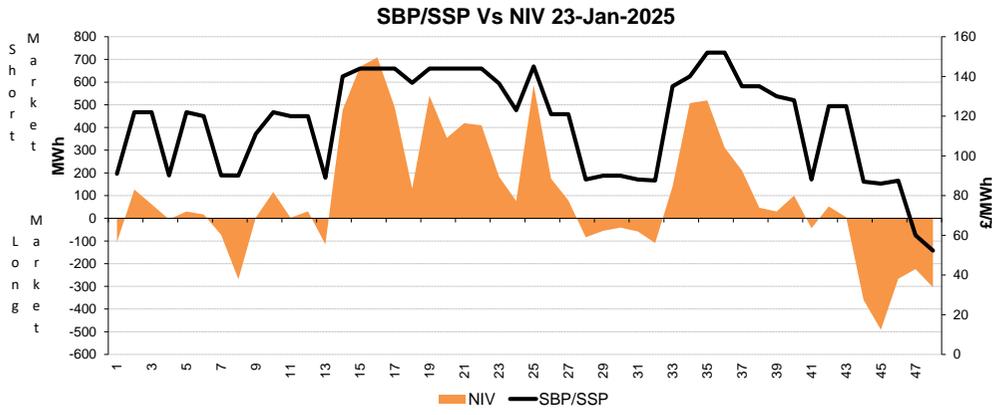
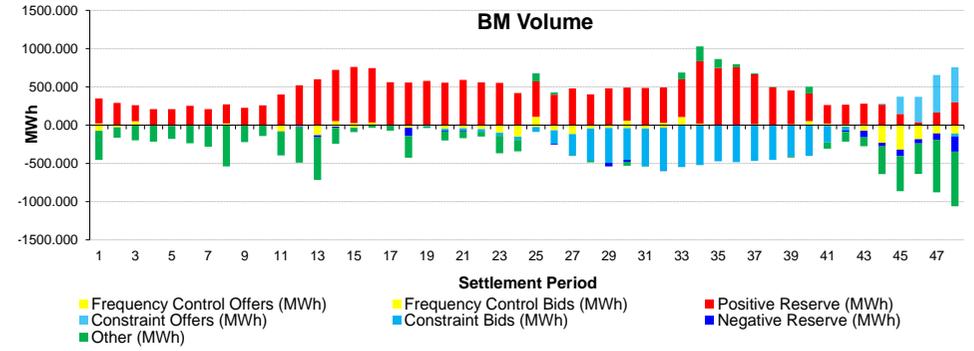
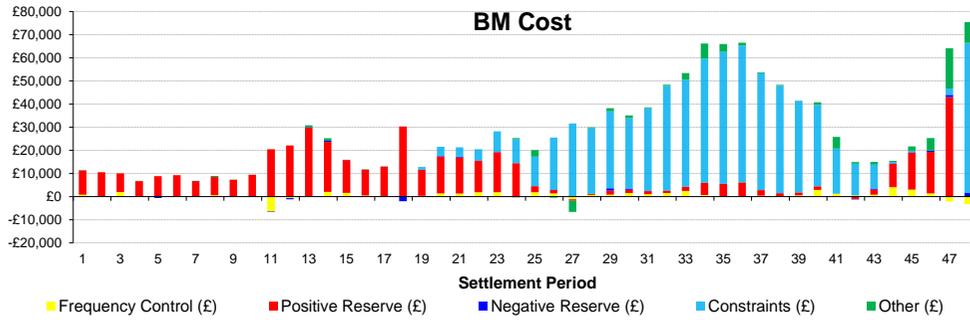
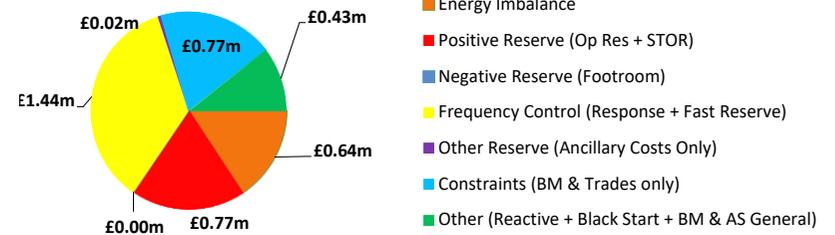


Date: Thursday 23 Jan 2025

BSUoS Final Tariff: £12.17/MWh
Total Outturn: £4.08m

Daily Balancing Costs

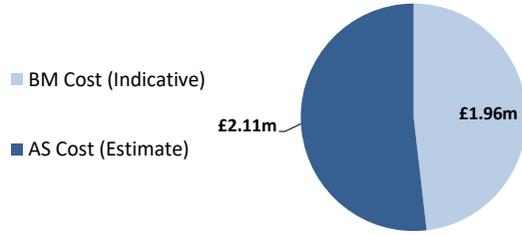

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped to manage thermal constraints in Scotland/Northern England predominantly during the daytime. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.