

Date: Thursday 20 Feb 2025

BSUoS Final Tariff: £12.17/MWh



Total Outturn: £20.74m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)

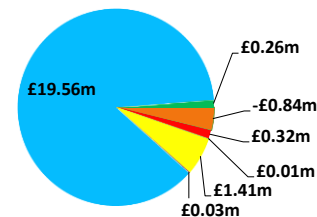

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

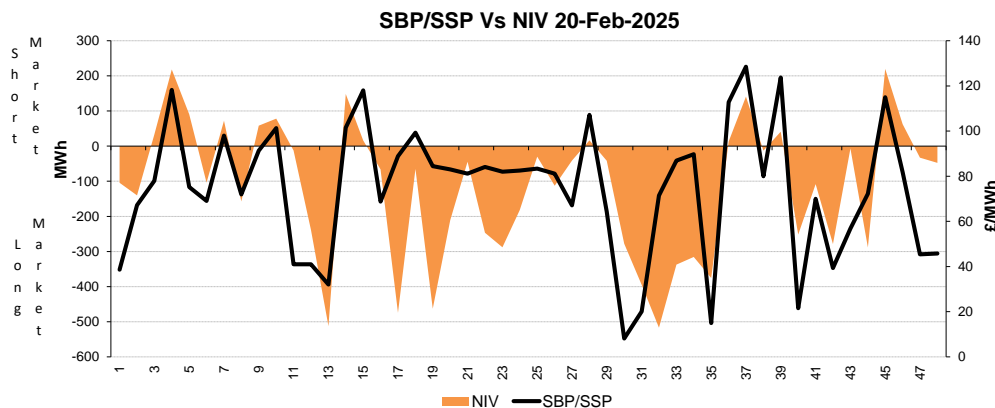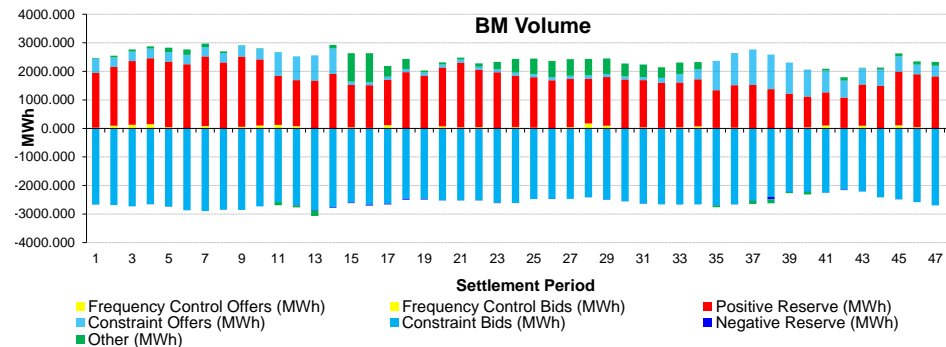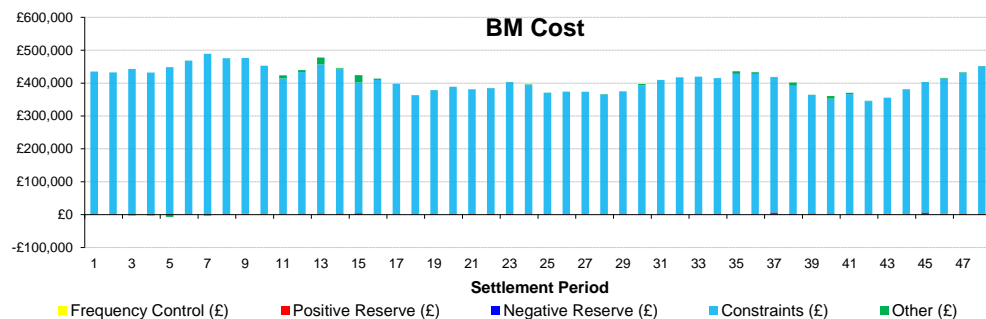

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. Trades and BM Actions were required to manage thermal constraints in Scotland and England throughout the day. Trades and BM Actions supported Voltage Control.