



Date: Thursday 27 Mar 2025

BSUoS Final Tariff: £12.17/MWh
Total Outturn: £11.67m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

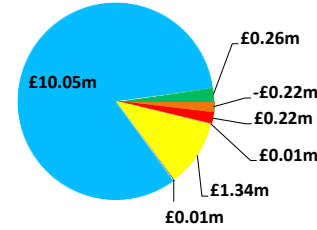

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

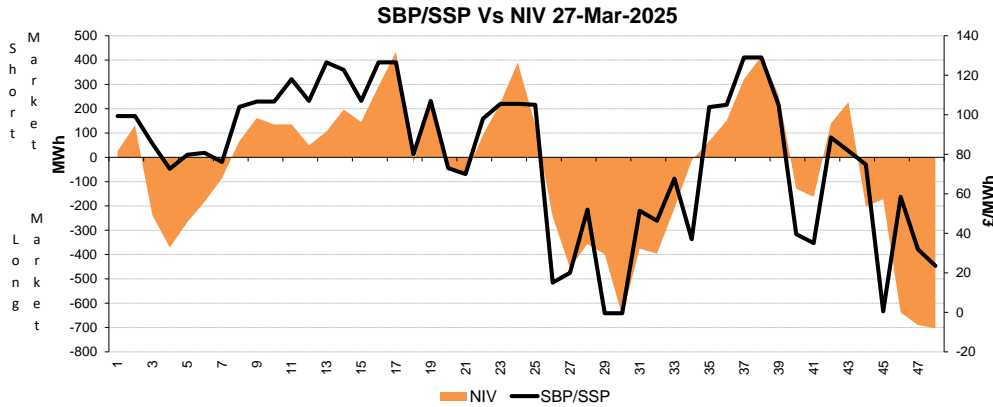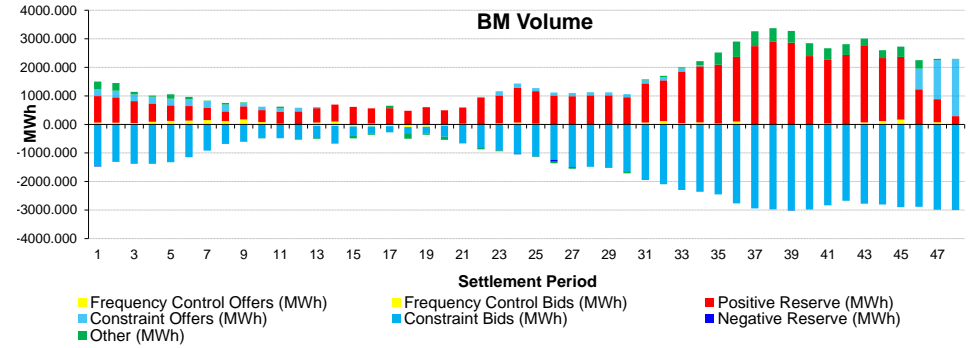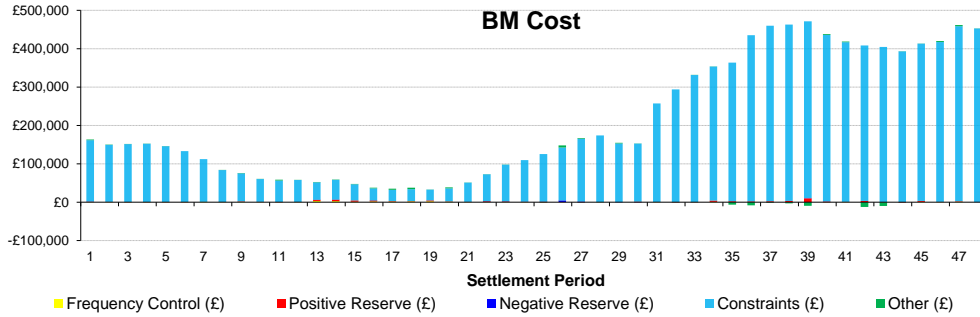

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. BM Actions were required to manage thermal constraints in Scotland and North England throughout the day. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.