






Date: **Saturday 29 Mar 2025**

**BSUoS Final Tariff: £12.17/MWh**  
**Total Outturn: £15.09m**

# Daily Balancing Costs



■ BM Cost (Indicative)  
 ■ AS Cost (Estimate)

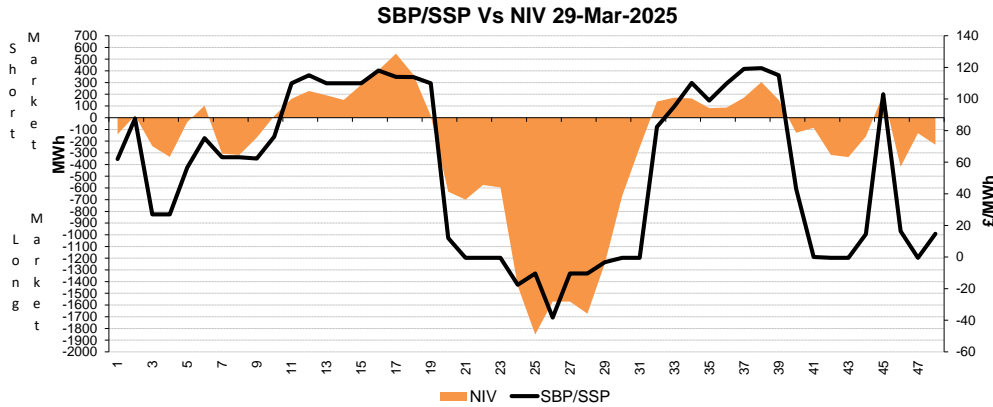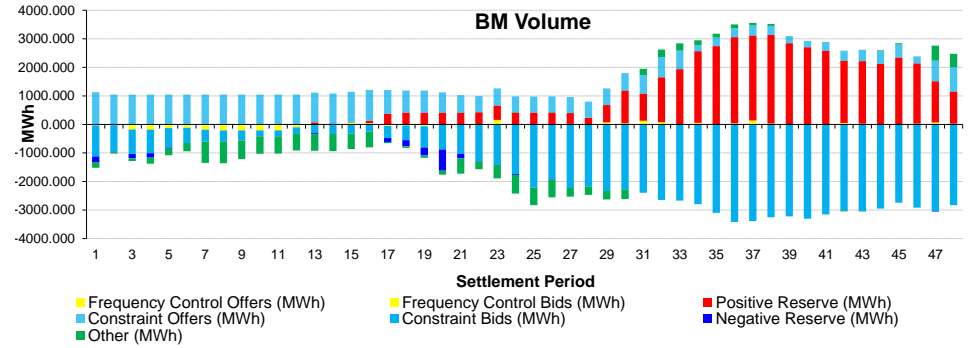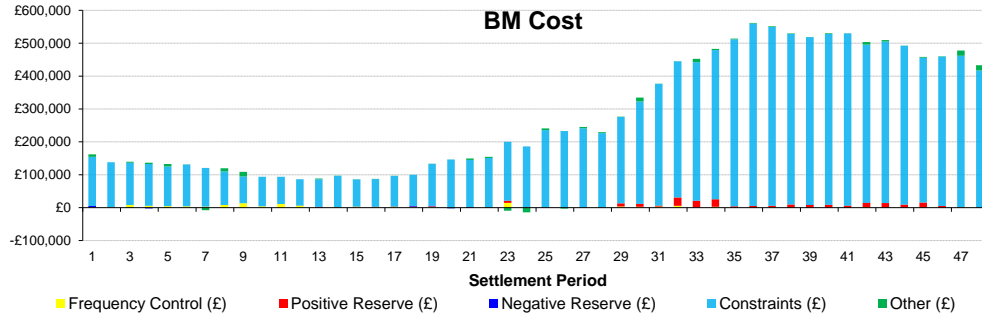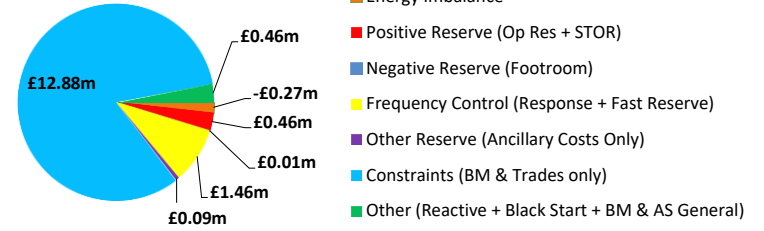

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. BM Actions were required to manage thermal constraints in England and Scotland throughout most of the day. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.