

Date:

Saturday 22 Mar 2025






BSUoS Final Tariff: £12.17/MWh

Total Outturn: £8.99m

# Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)

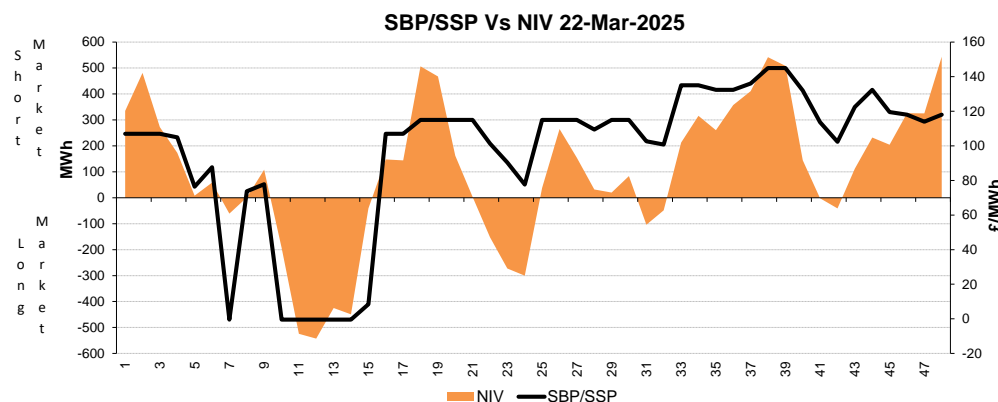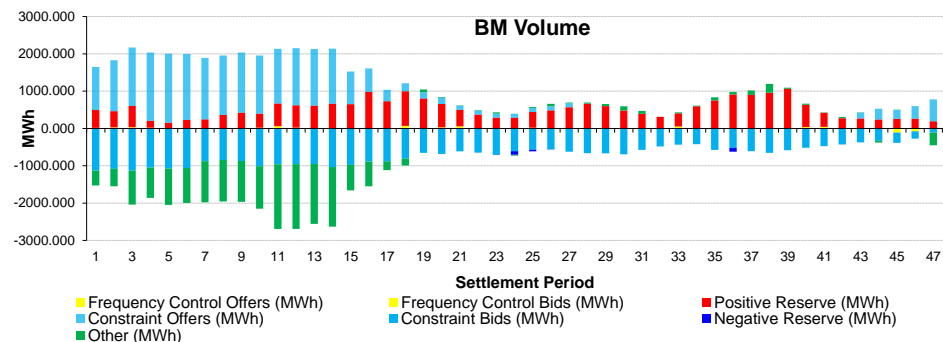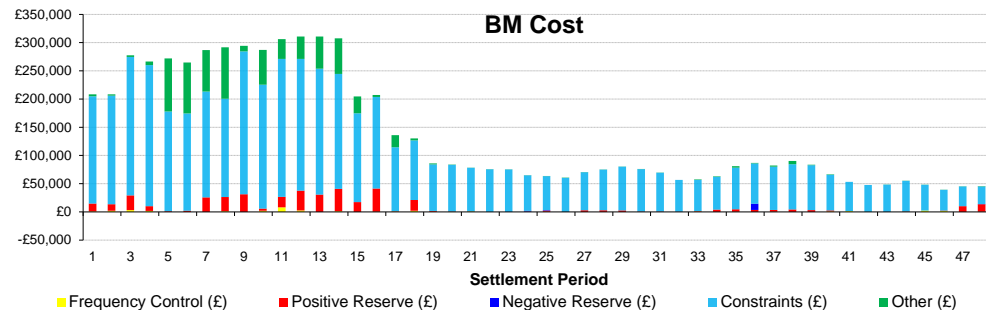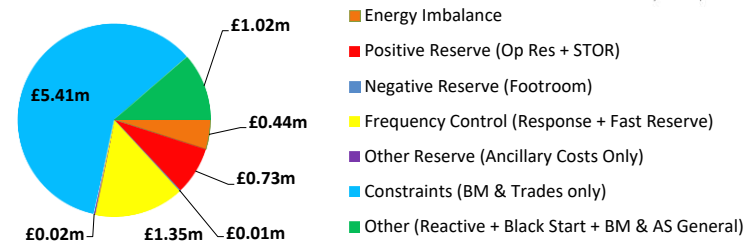

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. BM Actions were required to manage thermal constraints in Scotland throughout the day. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.